

ABB MEASUREMENT & ANALYTICS | DATA SHEET

CoriolisMaster FCB400, FCH400

Coriolis mass flowmeter



Measurement made easy

High-precision measurement of mass and volume flow, density, temperature and concentration with just one device

Up to five modular I/Os

- Optional plug-in cards
- Automatic firmware update
- Integrated solutions for filling operations and concentration measurement


SmartSensor

- All digital solution
- Measuring device intelligence located directly in the sensor
- Lower pressure loss

Integrated VeriMass device verification and diagnosis

- Predictive maintenance in the process
- Extended maintenance cycles
- Reduced maintenance effort

Overview – models

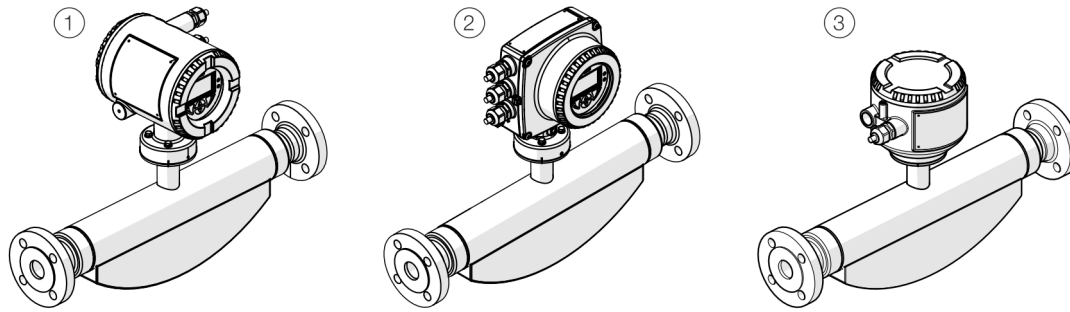

① Sensor (integral mount design, dual-compartment housing)

② Sensor (integral mount design, single-compartment housing)


③ Sensor (remote mount design)

Figure 1: Designs

| Sensor | | | | |
|--|--|---|--|---|
| Model | FCB400 standard design | | FCH400 hygienic design | |
| Chassis | Integral mount design, remote mount design | | | |
| Measuring accuracy for liquids | FCB430 | FCB450 | FCH430 | FCH450 |
| Mass flow* | 0.4 %, 0.25 % and 0.2 % | 0.1 % and 0.15 % | 0.4 %, 0.25 % and 0.2 % | 0.1 % and 0.15 % |
| Volume flow* | 0.4 %, 0.25 % and 0.2 % | 0.15 % and 0.11 % | 0.4 %, 0.25 % and 0.2 % | 0.15 % and 0.11 % |
| Density | 0.01 kg/l | <ul style="list-style-type: none"> 0.002 kg/l 0.001 kg/l (optional) 0.0004 kg/l (optional) | 0.01 kg/l | <ul style="list-style-type: none"> 0.002 kg/l 0.001 kg/l (optional) 0.0004 kg/l (optional) |
| Temperature | 1 K | 0,5 K | 1 K | 0,5 K |
| Measuring accuracy for gases* | 1 % | 0,5 % | 1 % | 0,5 % |
| Permissible measuring medium temperature T_{medium} | -50 to 160 °C (-58 to 320 °F) | -50 to 205 °C (-58 to 400 °F) | -50 to 160 °C (-58 to 320 °F) | -50 to 205 °C (-58 to 400 °F) |
| Process connection | | | | |
| Flange DIN 2501 / EN 1092-1 | DN 10 to 200; PN 40 to PN 160 | | — | |
| Flange ASME B16.5 | DN ½ to 8 in; CL150 to CL1500 | | — | |
| JIS flange | DN 10 to 200; JIS 10K to 20K | | — | |
| Pipe fitting DIN 11851 | DN 10 to 100 (¾ to 4 in) | | DN 20 to 100 (½ to 4 in) | |
| Pipe fitting SMS 1145 | DN 25 to 80 (1 to 3 in) | | — | |
| Tri-clamp DIN 32676 (ISO 2852) | DN 15 to 100 (¼ to 4 in) | | DN 20 to 100 (¼ to 4 in) | |
| Tri-clamp BPE | DN ¾ to 4 in | | DN ¾ to 4 in | |
| Female thread DIN ISO 228 and ASME B 1.20.1 | DN 15; PN 100 | | — | |
| Other connections | On request | | On request | |
| Wetted material | Stainless steel 1.4435 or 1.4404 (AISI 316L), nickel alloy C4 / C22 | | Stainless steel, polished 1.4404 (AISI 316L) or 1.4435 (AISI 316L) | |
| IP rating | <ul style="list-style-type: none"> Integral mount design: IP 65 / IP 67, NEMA 4X Remote mount design: IP 65 / IP 67 / IP 68 (sensor only, immersion depth: 5 m), NEMA 4X | | | |
| Approvals | | | | |
| Explosion protection | ATEX / IECEx / UKEX / cFMus / EAC-Ex | | ATEX / IECEx / UKEX / cFMus / EAC-Ex | |
| Hygiene approvals | — | | FDA compliant | |
| Legal metrology | OIML R117, MID, devices for legal metrology in accordance with API / AGA | | | |
| Further approvals | At www.abb.com/flow or upon request. | | | |

* Indication of accuracy in % of the measured value

... Overview – models

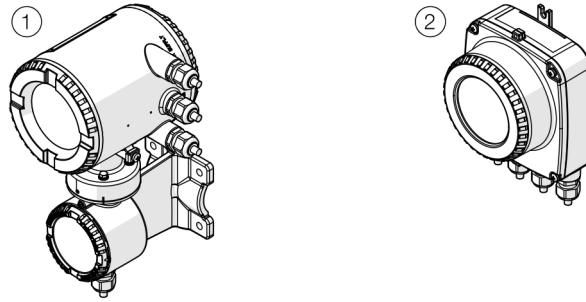

① Dual-compartment housing

② Single-compartment housing

Figure 2: Transmitter with remote mount design

| Transmitter | |
|---|---|
| Chassis | Integral mount design (see Figure 1, pos. ① and ②), remote mount design (see Figure 2, pos. ① and ②). |
| IP rating | IP 65 / IP 67, NEMA 4X |
| Cable length | Maximum 200 m (656 ft), with remote mount design only |
| Power supply | 100 to 240 V AC, 50 / 60 Hz 11 to 30 V DC, nominal voltage: 24 V DC |
| Outputs in basic version | Current output: 4 to 20 mA active or passive Digital output 1: passive, configurable as pulse, frequency or switch output Digital output 2: passive, configurable as pulse or switch output |
| Additional optional outputs | The transmitter has two slots in which plug-in cards can be inserted to provide additional inputs and outputs. The following plug-in cards are available: <ul style="list-style-type: none"> • Current output (maximum two plug-in cards simultaneously) • Active or passive digital output (maximum one plug-in card) • Digital input (maximum one plug-in card) • Modbus or PROFIBUS DP interface (maximum of one plug-in card) • 24 V DC loop power supply for active outputs (maximum one plug-in card) • Ethernet card • Power Over Ethernet - POE card |
| External output zero return | Yes |
| External totalizer reset | Yes |
| Forward / reverse flow metering | Yes |
| Counter | Yes |
| Communication | HART® protocol 7.1, Modbus® or PROFIBUS DP® (via plug-in card), EtherNet/IP™, PROFINET®, Modbus® TCP, Webserver over Ethernet* |
| Empty pipe detection | Yes, via configurable density alarm |
| Self-monitoring and diagnosis | Yes |
| Local indicator | Yes |
| Field optimization for flow and density | Yes |
| Concentration measurement 'DensiMass' | Yes, optional on models FCB450 and FCH450 |
| 'FillMass' filling function | Yes, optional on models FCB450 and FCH450 |
| 'VeriMass' function | Yes, optional |
| 'Enhanced Coriolis Control (ECC)' function | Yes, optional |

* EtherNet/IP™, Modbus® TCP and PROFINET®, web server via Ethernet available only with the single-compartment housing

General data

Device description

The CoriolisMaster FCB400, FCH400 is the cost-effective and easy ABB mass flowmeter with a new modular transmitter.

The CoriolisMaster FCB400, FCH400 operates in accordance with the Coriolis principle. The design offers the following benefits:

- Space-saving, robust design.
- Variety of process connections.
- Modular, flexible output concept.

Transmitter with digital signal processor (DSP)

The transmitter for the CoriolisMaster FCB400, FCH400 incorporates a digital signal processor (DSP) that enables high-precision mass flow and density measurements to be taken. The Coriolis sensor signals are immediately converted into digital data without any intermediate analog steps.

Excellent long-term stability and reliability together with fast signal processing are achieved with the new DSP transmitter.

Self-diagnostic functions for the flowmeter sensor and the transmitter, in combination with absolute zero stability, are benefits you can count on to ensure accurate measurements are taken.

The CoriolisMaster FCB400, FCH400 transmitter is particularly well suited for use in the following cases:

- When mass flow needs to be measured to the highest degree of accuracy,
- When the density of the measuring medium is determined,
- When the components of a recipe are mixed together,
- When measuring non-conductive fluids or for example, highly viscous, solid-loaded liquids,
- in filling processes.

SIL-functional safety

| Term | Value |
|--------------------|--|
| DeviceType | CoriolisMaster FCB430, FCB450, FCH430, FCH450 with option 'CS' |
| Type of Assessment | Verification in accordance with IEC 61508 2, route 1S/1H |
| SIL capability | SIL2 (Low demand mode) |
| HFT | 0 |
| Component Type | B |

| Failure Rates | Design | |
|--|-----------------------|---------------------|
| | Integral mount design | Remote mount design |
| SFF | 93.3 % | 93.2 % |
| PFD _{AVG} after 1 year (MTTR 48 hours) | 6,91E-04 | 7,28E-04 |
| PFD _{AVG} after 2 years (MTTR 48 hours) | 1,31E-03 | 1,38E-03 |
| PFD _{AVG} after 4 years (MTTR 48 hours) | 2,54E-03 | 2,68E-03 |
| λ_S | 435 FIT | 435 FIT |
| λ_{Dd} | 1529 FIT | 1616 FIT |
| λ_{Du} | 142 FIT | 149 FIT |

SAFETY INSTRUCTIONS


The listed failure rates λ_S , λ_{Dd} , λ_{Du} and PFD_{AVG} relate to the failure rates of the Siemens norm SN29500 at an average component temperature of 40 °C (104 °F).

This corresponds to an average ambient temperature of 30 °C (86 °F).

... General data

FillMass batch function


Only for FCB450 / FCH450

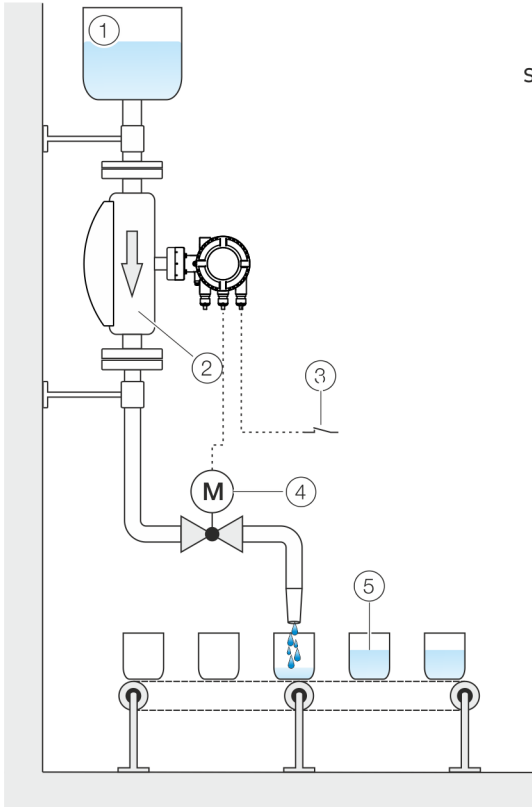

- ① Supply tank
- ② Sensor
- ③ Start / stop fill operation (digital input or field bus)
- ④ Fill valve
- ⑤ Filling tank

Figure 3: FillMass fill function

The integrated FillMass fill function allows filling processes with filling times of > 3 seconds. For this purpose, the filling quantity is given via an adjustable totalizer. The fill function is controlled via the HART interface or via the digital input.

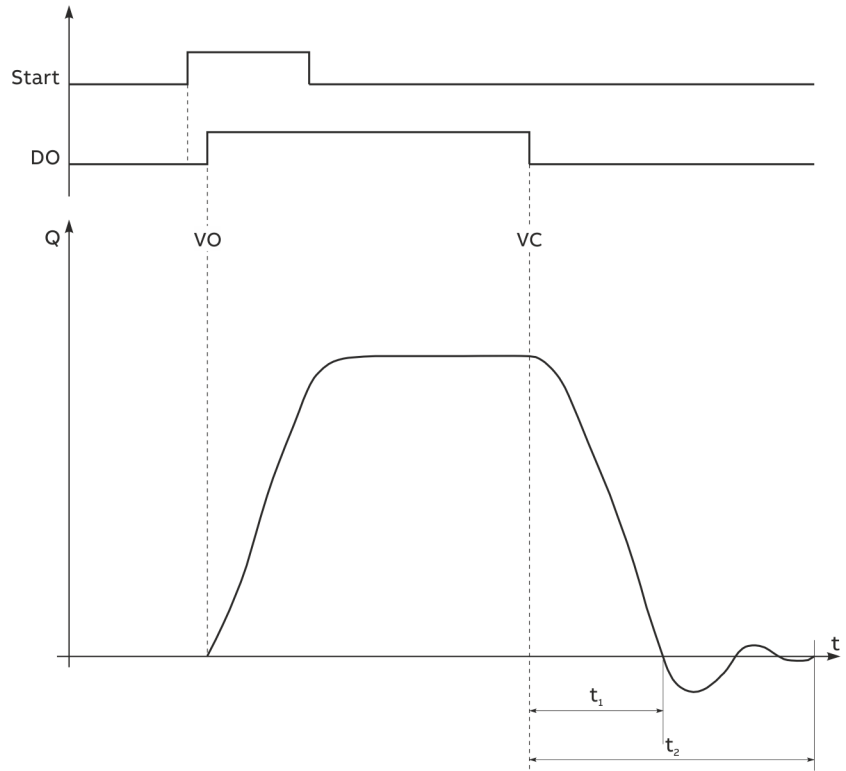

Start Start of the filling process via field bus or digital input

DO State of the digital output for the fill valve

Q Flow rate

VO Valve open (filling started)

VC Valve closed (fill quantity reached)

t_1 Valve closing time

t_2 Overrun time

The valve is triggered via one of the digital outputs and closed again once the preset filling quantity is reached. The transmitter measures the overrun quantity and calculates the overrun correction from this. Additionally, the low flow cut-off can be activated if required.

Concentration measurement DensiMass

Only for FCB450 / FCH450

The transmitter can calculate the current concentration from the measured density and temperature using concentration matrices.

The following concentration matrices are preconfigured in the transmitter as standard:

- Concentration of sodium hydroxide in water
- Concentration of alcohol in water
- Concentration of sugar in water
- Concentration of maize starch in water
- Concentration of wheat starch in water
- Concentration of antifreeze in water

In addition, the user can enter two user-defined matrices:

- Up to 100 values with one matrix
- Up to 50 values per matrix with two matrices

Calculating standard volumes and standard densities of liquids

If a suitable matrix is available, the DensiMass function also allows the measured volume to be corrected for any selected temperature.

The measured density can also be corrected for a given temperature.

However, this is only possible when measuring liquids and after entering an appropriate matrix.

This correction can also be performed using the default matrices (see above).

The calculated standard volumes and standard densities can also be issued for all other process variables.

The software 'DensiMatrix' is available for the easy input of the matrix.

Accuracy of the concentration measurement

The accuracy of the concentration measurement is determined in the first instance by the quality of the matrix data entered.

However, as the calculation is based on temperature and density (the input variables), the accuracy of the concentration measurement is ultimately determined by the measuring accuracy of the temperature and the density.

Example:

Density of 0 % alcohol in water at 20 °C (68 °F): 998.23 g/l

Density of 100 % alcohol in water at 20 °C (68 °F): 789.30 g/l

| Concentration | Density |
|---------------|------------|
| 100 % | 208.93 g/l |
| 0.48 % | 1 g/l |
| 0.96 % | 2 g/l |
| 0.24 % | 0.5 g/l |

Thus, the accuracy class of the density measurement directly determines the accuracy of the concentration measurement.

... General data

Enhanced Coriolis Control (ECC)function

The Enhanced Coriolis Control (ECC)function has been specially developed for demanding applications, such as:

- Liquids with gas phase
- Liquids with rapidly changing densities
- Fill operations with surge phases at the beginning or end
- Liquids with high viscosity

After the ECC function is activated, the device applies a particularly quick control algorithm to control the oscillating tubes in the device and therefore provide significantly better behavior in the applications listed above.

In addition, the ECC function offers a special noise suppression filter for mass flow measurement and density measurement.

In the case of particularly demanding applications, disruptions can thus be actively filtered and the measurement can be implemented in a considerably more stable manner.

For the filters, a variety of time constants between 0.5 s and 8 s can be selected.

Since Coriolis mass flowmeters measure the mass flow and density separately, the CoriolisMaster features a separate filter each for mass flow measurement and density measurement.

Devices for legal metrology in accordance with MID / OIML R117

The Coriolis mass flowmeters CoriolisMaster FCbX50 are type-tested for legal metrology in accordance with MID / OIML R117 in accuracy classes 0.5 and 0.3.

Additional information can be found on the corresponding certificate. The certificate is available in the download area at www.abb.com/flow.

When ordering, select one of the optional order codes:

- CT4 – Approved for official calibration in accordance with MID (OIMLR117 Cl0.5)
- CT3 – Approved for official calibration in accordance with MID (OIMLR117 Cl0.5/0.3)

All Coriolis mass flowmeters FCbX50 for legal metrology receive a 3-point flow rate calibration at the factory, which demonstrates measuring accuracy in accordance with the OIML-R117-2019 guidelines at minimum (Q_{\min}), medium and maximum (Q_{\max}) flow rates.

| Nominal diameter | Q1 (tol. +10 %) [kg/h] | Q2 (tol. ±10 %) [kg/h] | Q3 (tol. -20 %) [kg/h] |
|------------------|---------------------------|---------------------------|---------------------------|
| DN 15 | 365 | 2489 | 6500 |
| DN 25 | 1620 | 10570 | 27000 |
| DN 50 | 4550 | 27335 | 67000 |
| DN 80 | 14500 | 91489 | 145000 |
| DN 100 | 23000 | 124597 | 290000 |
| DN 150 | 32000 | 178053 | 290000* |

* corresponds to approx. 60 % $Q_{\max CT}$

Note

Use in accordance with API / AGA standards is also possible.

Please observe the additional remarks in the operating and commissioning instruction.

Applications in accordance with API (American Petroleum Institute)

For applications in accordance with API Chapter 5.6, the CoriolisMaster FCB400, FCH400 provides special parameters:

- Calibration Pressure: Measuring medium pressure at which the device was calibrated at ABB.
- Calibration Temp.: Measuring medium temperature at which the device was calibrated at ABB.
- Pressure Level: Parameters for entry of the current operating pressure in the device by the user.
- Flow Compens. factor: Display / output of the current compensation factor for mass flow calculation.
- Density Comp. factor: Display / output of the current compensation factor for density calculation.
- P.Comp.Status (PECI): In accordance with API, the user can set the following states:
 - 1: CT: Compensation in the Coriolis flowmeter based on the current pressure entered in the 'Pressure Level' parameter.
 - 2: TD: Compensation in the Coriolis flowmeter switched off – compensation is performed externally (Tertiary Device)
 - 3: OS: Compensation in the Coriolis flowmeter switched off – compensation is not performed on site (Off Site)
 - 4: NA: Compensation in the Coriolis flowmeter switched off – compensation is not deemed to be necessary, since the device is operating at a pressure for which the device has been proved.

VeriMass erosion monitor

The integrated diagnosis function VeriMass allows the status of the meter tube to be monitored. This enables changes due to material erosion and the formation of deposits on the meter tube walls to be identified at an early stage.

If the set limit value is exceeded, an alarm is triggered, for example via the programmable digital output or HART, depending on the configuration.

The limit value for the erosion monitor can be set either automatically or manually.

Automatic adjustment

The transmitter monitors the sensor's driver current over a prolonged period and creates a 'fingerprint' for the relevant application. The transmitter generates a corresponding tolerance value for deviations in the driver current.

The transmitter compares the behavior of the driver current with the generated fingerprint and triggers the relevant error message in the event of prolonged deviations.

Manual adjustment

For applications where automatic adjustment of the erosion monitor does not provide a satisfactory result, the erosion monitor can be adjusted manually.

For more information, please contact ABB Service or the sales organization.

Flowmeter sensor

General installation conditions

Installation location and assembly

Note the following points when selecting the installation location and when mounting the sensor:

- The ambient conditions (IP rating, ambient temperature range T_{ambient}) of the device must be adhered to at the installation location.
- Sensors and transmitters must not be exposed to direct sunlight. If necessary, provide a suitable means of sun protection on site. The limit values for ambient temperature T_{ambient} must be adhered to.
- On flange devices, ensure that the counterflanges of the piping are aligned plane parallel. Only install flange devices with suitable gaskets.
- Prevent the sensor from coming into contact with other objects.
- The device is designed for industrial applications. No special EMC protective measures are required if the electromagnetic fields and interference at the installation location of the device comply with 'Best Practice' (in accordance with the standards listed in the declaration of conformity).
Maintain a suitable distance from electromagnetic fields and interference that extend beyond the usual dimensions.

Seals

Users are responsible for selecting and mounting suitable gaskets (material, shape).

Note the following points when selecting and mounting gaskets:

- Use gaskets made from a material that is compatible with the measuring medium and measuring medium temperature.
- Gaskets must not extend into the flow area, since possible turbulence may influence the accuracy of the device.

Calculating pressure loss

Pressure loss depends on the properties of the medium and the flow rate.

A good aid for pressure loss calculation is the Online ABB Product Selection Assistant (PSA) for flow at www.abb.com/flow-selector.

Brackets and supports

No special supports or damping are required for the device when the device is used and installed as intended.

In systems designed in accordance with 'Best Practice', the forces acting on the device are already sufficiently absorbed. This is also true of devices installed in series or in parallel.

For heavier devices, it is advisable to use additional supports / brackets on site. Doing this prevents damage to the process connections and piping from lateral forces.

Please observe the following points:

- Mount two supports or brackets symmetrically in the immediate vicinity of the process connections.
- Do not fasten any supports or brackets to the housing of the flowmeter sensor.

Note

For increased vibration load, such as for example on ships, the use of the 'CL1' marine design is recommended.

Inlet section

The sensor does not require any inlet section.

The devices can be installed directly before/after manifolds, valves or other equipment, provided that no cavitation is caused by this equipment.

Mounting position

The flowmeter operates in any mounting position.

Depending on the measuring medium (liquid or gas) and the measuring medium temperature, certain mounting positions are preferable to others. For this purpose, consider the following examples.

The preferred flow direction is indicated by the arrow on the sensor. The flow will be displayed as positive.


The specified measuring accuracy can be achieved only in the calibrated flow direction (for forward flow calibration, this is only in the direction of the arrow; for the optional forward flow and reverse flow calibration, this can be in both flow directions).

Liquid measuring media

Observe the following points to avoid measuring errors:

- The meter tubes must always be completely filled with the measuring medium.
- The gases dissolved in the measuring medium must not leak out. To safeguard this, a minimum back pressure of 0.2 bar (2.9 psi) is recommended.
- The minimum vapor pressure of the measuring medium must be maintained when there is negative pressure in the meter tube or when liquids are gently simmering.
- During operation, there must be no phase transitions in the measuring medium.

Vertical installation

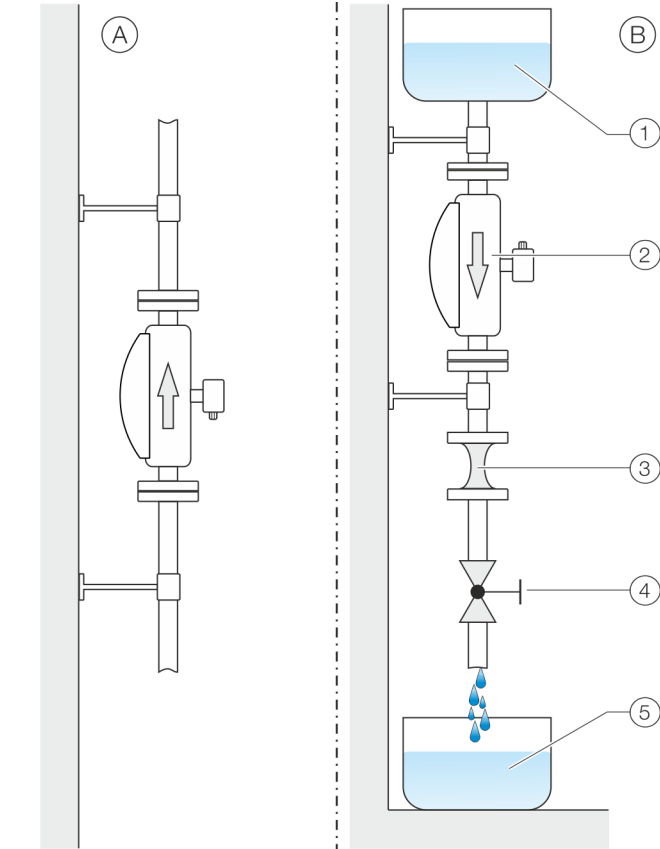

- ① Supply tank
- ② Sensor
- ③ Piping constriction / orifice
- ④ Turn-off device
- ⑤ Filling tank

Figure 4: Vertical installation

- Ⓐ For vertical installation in a riser, no special measures are required.
- Ⓑ For vertical installation in a downpipe, a piping constriction or an orifice must be installed below the sensor. Doing this prevents the sensor from draining during the measurement.

Horizontal installation

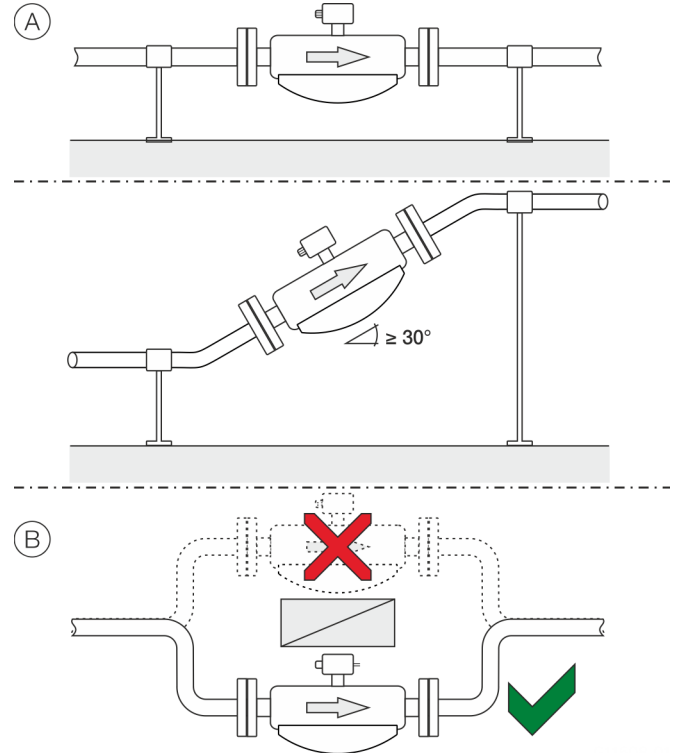


Figure 5: Horizontal installation

- Ⓐ For liquid measuring media and horizontal installation, the transmitter and terminal box must point upward. If a self-draining installation is required, the sensor must be mounted at an incline of $\geq 30^\circ$.
- Ⓑ Installing the sensor at the highest point of the piping leads to an increased number of measuring errors due to the accumulation of air or the formation of gas bubbles in the meter tube.

... Flowmeter sensor

... General installation conditions

Gaseous measuring media

Observe the following points to avoid measuring errors:

- Gases must be dry and free of liquids and condensates.
- Avoid the accumulation of liquids and the formation of condensate in the meter tube.
- During operation, there must be no phase transitions in the measuring medium.

If there is a risk of condensate formation when using gaseous measuring media, note the following:

Ensure that condensates cannot accumulate in front of the sensor.

If this cannot be avoided, we recommend that the sensor is installed vertically with a downward flow direction.

Vertical installation

For vertical installation, no special measures are required.

Horizontal installation


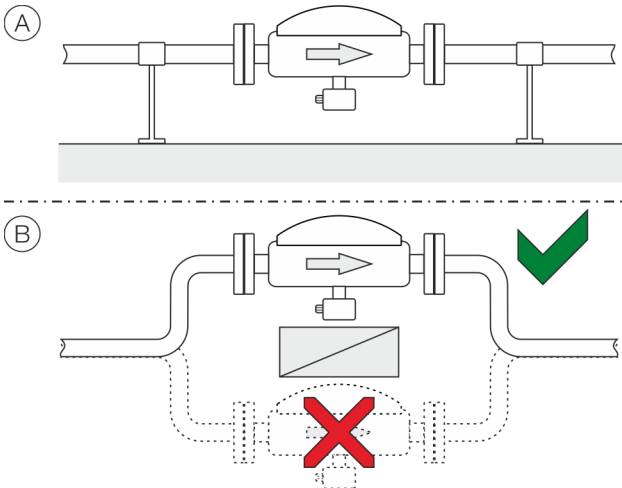


Figure 6: Horizontal installation

- (A) For gaseous measuring media and horizontal installation, the transmitter and terminal box must point downward.
- (B) Installing the sensor at the lowest point of the piping leads to an increased number of measuring errors due to the accumulation of liquid or the formation of condensates in the meter tube.

Sensor insulation

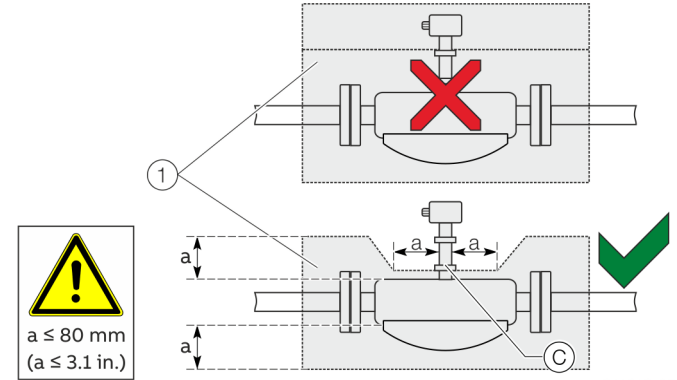

① Insulation


Figure 7: Installation at $T_{\text{medium}} -50^{\circ}\text{C}$ to 205°C (-58 to 400°F)

The sensor may only be insulated in conjunction with the option TE1 'Extended tower length for sensor insulation' or TE2 'Extended tower length – insulation capacity with dual gasket,' as shown in Figure 7.

Heat tracing of the sensor

When operating the sensor in conjunction with heat tracing, the temperature at point (C) (Figure 7) 100°C (212°F) may not be exceeded at any time!

Turn-off devices for the zero point adjustment

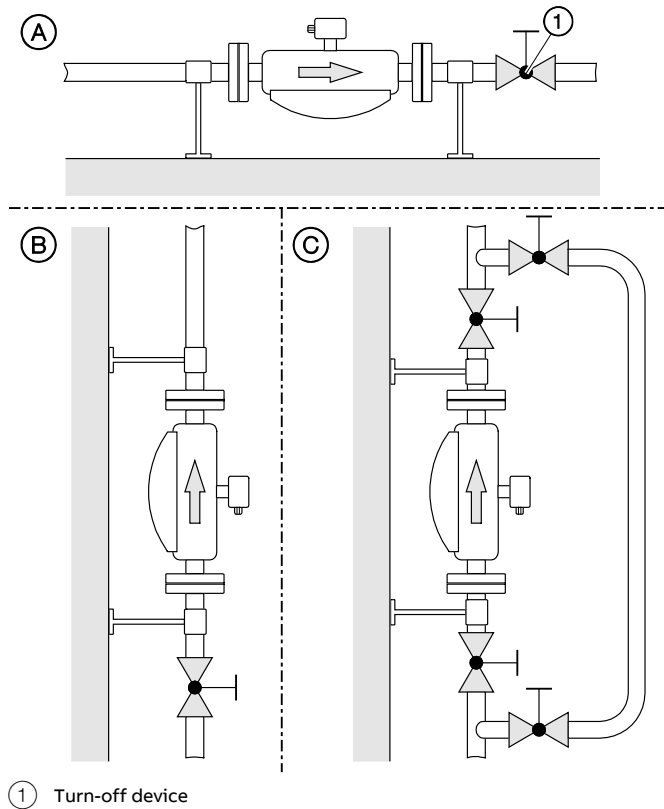

① Turn-off device

Figure 8: Mounting options for turn-off devices (example)

To guarantee the conditions for zero point balancing under operating conditions, turn-off devices are required in the piping:

- ① At least on the outlet side when the transmitter is mounted in horizontal position
- ② At least on the inlet side when the transmitter is mounted in vertical position.
- ③ In order to perform balancing during an ongoing process, it is advisable to mount a bypass pipe.


Installation in EHEDG-compliant installations

- The required self-draining functionality of the sensor can only be guaranteed when the vertical mounting position or horizontal mounting position at a 30° incline is used. Refer to **Vertical installation** on page 11.
- The combination of process connections and gaskets selected by the operator may comprise only EHEDG-compliant components. Please note the information in the latest version of the EHEDG Position Paper: 'Hygienic Process connections to use with hygienic components and equipment' in this regard.

... Flowmeter sensor

... General installation conditions

Devices for legal metrology

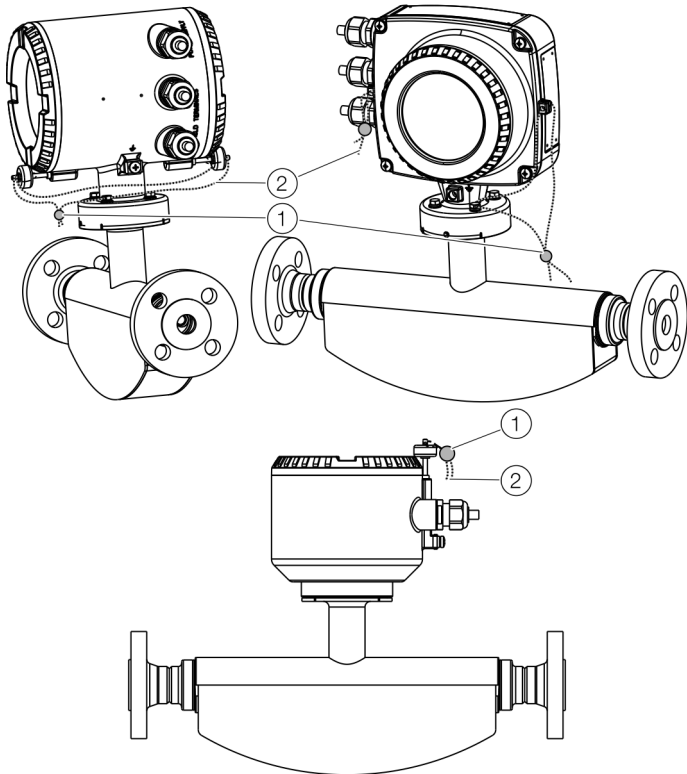

① Lead seal

② Lead seal wire

Figure 9: Sealing in accordance with MID / OIML R117 (example)


On devices for legal metrology, the hardware write protection must be activated after commissioning in many cases. This prevents a change in the parameterization of the devices.

To prevent deactivation of the hardware write protection or other manipulations during operation, the transmitter housing and the sensor housing connection box (with remote mount design) must be sealed.

For this purpose, a seal kit is available at ABB.

For the assembly of the seal, please observe the separate 'IN/FCX100/FCX400/MID/OIML-XA' instructions.

Designs

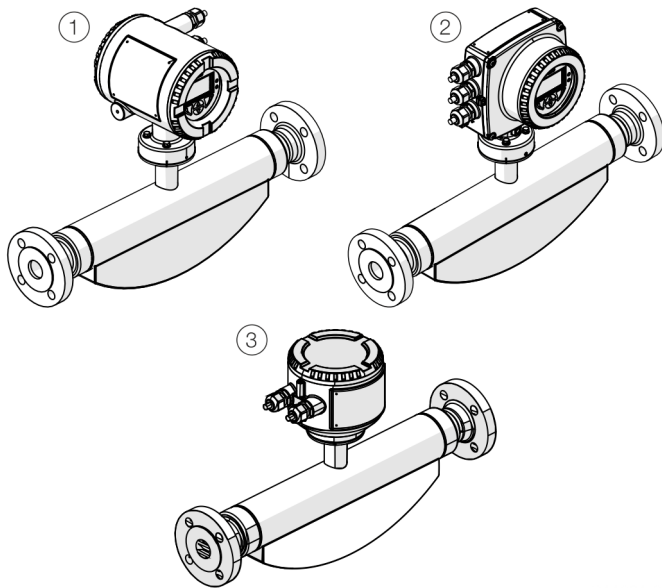

- ① Integral mount design with dual-compartment transmitter housing
- ② Integral mount design with single-compartment transmitter housing
- ③ Remote mount design (without transmitter)

Figure 10: Sensor FCB4xx / FCH4xx

Note

For additional information on dependencies and restrictions, and for help on product selection, please refer to the Online Product Selection Assistant (PSA) at www.abb.us/flow-selector.

Nominal diameter and measuring range

| Nominal diameter | Q_{max} in kg/h (lb/h) |
|------------------|-------------------------------|
| DN 15 (½ in) | 0 to 8,000 (0 to 17,637) |
| DN 25 (1 in) | 0 to 35,000 (0 to 77,162) |
| DN 50 (2 in) | 0 to 90,000 (0 to 198,416) |
| DN 80 (3 in) | 0 to 250,000 (0 to 551,156) |
| DN 100 (4 in) | 0 to 520,000 (0 to 1,146,404) |
| DN 150 (6 in) | 0 to 860,000 (0 to 1,895,975) |

Recommended flow range

Fluids:

- The recommended flow range is 5 to 100 % of Q_{max} .
- Flow rates < 1 % of Q_{max} should be avoided.

Gases:

- The flow velocity of gases in the meter tube should not up-scale 0.3 mach [approx. 100 m/s (328 ft/s)].
- Increased deviation in repeatability should be expected from a flow velocity of approx. 80 m/s (262 ft/s).
- The maximum flow range of gases depends on the operating density. Appropriate dimensioning guidelines are available at www.abb.com/flow.

... Flowmeter sensor

Measuring accuracy

Reference conditions

| | |
|----------------------------|--|
| Calibration fluid | Water <ul style="list-style-type: none"> • Temperature: 25 °C (77 °F) ± 5 K • Pressure: 2 to 4 bar (29 to 58 psi) |
| Ambient temperature | 25 °C (77 °F) +10 K / -5 K |
| Power supply | Line voltage in accordance with name plate $U_N \pm 1\%$ |
| Warm-up phase | 30 min |
| Installation | <ul style="list-style-type: none"> • Installation in accordance with Assembly Notes and Mounting positions • No visible gas phase • No external mechanical or hydraulic disturbances, particularly no cavitation |
| Output calibration | Pulse output |

Measured error and repeatability

The measured error and repeatability are calculated as follows for the flow:

Scenario 1:

If

$$\text{Flow rate} \geq \frac{\text{Zero stability}}{(\text{base accuracy} / 100)}$$

Then:

- Maximum measured error: \pm base accuracy as % of measured value.
- Repeatability: $\pm \frac{1}{2} \times$ base accuracy as % of measured value.

Scenario 2:

If

$$\text{Flow rate} < \frac{\text{Zero stability}}{(\text{base accuracy} / 100)}$$

Then:

- Maximum measured error: \pm (zero point stability / measured value) \times 100 % of measured value
- Repeatability: $\pm \frac{1}{2} \times$ (zero point stability / measured value) \times 100% of measured value.

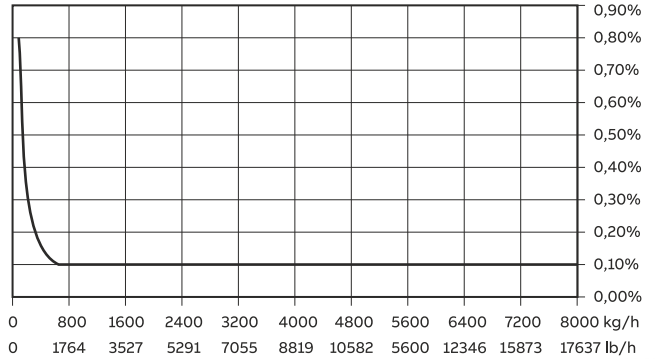


Figure 11: Measured error FCB450 DN 15 (Example)

| FCx450 | | | |
|-------------|----------------------------|-----------------|----------------|
| Measurement | Flow rate | Measured error* | Repeatability* |
| 100:1 | 80 kg/h (176.4 lb/h) | $\leq 0.8\%$ | 0.4 % |
| 50:1 | 160 kg/h (352.7 lb/h) | $\leq 0.4\%$ | 0.2 % |
| 10:1 | 800 kg/h (1763.7 lb/h) | $\leq 0.1\%$ | 0.05 % |
| 2:1 | 4000 kg/h (8818.5 lb/h) | $\leq 0.1\%$ | 0.05 % |
| 1:1 | 8000 kg/h (17637 lb/h) | $\leq 0.1\%$ | 0.05 % |

| FCx450 – high accuracy | | | |
|------------------------|----------------------------|-----------------|----------------|
| Measurement | Flow rate | Measured error* | Repeatability* |
| 100:1 | 80 kg/h (176.4 lb/h) | $\leq 0.5\%$ | 0.25 % |
| 50:1 | 160 kg/h (352.7 lb/h) | $\leq 0.25\%$ | 0.122 % |
| 10:1 | 800 kg/h (1763.7 lb/h) | $\leq 0.1\%$ | 0.05 % |
| 2:1 | 4000 kg/h (8818.5 lb/h) | $\leq 0.1\%$ | 0.05 % |
| 1:1 | 8000 kg/h (17637 lb/h) | $\leq 0.1\%$ | 0.05 % |

* Enter measured error and repeatability as % of measured value

| Measured error and base accuracy for liquids | | |
|---|--|---|
| | FCx430 | FCx450 |
| Order code flow calibration | A, B, E, J, K, N | C, D, L, M |
| Order code density calibration | 1 | 3, 4, 5 |
| Mass flow* | ±0.4 % | ±0.15 % |
| | ±0.25 % | ±0.1 % |
| | ±0.2 % | |
| Volume flow* | ±0.4 % | ±0.15 % |
| | ±0.25 % | ±0.11 % |
| | ±0.2 % | |
| Density | 0.010 kg/l** | 0.002 kg/l** 0.001 kg/l** 0.0004 kg/l** |
| Repeatability for flow rate | Refer to Measured error and repeatability on page 16. | |
| Repeatability for density | 0.002 kg/l** | 0.002 kg/l** 0.001 kg/l** 0.0004 kg/l** |
| Temperature | 1K | 0.5 K |

| Measured error and base accuracy for gases | | |
|---|------------------|---------------|
| | FCx430 | FCx450 |
| Order code flow calibration | A, B, E, J, K, N | C, D, L, M |
| Order code density calibration | 1 | 3, 4 |
| Mass flow* | ±1 % | ±0.5 % |
| Temperature | 1K | 0.5 K |

* Enter measured error and base accuracy as % of measured value

** For the density range from 0.5 to 1.8 kg/dm³

Zero point stability

| Nominal diameter | FCx430 | FCx450 |
|--------------------------------|-------------------------|---------------|
| Order code flow calibration | A, B, E, J, K, N | C, D, L, M |
| Order code density calibration | 1 | 3, 4 |
| DN 15 (½ in.) | 0.64 kg/h (1.41 lb/h) | |
| DN 25 (1 in.) | 2.16 kg/h (4.76 lb/h) | |
| DN 50 (2 in.) | 7.20 kg/h (15.87 lb/h) | |
| DN 80 (3 in.) | 20 kg/h (44 lb/h) | |
| DN 100 (4 in.) | 41.6 kg/h (91.7 lb/h) | |
| DN 150 (6 in.) | 68.8 kg/h (151.68 lb/h) | |

Effect of the medium temperature

| | FCx430 | FCx450 |
|--------------------------------|--|---|
| Order code flow calibration | A, B, E, J, K, N | C, D, L, M |
| Order code density calibration | 1 | 3, 4 |
| On flow rate | < ±0.005 % of Q _{max} / 1 K (1.8 °F) | < ±0.0015 % of Q _{max} / 1 K (1.8 °F) |
| On density | < 0.0001 kg/dm ³ per 1 K (1.8 °F) | |

Effect of the operating pressure

| Nominal diameter | Flow* | Density [kg/dm³ / bar] |
|-------------------------|--------------|--|
| DN 15 (½ in.) | -0.002 % | No effect |
| DN 25 (1 in.) | -0.013 % | 0.00035 |
| DN 50 (2 in.) | -0.010 % | 0.00027 |
| DN 80 (3 in.) | -0.006 % | 0.00019 |
| DN 100 (4 in.) | -0.009 % | 0.00024 |
| DN 150 (6 in.) | -0.035 % | 0.00045 |

* Influence of operating pressure as % of measured value per bar (1 bar = 14.5 psi)

... Flowmeter sensor

Specifications

Pressure loss

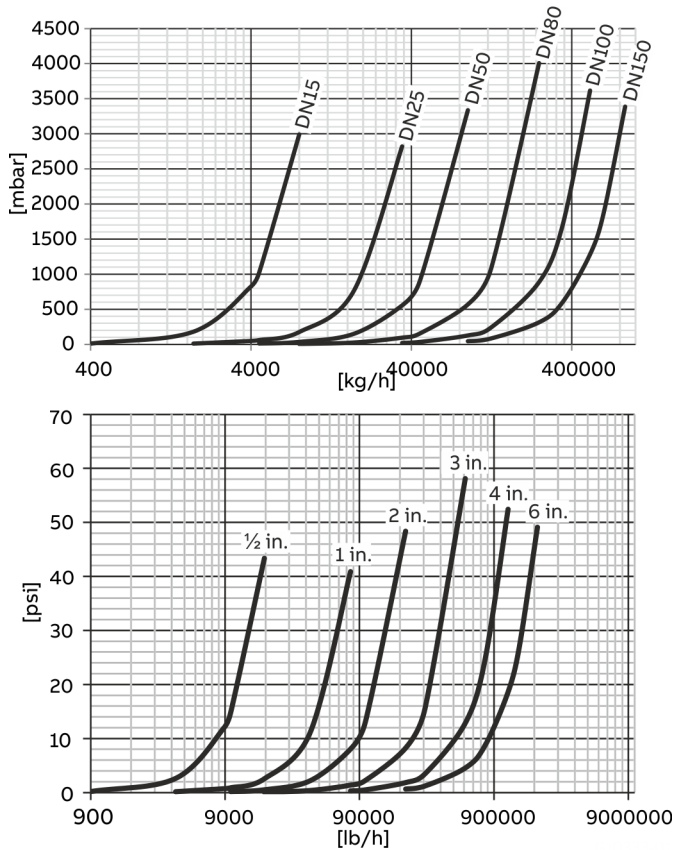


Figure 12: Pressure loss curve (measured with water, viscosity: 1 mPas)

Viscosity range

For dynamic viscosities ≥ 1 Pas (1000 mPas = 1000 cP), please consult ABB.

Temperature limits °C (°F)

Note

When using the device in potentially explosive atmospheres, note the additional temperature data in **Temperature data** on page 93!

Measuring medium temperature T_{medium}

- FCx430: -50 to 160 °C (-58 to 320 °F)
- FCx450: -50 to 205 °C (-58 to 401 °F)

In devices with order code 'Extended tower length – TE3', the measuring medium temperature must be limited to a maximum of 140 °C (284 °F) from an ambient temperature of ≥ 65 °C (149 °F).

Ambient temperature T_{amb}

- Standard: -20 to 70 °C (-4 to 158 °F)
- Optional: -40 to 70 °C (-40 to 158 °F)

Process connections

For an overview of available process connection versions, see **Overview – models** on page 3.

Pressure ratings

The maximum permissible operating pressure is determined by the respective process connection, the temperature of the medium to be measured, the screws, and the gasket material. For an overview of available pressure ratings, see **Overview – models** on page 3.

Housing as a protective device (optional)

Order code PR5

Maximum burst pressure 60 bar (870 psi)

Optional order code PR6 and PR7 on request

- Increased burst pressures up to 100 bar (1450 psi), possible for nominal diameters DN 15 to 100 (1/2 to 4 in.).
- Increased burst pressures up to 150 bar (2175 psi), possible for nominal diameters DN 15 to 80 (1/2 to 3 in.).
- Purge connections are available on request.

Pressure Equipment Directive

Conformity assessment in accordance with Category III, fluid group 1, gas. The pressure equipment is designed for load changes in accordance with the AD2000 specification sheet S1 Chapter 1.4 a) and b). Note the corrosion resistance of the meter tube materials in relation to the measuring medium.

CRN approval

Certain device versions and connection options have CRN approval under number 'CRN 0F15656.5'.

Please contact ABB for more information.

Installation lengths in accordance with NAMUR standards

The CoriolisMaster FCB400, FCH400 is the ideal device for use in accordance with NAMUR standards.

While also conforming to other standards, the device can be ordered with installation lengths in accordance with NAMUR standards.

The exact lengths can be found in the tables in page 33 (for integral mount design) and page 48 (for remote mount design).

Meter tube inside diameter

Inside diameter of the meter tube of the Coriolis mass flowmeter CoriolisMaster FCB400, FCH400.

| Nominal diameter | Meter tube inside diameter |
|------------------|----------------------------|
| DN 15 (½ in) | 2 × 8 mm (2 × 0.31 in) |
| DN 25 (1 in) | 2 × 16 mm (2 × 0.63 in) |
| DN 50 (2 in) | 2 × 23.7 mm (2 × 0.93 in) |
| DN 80 (3 in) | 2 × 36.62 mm (2 × 1.44 in) |
| DN 100 (4 in) | 2 × 52.51 mm (2 × 2.07 in) |
| DN 150 (6 in) | 2 × 68.9 mm (2 × 2.71 in) |

IP rating

In accordance with EN60529: IP 65 / IP 67, NEMA 4X

Note

The sensor in remote mount design is approved for an immersion depth up to 5 m (16.4 ft) in accordance with IP rating IP 68.

Materials for the transmitter terminal box

Integral mount design

| | |
|---------------|---|
| Material | Cast aluminum or stainless steel 1.4409 (ASTM CF3M) |
| Paint | Paint coat ≥ 80 µm thick, RAL 9002 (light gray) |
| Cable gland** | Polyamide or stainless steel* |

Remote mount design

| | |
|---------------|--|
| Material | Cast aluminum |
| Paint | Mid-section: Paint coat ≥ 80 µm thick, RAL 7012 (basalt gray) Front cover / rear cover: RAL 9002 (light gray) |
| Cable gland** | Polyamide |

* In the case of explosion-proof design for -40 °C (-40 °F) ambient temperature)

** Cable gland with M20 x 1.5 or NPT thread, to be selected via the order number.

Materials for the sensor

Wetted components

| FCB400 | FCH400 |
|---|--|
| Stainless steel 1.4435 or 1.4404 (AISI 316L) | Stainless steel 1.4435 or 1.4404 (AISI 316L) |
| C4* nickel alloy (2.4610) or C22 nickel – alloy (2.4602) | |
| Optional: Manufacture in accordance with NACE MR0175 and MR0103 (ISO 15156) | |

Sensor housing**

Stainless steel 1.4404 (AISI 316L), 1.4301 (AISI 304), 1.4308 (ASTM CF8)

* Hastelloy C is a registered trademark of Haynes International. C4 and C22 nickel alloys are equivalent to Hastelloy C4 and Hastelloy C22.

** If the wetted parts of the sensor are made from nickel alloy then parts of the sensor housing (splitter) are also manufactured from nickel alloy. However, the prevailing parts remain manufactured from the specified material.

Roughness for flanges in accordance with EN 1092-1, ASME and JIS

| | EN 1092-1 B1 | EN 1092-1 B2 |
|-------------------------|-----------------|----------------|
| Pressure rating | ≤ PN 40 | ≥ PN 63 |
| Mean roughness value Ra | 3.2 to 12.5 µm | 0.8 to 3.2 µm |
| Roughness depth Rz | 12.5 to 50.0 µm | 3.2 to 12.5 µm |

| | ASME B 16.5 | JIS B 2220 | JIS 10K |
|-------------------------|----------------|---------------|---------------|
| Mean roughness value Ra | 0.8 to 3.2 µm | 3.2 to 6.3 µm | 3.2 to 6.3 µm |
| Roughness depth Rz | 3.2 to 12.5 µm | 12.5 to 25 µm | 12.5 to 25 µm |

... Flowmeter sensor

Material load for process connections

Note

You can reference the availability of the different process connections in the Online ABB Product Selection Assistant (PSA) for flow www.abb.com/flow-selector.

- Not all connections shown here are available in all the devices and designs.
- The permissible material load of the device can additionally differ from the material load of the connection. The permissible limit values (pressure rating / measuring medium temperature T_{medium}) can be found on the name plate.

| Design | Nominal diameter | PS _{max} | TS _{max} | TS _{min} |
|-----------------------------|---------------------------------|-------------------------|----------------------|--------------------|
| Pipe fitting (DIN 11851) | DN 15 to DN 40 (½ to 1½ in) | 40 bar (580 psi) | 140 °C (284 °F) | -40 °C (-40 °F) |
| | DN 50 to DN 100 (2 to 4 in) | 25 bar (363 psi) | 140 °C (284 °F) | -40 °C (-40 °F) |
| Pipe fitting (SMS 1145) | DN 25 to DN 80 (1 to 3 in) | 6 bar (87 psi) | 140 °C (284 °F) | -40 °C (-40 °F) |
| Tri-Clamp (DIN 32676) | DN 15 to DN 50 (½ to 2 in) | 16 bar (232 psi) | 140 °C (284 °F) | -40 °C (-40 °F) |
| | DN 65 to DN 100 (2½ to 4 in) | 10 bar (145 psi) | 140 °C (284 °F) | -40 °C (-40 °F) |
| ASME BPE Clamp | < DN 80 (< 3 in) | 17,1 bar (248 psi) | 121 °C (249,8 °F) | -40 °C (-40 °F) |
| | DN 80 (< 3 in) | 15,5 bar (224,8 psi) | 121 °C (249,8 °F) | -40 °C (-40 °F) |
| | DN 100 (< 4 in) | 12,9 bar (187,1 psi) | 121 °C (249,8 °F) | -40 °C (-40 °F) |
| NPT female thread | DN15 stainless steel 1.4404 | 179 bar (2596,2 psi) | 150 °C (302 °F) | -40 °C (-40 °F) |
| | DN15 stainless steel 1.4404 | 163 bar (2364,1 psi) | 205 °C (401 °F) | -40 °C (-40 °F) |
| | DN15 HC22 2.4602 | 267 bar (3872,5 psi) | 150 °C (302 °F) | -40 °C (-40 °F) |
| | DN15 HC22 2.4602 | 243 bar (3524,4 psi) | 205 °C (401 °F) | -40 °C (-40 °F) |
| | DN15 HC22 2.4602 | 243 bar (3524,4 psi) | 205 °C (401 °F) | -40 °C (-40 °F) |

Material load curves for flange devices

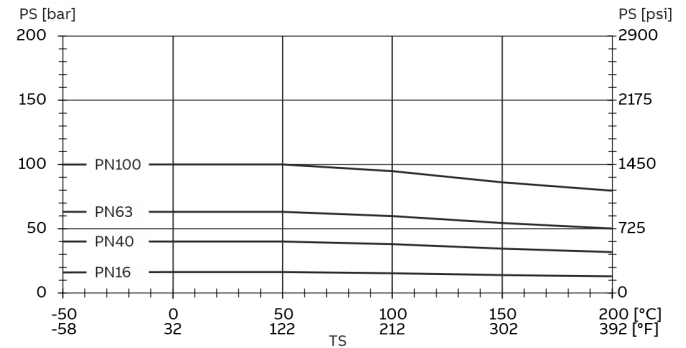


Figure 13: Stainless steel DIN flange 1.4404 (316L) up to DN 200 (8 in.)

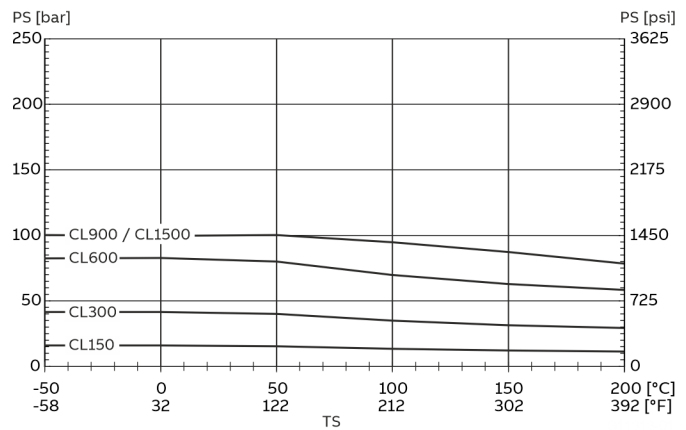


Figure 14: Stainless steel ASME flange 1.4404 (316L) up to DN 200 (8 in.)

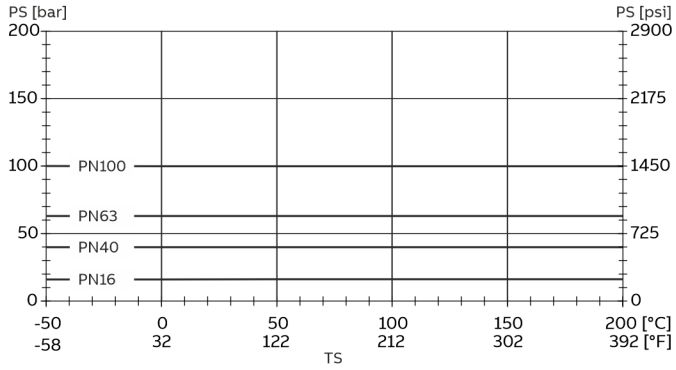


Figure 15: Nickel alloy DIN flange up to DN 200 (8 in)

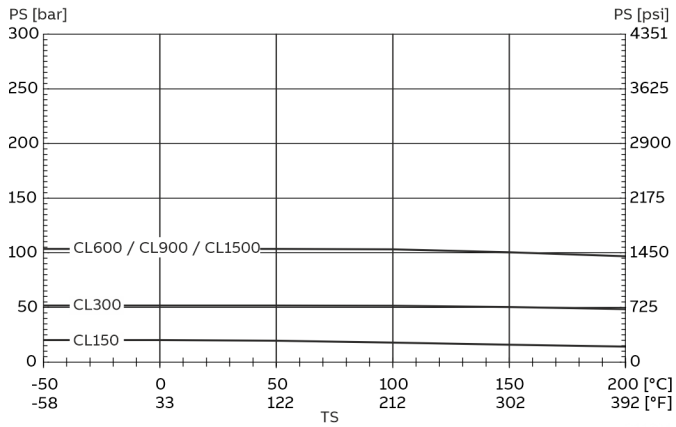


Figure 16: Nickel alloy ASME flange up to DN 200 (in.)

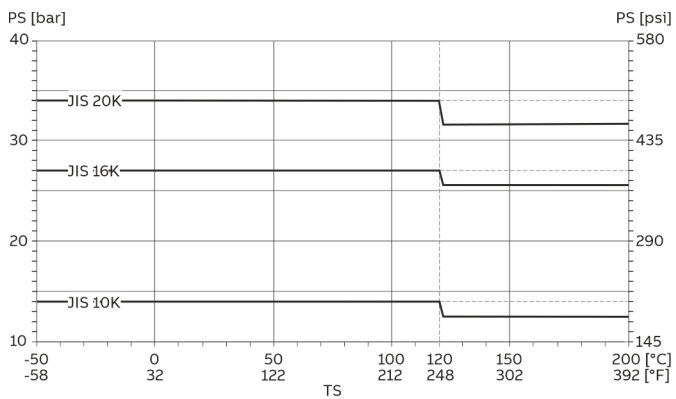


Figure 17: Stainless steel JIS B2220 flange 1.4435 or 1.4404 (AISI 316L) or nickel alloy

... Flowmeter sensor

Dimensions for devices with integral mount design

Devices with single-compartment transmitter housing

In integral mount design devices, the height (E / E1) and the dimensions provided in Figure 18 differ from the dimensions of the devices with dual-compartment transmitter housings.

- To the height (E / E1), 13 mm (0.51 in.) must be added.
- All other dimensions and the weight are unchanged.

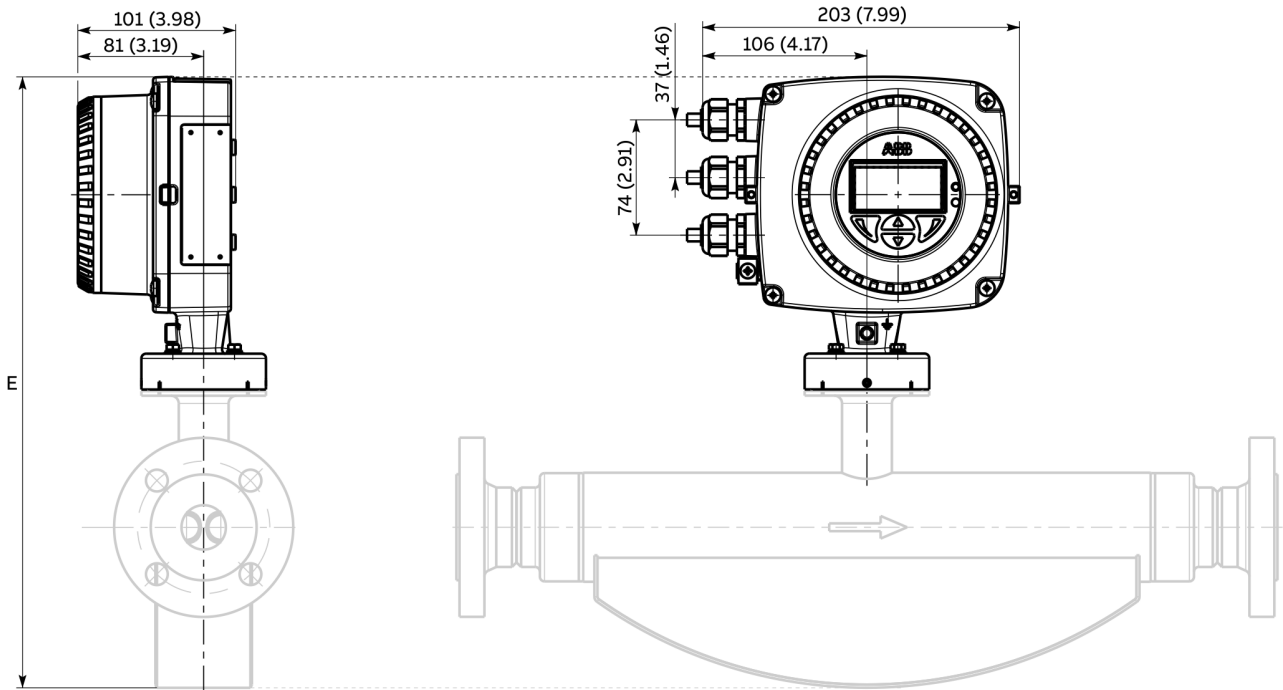



Figure 18: Integral mount design with single-compartment transmitter housing

Devices with meter tube nominal diameter DN 15 to 50 and flange DN 10 to 65


Sensor with wetted parts made from stainless steel.

All dimensions and weights are specified in mm (in) or kg (lb).

Standard Version

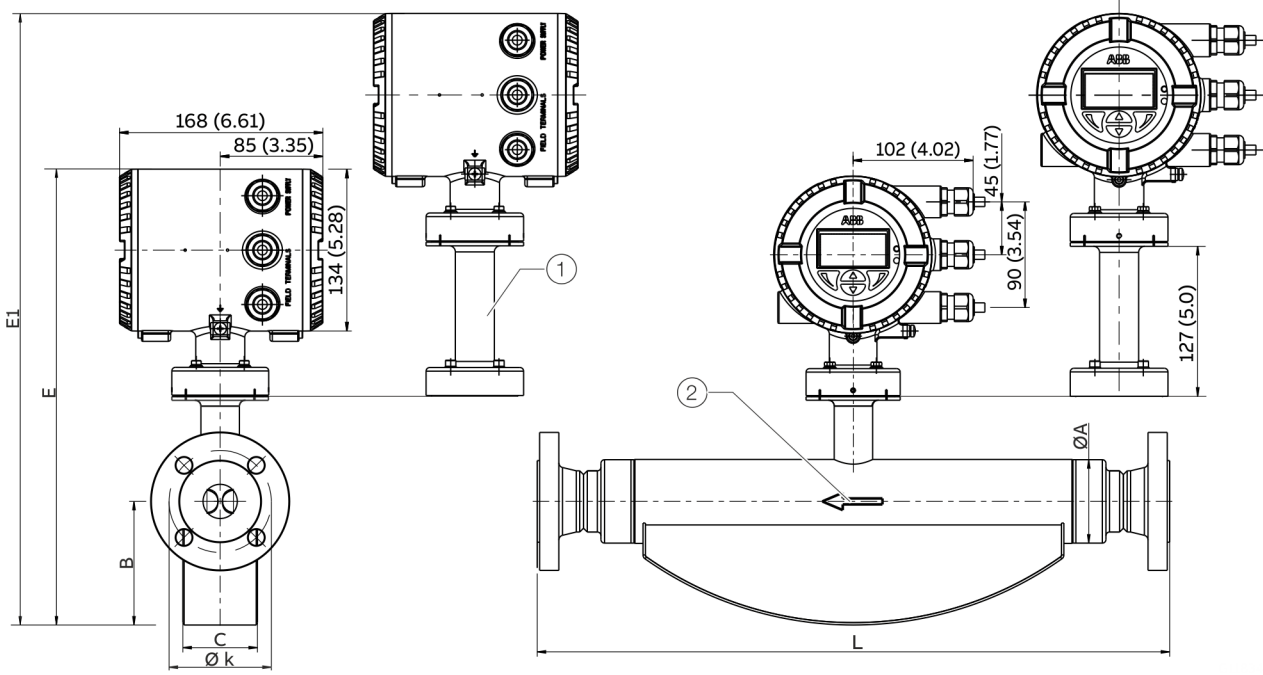

Marine version – CL1

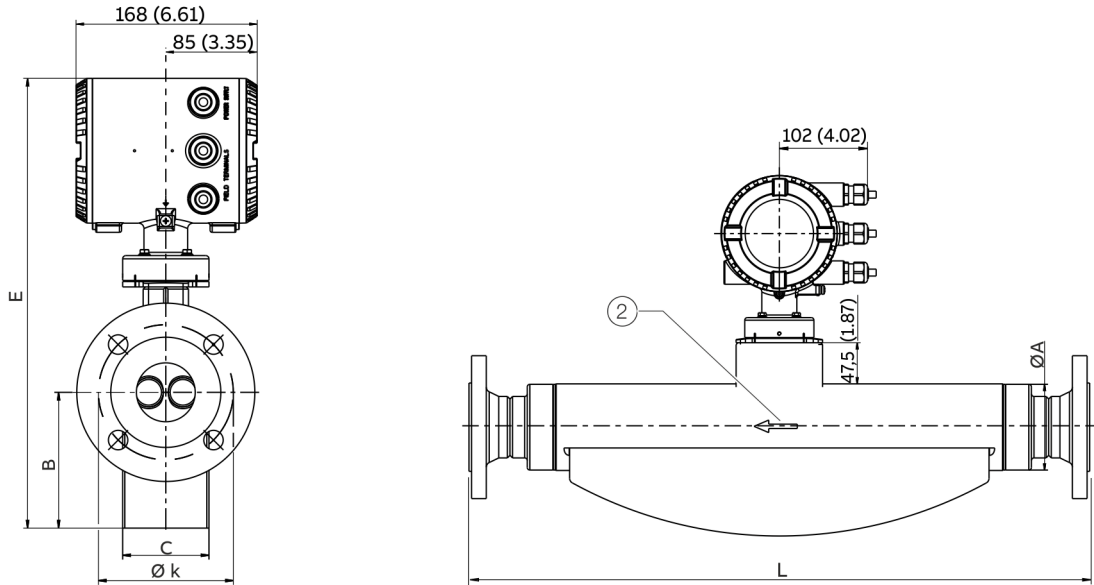

- ① 'Extended tower length – TE1, TE2' option or 'Pressure rating of sensor secondary housing – PR5, PR6, PR7' option
- ② Flow direction

Figure 1: Integral mount design with dual-compartment transmitter housing

... Flowmeter sensor

... Dimensions for devices with integral mount design

Meter tube nominal diameter DN 15 (½ in)

| DN / process connection | | L | Ø k | Ø A | B | C | E | E1* | Weight max. |
|-------------------------|-----------------------|-------------|------------|------------|----------|----------|-------------|-------------|-------------|
| 10 (¾) | PN 40 (EN 1092-1 B1) | 385 (15.2) | 60 (2.4) | 44.5 (1.8) | 80 (3.2) | 49 (1.9) | 345 (13.58) | 472 (18.58) | 13 (28.7) |
| | JIS 10K | 385 (15.2) | 65 (2.6) | | | | | | |
| | JIS 16K | 385 (15.2) | 65 (2.6) | | | | | | |
| | JIS 20K | 385 (15.2) | 65 (2.6) | | | | | | |
| 15 (½) | PN 40 (EN 1092-1 B1) | 385 (15.2) | 65 (2.6) | | | | | | |
| | PN 63 (EN 1092-1 B2) | 403 (15.9) | 75 (3.0) | | | | | | |
| | PN 100 (EN 1092-1 B2) | | | | | | | | |
| | CL150 (ASME B16.5) | 435 (17.13) | 60.5 (2.4) | | | | | | |
| | CL300 (ASME B16.5) | 421 (16.6) | 66.5 (2.6) | | | | | | |
| | CL600 (ASME B16.5) | | | | | | | | |
| | CL900 (ASME B16.5) | | 82.6 (3.3) | | | | | | |
| | CL1500 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 385 (15.2) | 70 (2.8) | | | | | | |
| | JIS 16K | 385 (15.2) | 70 (2.8) | | | | | | |
| JIS 20K | 385 (15.2) | 70 (2.8) | | | | | | | |
| 20 (¾) | PN 40 (EN 1092-1 B1) | 421 (16.6) | 75 (3.0) | | | | | | |
| | CL150 (ASME B16.5) | 421 (16.6) | 69.9 (2.8) | | | | | | |
| | JIS 10K | 421 (16.6) | 75 (3.0) | | | | | | |
| | JIS 16K | 421 (16.6) | 75 (3.0) | | | | | | |
| | JIS 20K | 421 (16.6) | 75 (3.0) | | | | | | |

* Standard version: devices with 'Extended tower length – TE1, TE2' or 'pressure rating of sensor secondary housing'.

Tolerance for dimension L: +0 / -3 mm (+0 / -0.118 in)

Meter tube nominal diameter DN 25 (1 in)

| DN / process connection | L | Ø k | Ø A | B | C | E | E1* | Weight max. | |
|-------------------------|-----------------------|------------|--------------|-------------|------------|-----------|------------|-------------|-----------|
| 20 (¾) | PN 40 (EN 1092-1 B1) | 576 (22.7) | 75 (3.0) | 69.5 (2.74) | 103 (4.06) | 62 (2.44) | 386 (15.2) | 513 (20.20) | 15 (33.1) |
| | CL150 (ASME B16.5) | 575 (22.6) | 69.9 (2.8) | | | | | | |
| | JIS 10K | 576 (22.7) | 75 (3.0) | | | | | | |
| | JIS 16K | 576 (22.7) | 75 (3.0) | | | | | | |
| | JIS 20K | 576 (22.7) | 75 (3.0) | | | | | | |
| 25 (1) | PN 40 (EN 1092-1 B1) | 525 (20.7) | 85 (3.3) | | | | | | |
| | PN 63 (EN 1092-1 B2) | 564 (22.2) | 100 (3.9) | | | | | | |
| | PN 100 (EN 1092-1 B2) | | | | | | | | |
| | CL150 (ASME B16.5) | 575 (22.6) | 79.2 (3.1) | | | | | | |
| | CL300 (ASME B16.5) | 576 (22.7) | 88.9 (3.5) | | | | | | |
| | CL600 (ASME B16.5) | | | | | | | | |
| | CL900 (ASME B16.5) | 576 (22.7) | 101.6 (4.0) | | | | | | |
| | CL1500 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 525 (20.7) | 90 (3.54) | | | | | | |
| | JIS 16K | 525 (20.7) | 90 (3.54) | | | | | | |
| JIS 20K | 525 (20.7) | 90 (3.54) | | | | | | | |
| 40 (1½) | PN 40 (EN 1092-1 B1) | 576 (22.7) | 110 (4.33) | | | | | | |
| | PN 63 (EN 1092-1 B2) | 572 (22.5) | 125 (4.92) | | | | | | |
| | PN 100 (EN 1092-1 B2) | | | | | | | | |
| | CL150 (ASME B16.5) | 576 (22.7) | 98.6 (3.88) | | | | | | |
| | CL300 (ASME B16.5) | 576 (22.7) | 114.3 (45.0) | | | | | | |
| | CL600 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 576 (22.7) | 105 (4.13) | | | | | | |
| | JIS 16K | 576 (22.7) | 105 (4.13) | | | | | | |
| | JIS 20K | 576 (22.7) | 105 (4.13) | | | | | | |

* Standard version: devices with 'Extended tower length – TE1, TE2' or 'pressure rating of sensor secondary housing'.

Tolerance for dimension L: +0 / -3 mm (+0 / -0.118 in)

... Flowmeter sensor

... Dimensions for devices with integral mount design

Meter tube nominal diameter DN 50 (2 in)

| DN / process connection | | L | Ø k | Ø A | B | C | E | E1* | Weight max. |
|-------------------------|-----------------------|-------------|--------------|----------|------------|-----------|-------------|-------------|-------------|
| 40 (1½) | PN 40 (EN 1092-1 B1) | 763 (30) | 110 (4.33) | 99 (3.9) | 126 (4.96) | 80 (3.15) | 416 (16.38) | 543 (21.38) | 31 (68.3) |
| | PN 63 (EN 1092-1 B2) | 745 (29.33) | 125 (4.92) | | | | | | |
| | PN 100 (EN 1092-1 B2) | | | | | | | | |
| | CL150 (ASME B16.5) | 763 (30) | 98.6 (3.88) | | | | | | |
| | CL300 (ASME B16.5) | 756 (29.76) | 114.3 (4.5) | | | | | | |
| | CL600 (ASME B16.5) | | | | | | | | |
| | CL900 (ASME B16.5) | 780 (30.71) | 124 (4.88) | | | | | | |
| | CL1500 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 763 (30) | 105 (4.13) | | | | | | |
| | JIS 16K | 763 (30) | 105 (4.13) | | | | | | |
| JIS 20K | 763 (30) | 105 (4.13) | | | | | | | |
| 50 (2) | PN 40 (EN 1092-1 B1) | 715 (28.15) | 125 (4.92) | | | | | | |
| | PN 63 (EN 1092-1 B2) | 745 (29.33) | 135 (5.31) | | | | | | |
| | PN 100 (EN 1092-1 B2) | 745 (29.33) | 145 (5.71) | | | | | | |
| | CL150 (ASME B16.5) | 715 (28.15) | 120.7 (4.75) | | | | | | |
| | CL300 (ASME B16.5) | 763 (30) | 127 (5.0) | | | | | | |
| | CL600 (ASME B16.5) | 773 (30.43) | 127 (5.0) | | | | | | |
| | CL900 (ASME B16.5) | 790 (31.1) | 165.1 (6.5) | | | | | | |
| | CL1500 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 715 (28.15) | 120 (4.72) | | | | | | |
| | JIS 16K | 715 (28.15) | 120 (4.72) | | | | | | |
| JIS 20K | 715 (28.15) | 120 (4.72) | | | | | | | |
| 65 (2½) | PN 40 (EN 1092-1 B1) | 763 (30) | 145 (5.71) | | | | | | |
| | CL150 (ASME B16.5) | 756 (29.76) | 139.7 (5.5) | | | | | | |
| | CL900 (ASME B16.5) | 800 (31.5) | 190.5 (7.5) | | | | | | |
| | CL1500 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 763 (30) | 140 (5.51) | | | | | | |
| | JIS 16K | 763 (30) | 140 (5.51) | | | | | | |
| JIS 20K | 763 (30) | 140 (5.51) | | | | | | | |

* Standard version: devices with 'Extended tower length – TE1, TE2' or 'pressure rating of sensor secondary housing'.


Tolerance for dimension L: +0 / -3 mm (+0 / -0.118 in)

Devices with meter tube nominal diameter DN 80 and flange DN 65 to 100


Sensor with wetted parts made from stainless steel.

All dimensions and weights are specified in mm (in) or kg (lb).

Standard Version

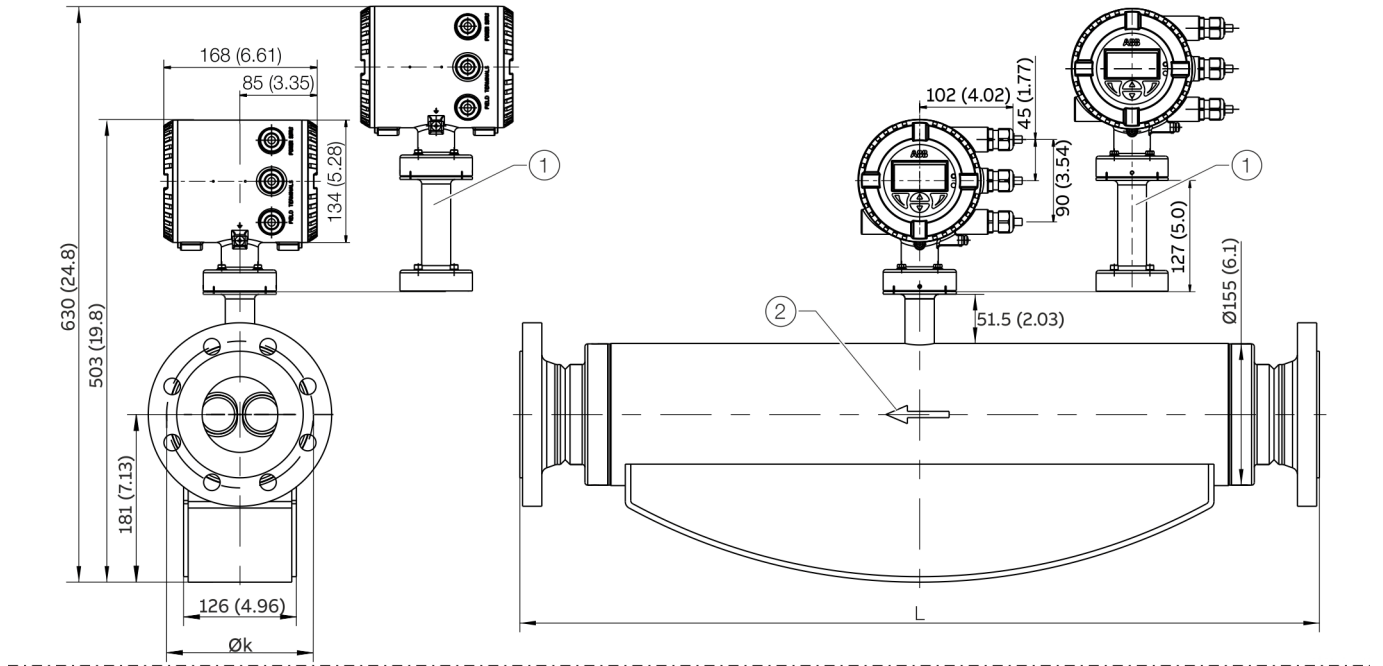

Marine version – CL1

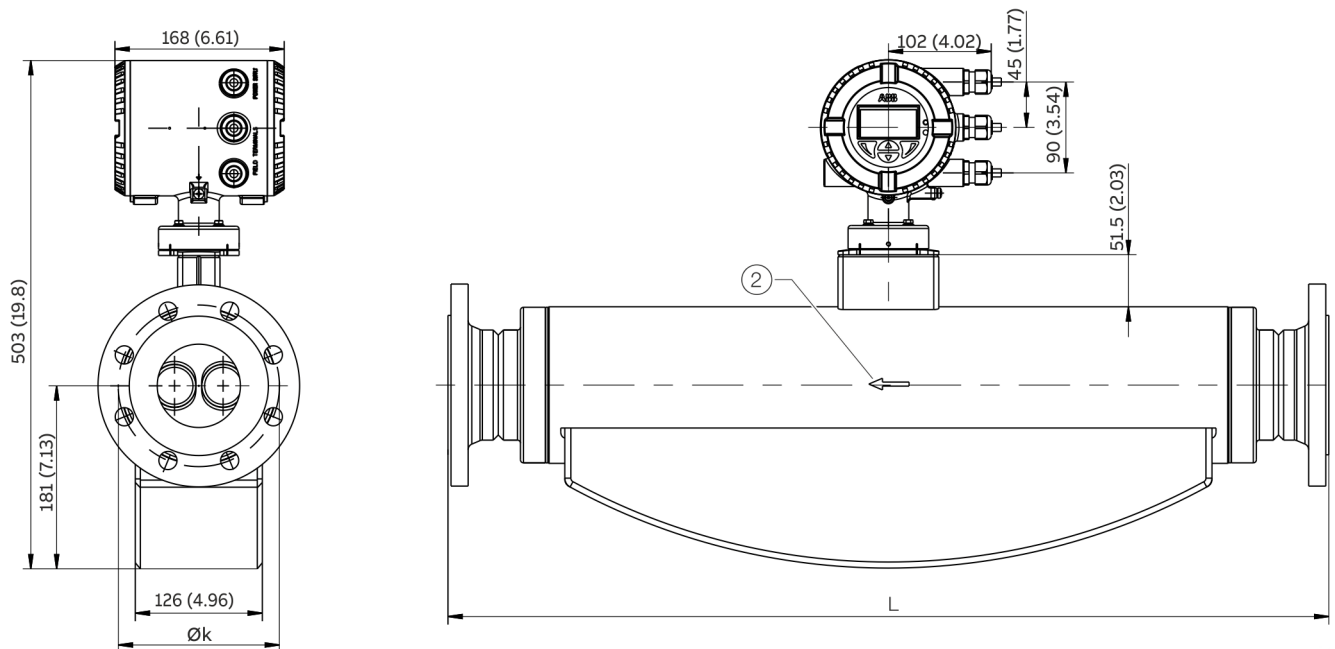

- ① 'Extended tower length – TE1, TE2' option or 'Pressure rating of sensor secondary housing – PR5, PR6, PR7' option
- ② Flow direction

Figure 2: Integral mount design with dual-compartment transmitter housing

... Flowmeter sensor

... Dimensions for devices with integral mount design

Meter tube nominal diameter DN 80 (3 in)

| DN / process connection | L | Ø k | Weight max. |
|-------------------------|-----------------------|--------------|--------------|
| 65 (2½ in) | PN 16 (EN 1092-1 B1) | —* | —* |
| | PN 40 (EN 1092-1 B1) | 910 (35.83) | 145 (5.71) |
| | PN 63 (EN 1092-1 B2) | | 160 (6.30) |
| | PN 100 (EN 1092-1 B2) | | 170 (6.69) |
| | CL150 (ASME B16.5) | 920 (36.22) | 123 (4.48) |
| | CL300 (ASME B16.5) | 920 (36.22) | 149.4 (5.88) |
| | CL600 (ASME B16.5) | | 77 (169.8) |
| | CL900 (ASME B16.5) | 965 (37.99) | 190.5 (7.50) |
| | CL1500 (ASME B16.5) | | 94 (207.23) |
| | JIS 10K | 910 (35.83) | 140 (5.5) |
| | JIS 16K | 910 (35.83) | 140 (5.5) |
| | JIS 20K | 920 (36.22) | 140 (5.5) |
| 80 (3 in) | PN 16 (EN 1092-1 B1) | 870 (34.25) | 160 (6.30) |
| | PN 40 (EN 1092-1 B1) | | 75 (165.4) |
| | PN 63 (EN 1092-1 B2) | 910 (35.83) | 170 (6.69) |
| | PN 100 (EN 1092-1 B2) | | 180 (7.09) |
| | CL150 (ASME B16.5) | 880 (34.65) | 152.4 (6.00) |
| | CL300 (ASME B16.5) | 895 (35.24) | 168.1 (6.62) |
| | CL600 (ASME B16.5) | 920 (36.22) | 82 (180.8) |
| | CL900 (ASME B16.5) | 1100 (43.31) | 190.5 (7.50) |
| | CL1500 (ASME B16.5) | 1300 (51.18) | 203.2 (8.00) |
| | JIS 10K | 870 (34.25) | 150 (5.91) |
| | JIS 16K | 870 (34.25) | 150 (5.91) |
| | JIS 20K | 910 (35.83) | 150 (5.91) |
| 100 (4 in) | PN 16 (EN 1092-1 B1) | 875 (34.45) | 180 (7.09) |
| | PN 40 (EN 1092-1 B1) | | 190 (7.48) |
| | PN 63 (EN 1092-1 B2) | 1060 (41.73) | 200 (7.87) |
| | PN 100 (EN 1092-1 B2) | 1080 (42.52) | 210 (8.27) |
| | CL150 (ASME B16.5) | 880 (34.65) | 190.5 (7.50) |
| | CL300 (ASME B16.5) | 1075 (42.32) | 200.2 (7.88) |
| | CL600 (ASME B16.5) | 1100 (43.31) | 215.9 (8.50) |
| | CL900 (ASME B16.5) | 1130 (44.49) | 234.9 (9.25) |
| | CL1500 (ASME B16.5) | 1150 (45.28) | 241.3 (9.50) |
| | JIS 10K | 1060 (41.73) | 175 (6.86) |
| | JIS 16K | 1060 (41.73) | 175 (6.86) |
| | JIS 20K | 1060 (41.73) | 175 (6.86) |

* On request

Tolerance for dimension L: +0 / -3 mm (+0 / -0.118 in)

Devices with meter tube nominal diameter DN 100 and flange DN 80 to 150

Sensor with wetted parts made from stainless steel.

All dimensions and weights are specified in mm (in) or kg (lb).

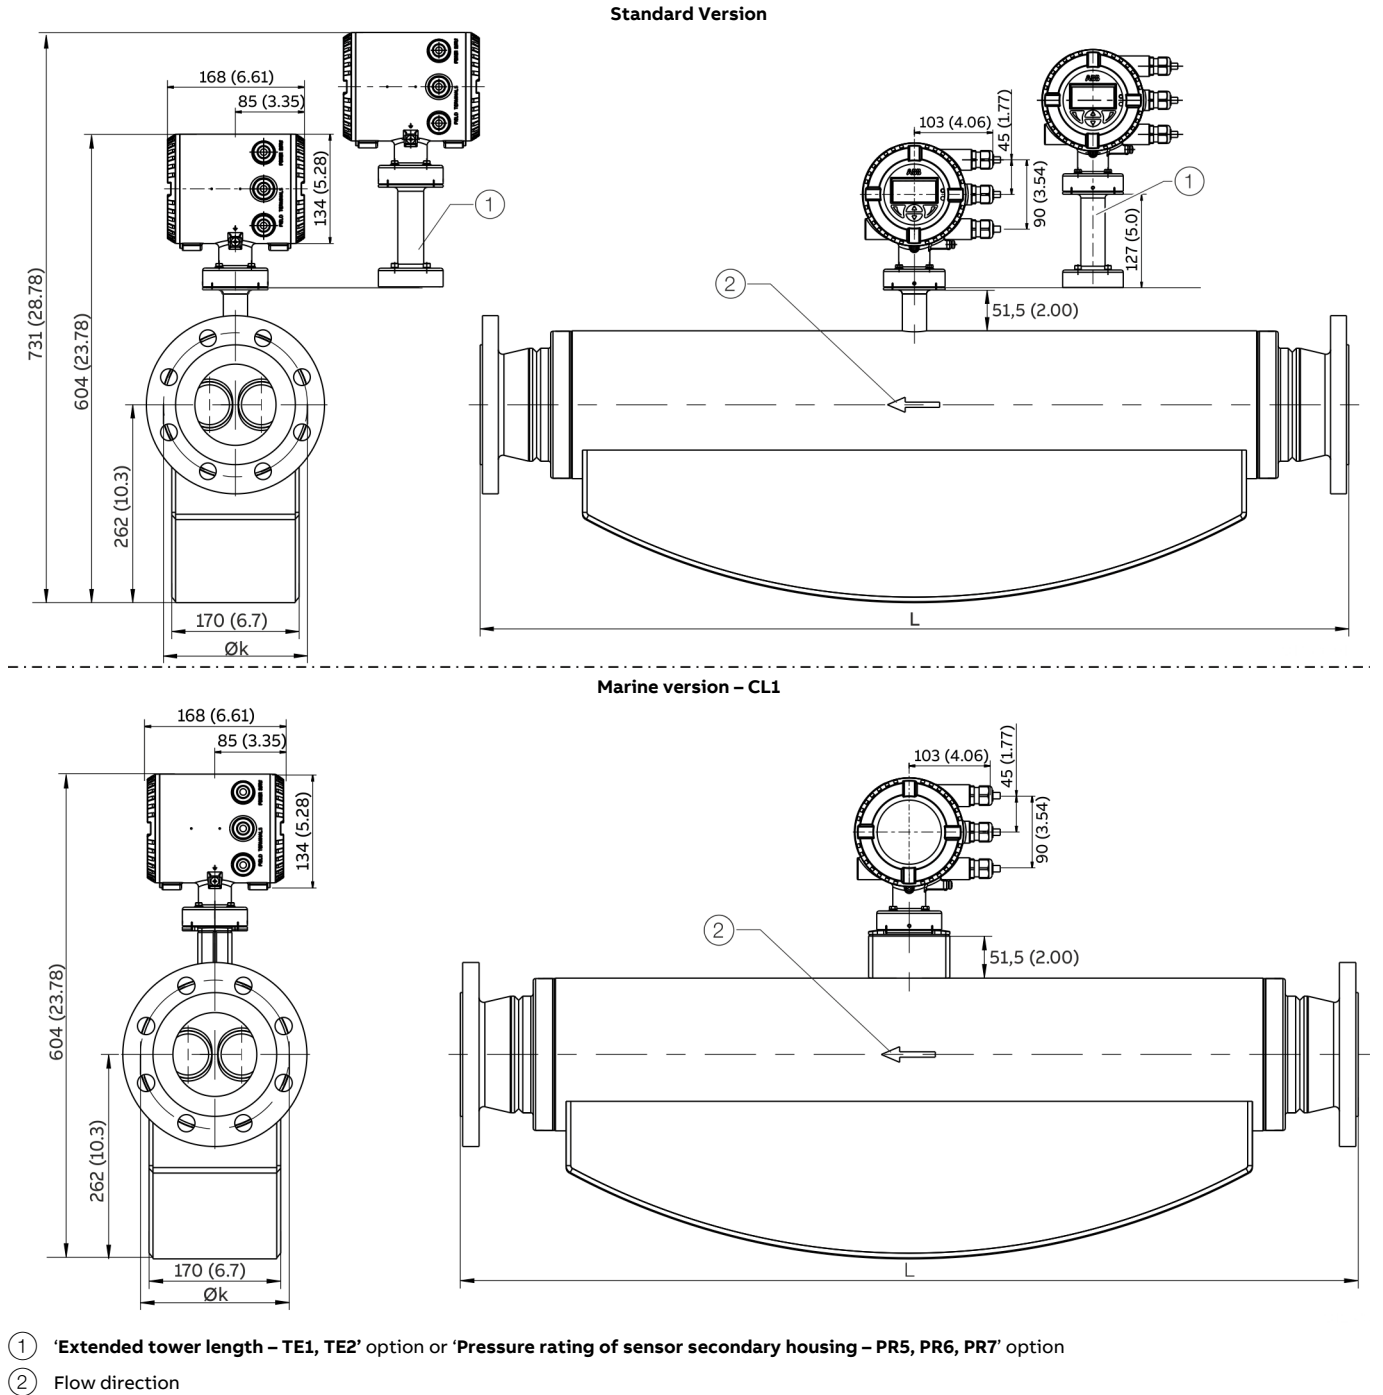


Figure 3: Integral mount design with dual compartment transmitter housing

... Flowmeter sensor

... Dimensions for devices with integral mount design

| Meter tube nominal diameter DN 100 (4 in) | | | | |
|---|-----------------------|----------------------------|----------------------------|-------------|
| DN / process connection | | L | Ø k | Weight max. |
| 80 (3 in) | PN 16 (EN 1092-1 B1) | 1222 (48.11) ¹⁾ | 160 (6.30) | 126 (278) |
| | PN 40 (EN 1092-1 B1) | | | |
| | PN 63 (EN 1092-1 B2) | 1234 (48.58) ¹⁾ | 170 (6.69) | 130 (287) |
| | PN 100 (EN 1092-1 B2) | | 180 (7.09) | 132 (291) |
| | CL150 (ASME B16.5) | 1244 (48.98) ¹⁾ | 152.4 (6.00) | 127 (280) |
| | CL300 (ASME B16.5) | | 168.1 (6.62) | 135 (298) |
| | CL600 (ASME B16.5) | | 168.1 (6.62) | 138 (304) |
| | CL900 (ASME B16.5) | 1470 (57.87) ¹⁾ | 190.5 (7.50) | 141 (311) |
| | CL1500 (ASME B16.5) | 1500 (59.05) ¹⁾ | 203.2 (8.00) | 153 (337) |
| | JIS 10K | 1275 (50.20) ¹⁾ | 150 (5.91) | 123 (271) |
| | JIS 16K | 1275 (50.20) ¹⁾ | 150 (5.91) | 123 (271) |
| | JIS 20K | 1275 (50.20) ¹⁾ | 150 (5.91) | 123 (271) |
| | 100 (4 in) | PN 16 (EN 1092-1 B1) | 1123 (44.21) ²⁾ | 180 (7.09) |
| PN 40 (EN 1092-1 B1) | | 1146 (45.12) ²⁾ | 190 (7.48) | 126 (278) |
| PN 63 (EN 1092-1 B2) | | 1304 (51.34) ¹⁾ | 138 (5.43) | 133 (293) |
| PN 100 (EN 1092-1 B2) | | 1334 (52.52) ¹⁾ | 150 (5.91) | 141 (311) |
| CL150 (ASME B16.5) | | 1145 (45.08) ²⁾ | 190.5 (7.50) | 127 (280) |
| CL300 (ASME B16.5) | | 1320 (51.97) ²⁾ | 200.2 (7.88) | 139 (306) |
| CL600 (ASME B16.5) | | 1336 (52.60) ³⁾ | 215.9 (8.50) | 141 (311) |
| CL900 (ASME B16.5) | | 1380 (54.33) ¹⁾ | 234.9 (9.25) | 160 (353) |
| CL1500 (ASME B16.5) | | 1400 (55.12) ¹⁾ | 241.3 (9.50) | 174 (384) |
| JIS 10K | | 1150 (45.28) ¹⁾ | 175 (6.89) | 126 (278) |
| JIS 16K | | 1150 (45.28) ¹⁾ | 175 (6.89) | 126 (278) |
| JIS 20K | | 1150 (45.28) ¹⁾ | 175 (6.89) | 126 (278) |
| 150 (6 in) | | PN 16 (EN 1092-1 B1) | 1255 (49.41) ²⁾ | 240 (9.44) |
| | PN 40 (EN 1092-1 B1) | 1297 (51.06) ¹⁾ | 250 (9.84) | 139 (306) |
| | CL150 (ASME B16.5) | 1252 (49.29) ³⁾ | 241.3 (9.50) | 137 (302) |
| | CL600 (ASME B16.5) | 1400 (55.12) ¹⁾ | – | – |
| | JIS 10K | 1300 (51.18) ¹⁾ | 240 (9.44) | 130 (287) |
| | JIS 16K | 1300 (51.18) ¹⁾ | 240 (9.44) | 130 (287) |
| | JIS 20K | 1308 (51.50) ¹⁾ | 240 (9.44) | 130 (287) |

L dimension tolerances


- 1) +0 / -15 mm (+0 / -0.59 in)
- 2) +0 / -5 mm (+0 / -0.20 in)
- 3) +0 / -8 mm (+0 / -0.31 in)

Devices with meter tube nominal diameter DN 150 and flange DN 100 to DN 200


Sensor with wetted parts made from stainless steel.

All dimensions and weights are specified in mm (in) or kg (lb).

Standard Version

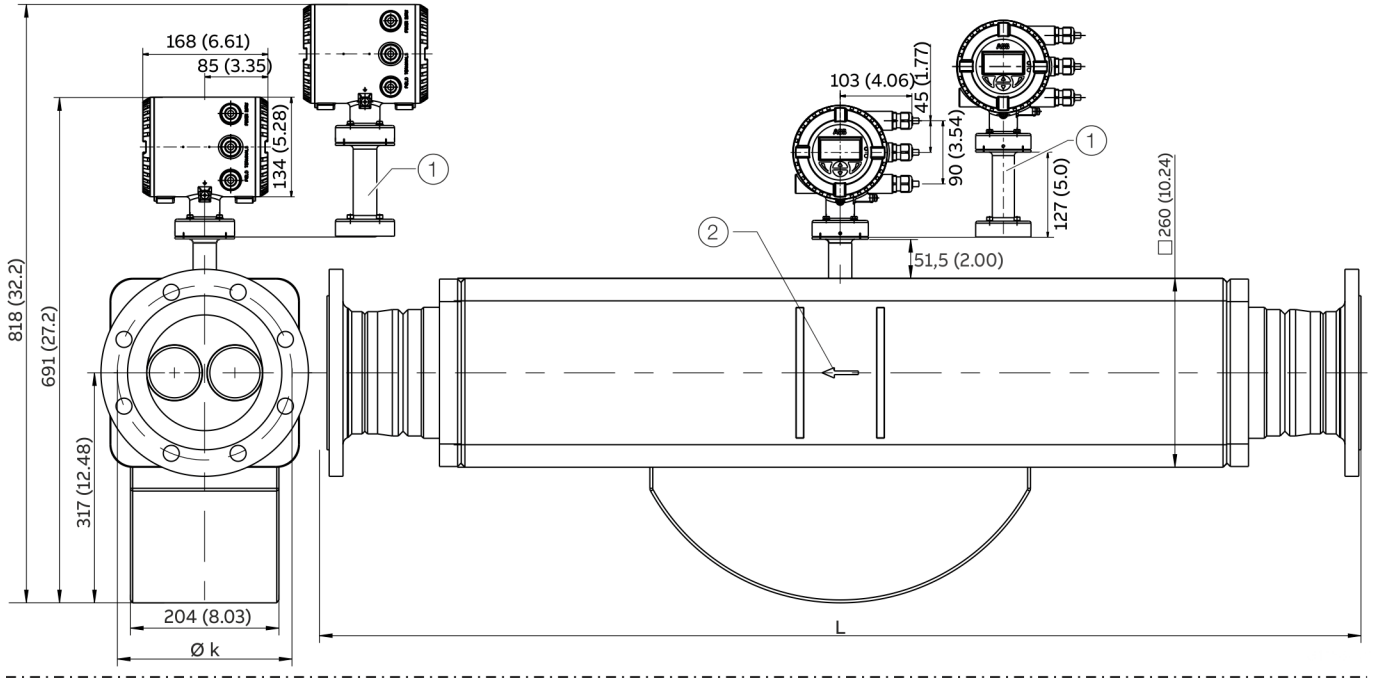

Marine version – CL1

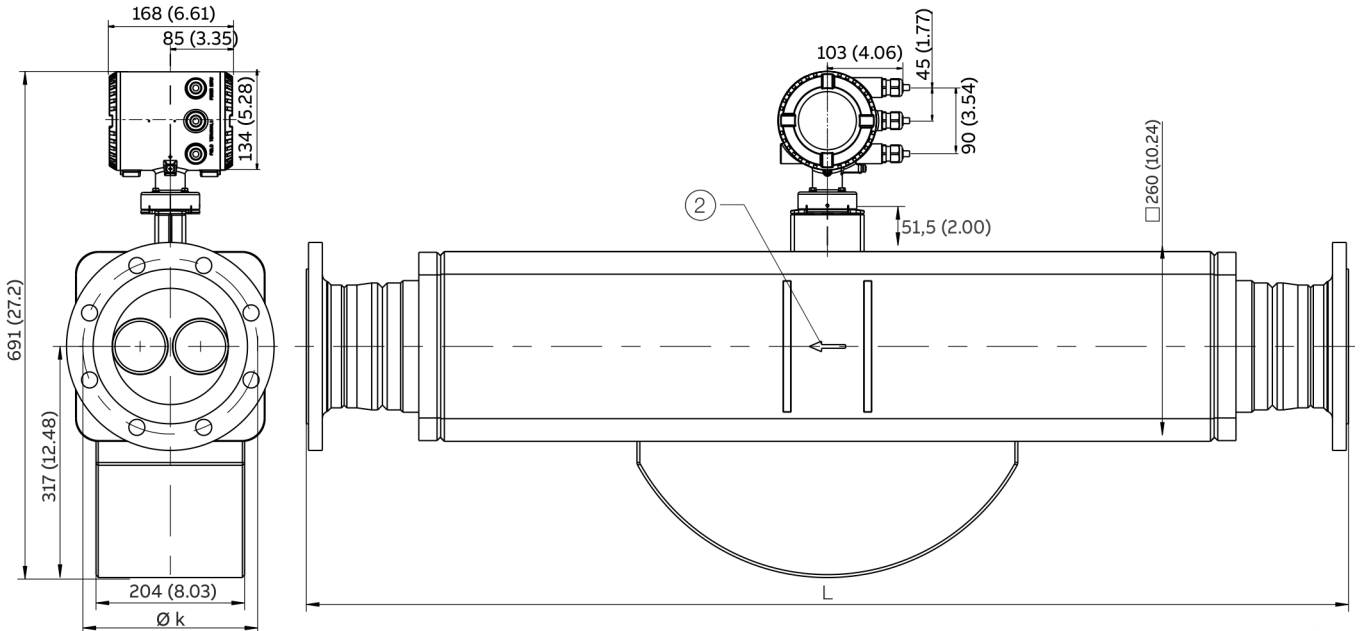

① 'Extended tower length – TE1, TE2' option or 'Pressure rating of sensor secondary housing – PR5, PR6, PR7' option

② Flow direction

Figure 4: Integral mount design with dual compartment transmitter housing

... Flowmeter sensor

... Dimensions for devices with integral mount design

| Meter tube nominal diameter DN 150 (6 in) | | | | |
|---|----------------------|----------------------------|---------------|-------------|
| DN / process connection | | L | Ø k | Weight max. |
| 100 (4 in) | PN 16 (EN 1092-1 B1) | 1569 (61.77) ¹⁾ | 180 (7.09) | 175 (386) |
| | PN 40 (EN 1092-1 B1) | 1599 (62.95) ¹⁾ | 190 (7.48) | 179 (395) |
| | CL150 (ASME B16.5) | 1630 (64.17) ¹⁾ | 190.5 (7.50) | 182 (401) |
| | CL300 (ASME B16.5) | 1650 (64.96) ¹⁾ | 200.2 (7.88) | 188 (414) |
| | CL600 (ASME B16.5) | 1675 (65.94) ¹⁾ | 215.9 (8.50) | 198 (437) |
| | CL900 (ASME B16.5) | 1705 (67.13) ¹⁾ | 234.9 (9.25) | 208 (459) |
| | CL1500 (ASME B16.5) | 1725 (67.91) ¹⁾ | 241.3 (9.50) | 223 (492) |
| | JIS 10K | 1485 (58.46) ¹⁾ | 175 (6.89) | 179 (395) |
| | JIS 16K | 1485 (58.46) ¹⁾ | 185 (7.28) | 181 (399) |
| | JIS 20K | 1485 (58.46) ¹⁾ | 185 (7.28) | 181 (399) |
| 150 (6 in) | PN 16 (EN 1092-1 B1) | 1421 (55.94) ¹⁾ | 240 (9.45) | 178 (392) |
| | PN 40 (EN 1092-1 B1) | 1459 (57.44) ²⁾ | 250 (9.84) | 186 (410) |
| | CL150 (ASME B16.5) | 1482 (58.35) ³⁾ | 241.3 (9.50) | 185 (408) |
| | CL300 (ASME B16.5) | 1503 (59.17) ³⁾ | 269.7 (10.62) | 203 (448) |
| | CL600 (ASME B16.5) | 1555 (61.22) ¹⁾ | 292.1 (11.50) | 225 (496) |
| | CL900 (ASME B16.5) | 1605 (63.19) ¹⁾ | 317.5 (12.5) | 249 (549) |
| | CL1500 (ASME B16.5) | 1665 (65.55) ¹⁾ | | 291 (642) |
| | JIS 10K | 1425 (56.10) ¹⁾ | 240 (9.45) | 186 (410) |
| | JIS 16K | 1456 (57.32) ¹⁾ | 260 (6.30) | 187 (412) |
| | JIS 20K | 1464 (57.64) ¹⁾ | 260 (6.30) | 187 (412) |
| 200 (8 in) | PN 16 (EN 1092-1 B1) | —* | —* | —* |
| | PN 40 (EN 1092-1 B1) | 1637 (64.45) ¹⁾ | 320 (12.6) | 209 (461) |
| | CL150 (ASME B16.5) | 1650 (64.96) ¹⁾ | 298.5 (11.75) | 204 (450) |
| | CL300 (ASME B16.5) | 1664 (65.51) ³⁾ | 330.2 (13.0) | 229 (505) |
| | CL600 (ASME B16.5) | 1730 (68.11) ¹⁾ | — | — |
| | JIS10K | 1583 (62.32) ¹⁾ | 290 (11.42) | 209 (461) |
| | JIS 16K | 1615 (63.58) ¹⁾ | 305 (12.01) | 210 (463) |
| | JIS 20K | 1623 (63.90) ¹⁾ | 305 (12.01) | 210 (463) |

* On request

L dimension tolerances


- 1) +0 / -20 mm (+0 / -0.79 in)
- 2) +0 / -5 mm (+0 / -0.20 in)
- 3) +0 / -8 mm (+0 / -0.31 in)

Devices DN 15 to 150 in NAMUR standard installation lengths (order option S5, S7)


Sensor with wetted parts made from stainless steel.

Dimensions and weights are in mm (in.) and kg (lb).

Standard Version

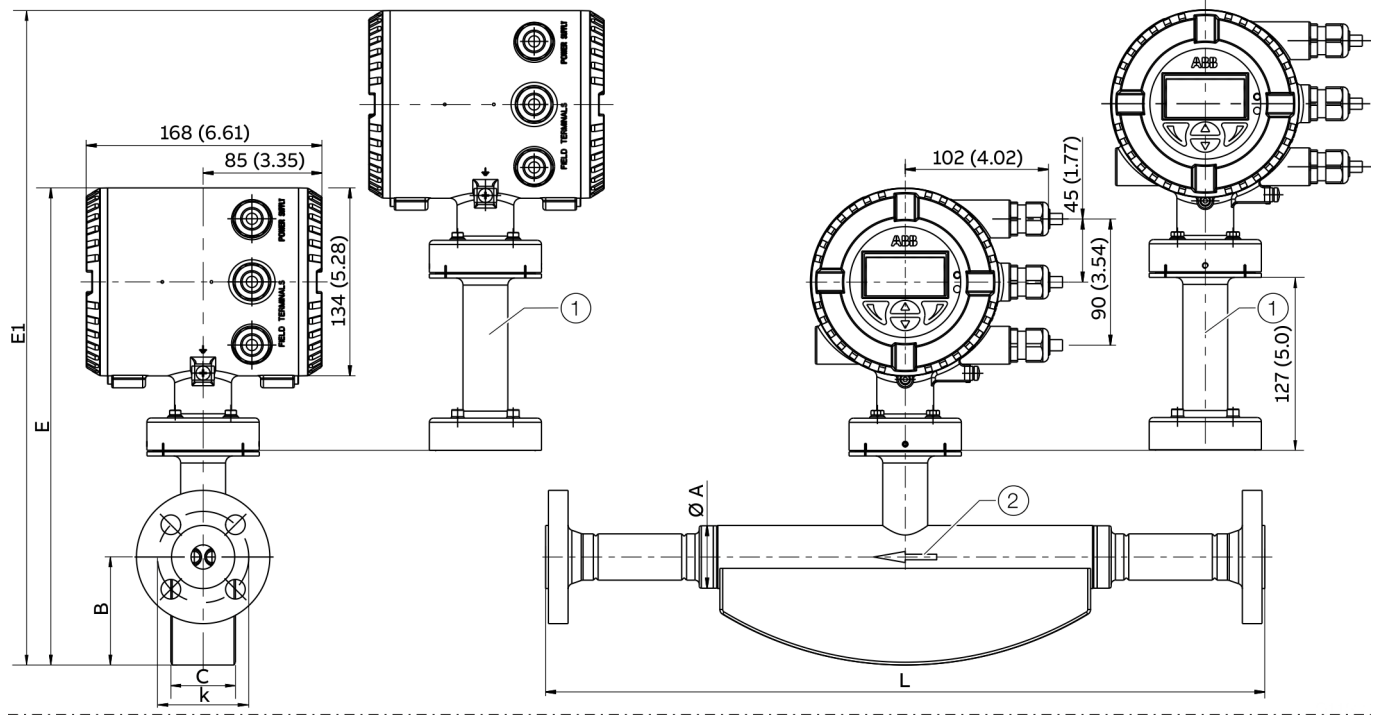

Marine version – CL1

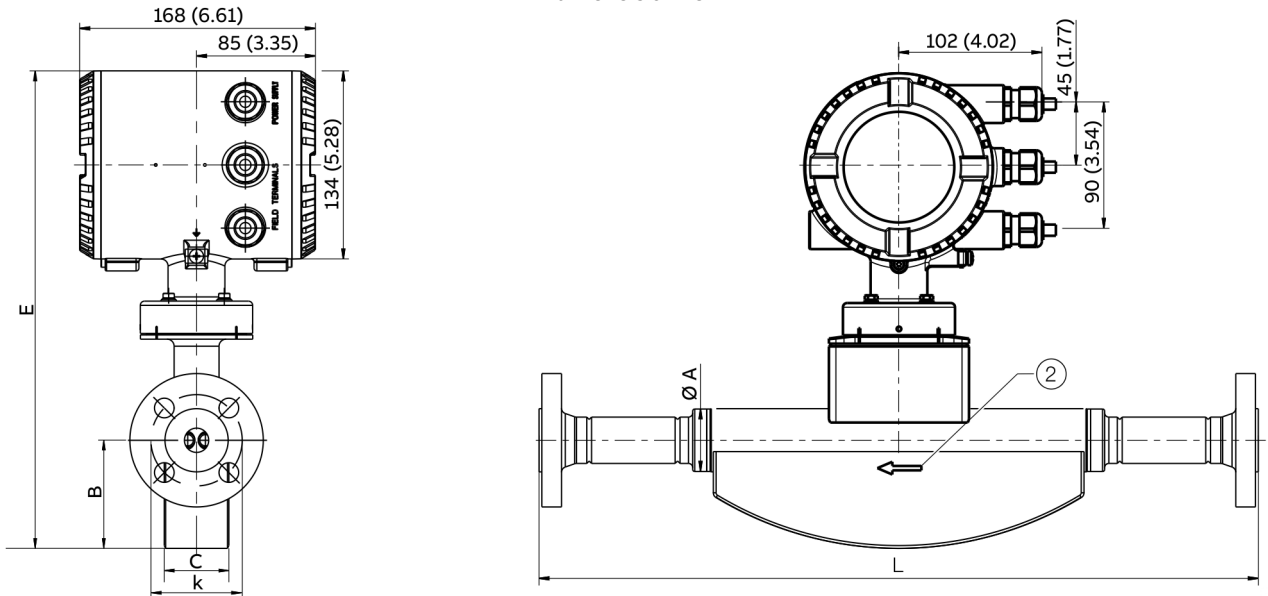

- ① 'Extended tower length – TE1, TE2' option or 'Pressure rating of sensor secondary housing – PR5, PR6, PR7' option
- ② Flow direction

Figure 5: Device in integral mount design

... Flowmeter sensor

... Dimensions for devices with integral mount design

Devices DN 15 to 150 in NAMUR standard installation lengths

| Meter tube | Process connection | L | Ø k | Ø A | B | C | E | E1* | Weight max. |
|---------------------|-----------------------|----------------------------|------------|-------------|-------------|------------|-------------|-------------|-------------|
| EN 1092-1 B1 | | | | | | | | | |
| DN 15 (½ in) | DN 15 (½ in) / PN 40 | 510 (20.08) ¹⁾ | 60 (2.4) | 44.5 (1.8) | 77 (3.0) | 46 (1.8) | 340 (13.39) | 467 (18.39) | 13.5 (29.8) |
| DN 25 (1 in) | DN 25 (1 in) / PN 40 | 600 (23.62) ¹⁾ | 75 (3.0) | 69.5 (2.74) | 103 (4.06) | 62 (2.44) | 379 (14.92) | 506 (19.92) | 15 (33.1) |
| DN 50 (1 in) | DN 50 (1 in) / PN 40 | 715 (28.15) ¹⁾ | 125 (4.92) | 99 (3.9) | 125 (4.92) | 80 (3.15) | 416 (16.38) | 543 (21.38) | 31 (68.3) |
| DN 80 (3 in) | DN 80 (3 in) / PN 40 | 915 (36.02) ¹⁾ | 160 (6.30) | 155 (6.1) | 183 (7.2) | 123 (4.84) | 505 (19.88) | 632 (24.88) | 74 (163) |
| DN 100 (4 in) | DN 100 (4 in) / PN 16 | 1400 (55.12) ²⁾ | 180 (7.09) | 195 (7.68) | 261 (10.28) | 168 (6.61) | 603 (23.74) | 730 (28.74) | 123 (271) |
| DN 150 (6 in) | DN 150 (6 in) / PN 16 | 1700 (66.93) ³⁾ | 240 (9.45) | 260 (10.24) | 320 (12.6) | 205 (8.07) | 691 (27.2) | 818 (32.2) | 178 (392) |

* Standard design: * Devices with 'Extended tower length – TE1, TE2' option or 'Pressure rating of sensor secondary housing' option


L dimension tolerances

- 1) +0 / -3 mm (+0 / -0.118 in)
- 2) +0 / -5 mm (+0 / -0.20 in)
- 3) +0 / -20 mm (+0 / -0.79 in)

Devices with meter tube nominal diameter DN 15 to 80 and connections in accordance with SMS 1145, DIN 11851, DIN 32676, DIN ISO 228, ASME BPE and ASME B 1.20.1

Sensor with wetted parts made from stainless steel.

All dimensions and weights are specified in mm (in) or kg (lb).

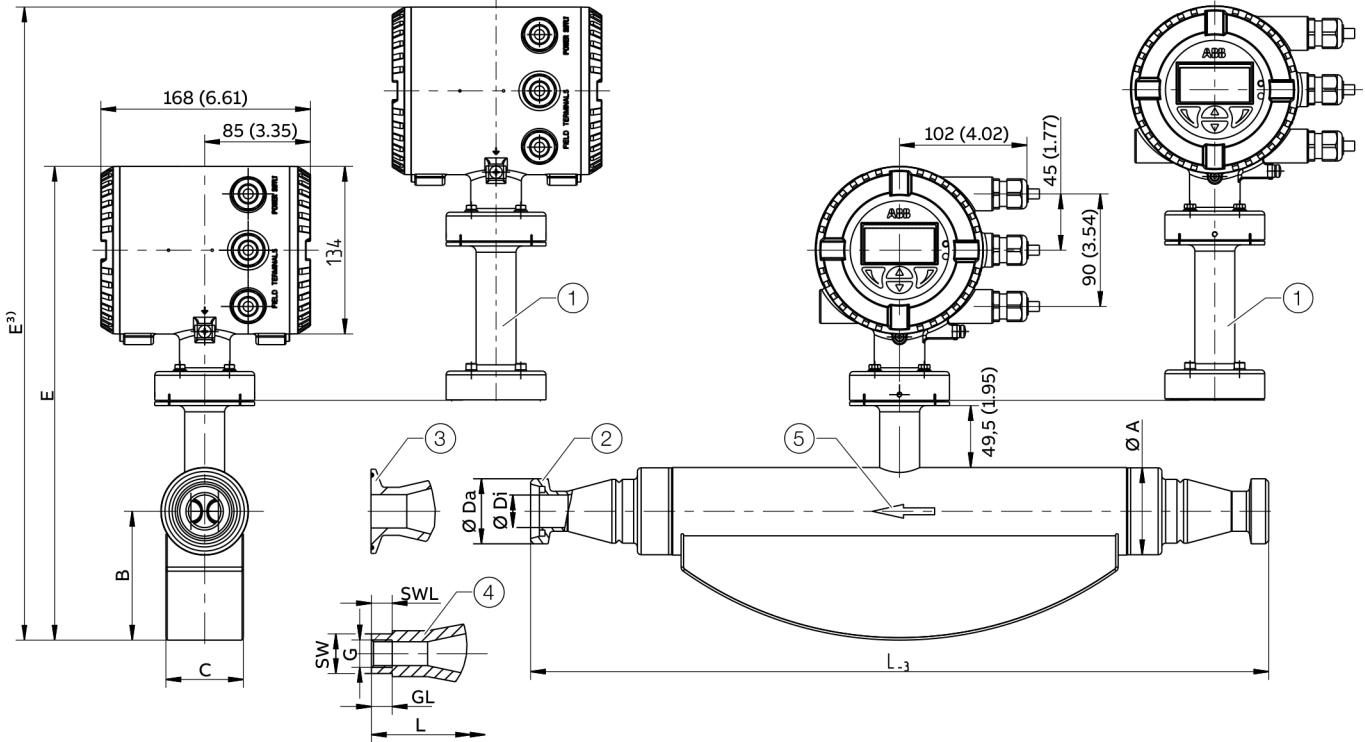

- ① 'Extended tower length – TE1' option or 'Pressure rating of sensor secondary housing – PR5, PR6, PR7' option.
- ② Threaded spuds in accordance with DIN 11851 and SMS 1145
- ③ Clamping connection in accordance with DIN 32676 and ASME BPE
- ④ Female thread connection in accordance with DIN ISO 228 and ASME B 1.20.1
- ⑤ Flow direction

Figure 19: Integral mount design with dual-compartment transmitter housing

| Process connection in accordance with SMS 1145 meter tube nominal diameter DN 25 to 80 (1 to 3 in) | | | | | | | | | | | |
|--|--------------------|----|------------|------------|-------------|--------|--------|--------|--------------------|--------------------|-------------------|
| Meter tube DN | Process connection | | L | Ø DA | Ø Di | Ø A | B | C | E | Approximate weight | |
| | DN | PN | | | | | | | | Aluminum* | Stainless steel** |
| 25 (1 in) | 25 (1 in) | 6 | 590 (23.2) | RD 40x½ in | 22.6 (0.89) | 69.5 | 103 | 62 | 379 / 506*** | 13 (29) | 14 (31) |
| | 40 (1½ in) | | | RD 60x½ in | 38 (1.50) | (2.74) | (4.06) | (2.44) | (14.92 / 19.92***) | | |
| 50 (2 in) | 40 (1½ in) | 6 | 763 (30.0) | RD 60x½ in | 35.5 (1.40) | 99 | 125 | 80 | 416 / 543*** | 29 (64) | 30 (66) |
| | 50 (2 in) | | 740 (29.1) | RD 70x½ in | 48.5 (1.91) | (3.46) | (4.92) | (3.15) | (16.38 / 21.38***) | | |
| | 65 (2½ in) | | | RD 85x½ in | 60.5 (2.38) | | | | | | |
| 80 (3 in) | 65 (2½ in) | | 990 (39.0) | RD 85x½ in | 60.5 (2.38) | 155 | 183 | 123 | 505 / 632*** | 70 (154) | 71 (156) |
| | 80 (3 in) | | 940 (37.0) | RD 98x¾ in | 72.6 (2.86) | (6.10) | (7.20) | (4.84) | (19.88 / 24.88***) | | |

* Devices with terminal boxes made from aluminum.

** Devices with terminal boxes made from stainless steel.

*** Devices with 'Extended tower length' option or 'Pressure rating of sensor secondary housing' option.

... Flowmeter sensor

... Dimensions for devices with integral mount design

Process connection in accordance with DIN 11851 meter tube nominal diameter DN 15 to 80 (½ to 3 in.)

| Meter tube DN | Process connection | | L | Ø DA | Ø Di | Ø A | B | C | E | Approximate weight | | | | | | | |
|------------------|--------------------|------------|------------|-------------|------------|------|-----------|-----------|--------------|--------------------|-------------------|--------|--------------------|--------------|--------------------|----------------|----------------|
| | DN | PN | | | | | | | | Aluminum* | Stainless steel** | | | | | | |
| 15 (½ in) | 10 (¾ in) | 40 | 413 (16.3) | RD 28x¾ in | 10 (0.39) | 44.5 | 77 (3.03) | 46 (1.81) | 340 / 467*** | 9 / 10*** | 12 / 13*** | | | | | | |
| | 15 (½ in) | | | RD 34x½ in | 16 (0.63) | | | | | | | (1.75) | (13.39 / 18.39***) | (20 / 22***) | (27 / 29***) | | |
| | 20 (¾ in) | | | RD 44x½ in | 20 (0.79) | | | | | | | | | | | | |
| 25 (1 in) | 20 (¾ in) | 590 (23.2) | 590 (23.2) | RD 44x½ in | 20 (0.79) | 69.5 | 103 | 62 | 379 / 506*** | 11 / 12*** | 14 / 15*** | | | | | | |
| | 25 (1 in) | | | RD 52x½ in | 26 (1.02) | | | | | | | (2.74) | (4.06) | (2.44) | (14.92 / 19.92***) | (24 / 27***) | (31 / 33***) |
| | 40 (1 ½ in) | | | RD 65x½ in | 38 (1.5) | | | | | | | | | | | | |
| 50 (2 in) | 40 (1 ½ in) | 763 (30.0) | 763 (30.0) | RD 65x½ in | 38 (1.5) | 99 | 125 | 80 | 416 / 543*** | 27 / 28*** | 30 / 31*** | | | | | | |
| | 50 (2 in) | | | RD 78x½ in | 50 (1.97) | | | | | | | (3.46) | (4.92) | (3.15) | (16.38 / 21.38***) | (60 / 62***) | (66 / 68***) |
| | 65 (2 ½ in) | | | RD 95x½ in | 66 (2.6) | | | | | | | | | | | | |
| 80 (3 in) | 65 (2 ½ in) | 990 (39.0) | 990 (39.0) | RD 95x½ in | 66 (2.6) | 155 | 183 | 123 | 505 / 632*** | 68 / 69*** | 71 / 72*** | | | | | | |
| | 80 (3 in) | | | RD 110x¾ in | 81 (3.19) | | | | | | | (6.10) | (7.20) | (4.84) | (19.88 / 24.88***) | (150 / 152***) | (157 / 159***) |
| | 100 (4 in) | | | RD 130x¾ in | 100 (3.94) | | | | | | | | | | | | |

Process connection in accordance with DIN 32676 meter tube nominal diameter DN 15 to 80 (½ to 3 in.)

| Meter tube DN | Process connection | | L | Ø DA | Ø Di | Ø A | B | C | E | Approximate weight | | | | | | | | | |
|------------------|--------------------|------------|------------|-------------|------------|------|-----------|-----------|--------------|--------------------|-------------------|--------------------|--------------|--------------|--------------------|--------------------|--------------------|----------------|--------------|
| | DN | PN | | | | | | | | Aluminum* | Stainless steel** | | | | | | | | |
| 15 (½ in) | 10 (¾ in) | 40 | 413 (16.3) | 34 (1.34) | 10 (0.39) | 44.5 | 77 (3.03) | 46 (1.81) | 340 / 467*** | 9 / 10*** | 12 / 13*** | | | | | | | | |
| | 15 (½ in) | | | 16 (0.63) | (1.75) | | | | | | | (13.39 / 18.39***) | (20 / 22***) | (27 / 29***) | | | | | |
| | 20 (¾ in) | | | 20 (0.79) | | | | | | | | | | | | | | | |
| 25 (1 in) | 20 (¾ in) | 590 (23.2) | 590 (23.2) | | 20 (0.79) | 69.5 | 103 | 62 | 379 / 506*** | 11 / 12*** | 14 / 15*** | | | | | | | | |
| | 25 (1 in) | | | 50.5 (1.99) | 26 (1.02) | | | | | | | (2.74) | (4.06) | (2.44) | (14.92 / 19.92***) | (24 / 27***) | (31 / 33***) | | |
| | 40 (1 ½ in) | | | | 38 (1.5) | | | | | | | | | | | | | | |
| 50 (2 in) | 40 (1 ½ in) | 763 (30.0) | 763 (30.0) | | 38 (1.5) | 99 | 125 | 80 | 416 / 543*** | 27 / 28*** | 30 / 31*** | | | | | | | | |
| | 50 (2 in) | | | 25 | 740 (29.1) | | | | | | | 64 (2.52) | 50 (1.97) | (3.46) | (4.92) | (3.15) | (16.38 / 21.38***) | (60 / 62***) | (66 / 68***) |
| | 65 (2 ½ in) | | | | | | | | | | | 91 (3.58) | 66 (2.6) | | | | | | |
| 80 (3 in) | 65 (2 ½ in) | 10 | 950 (37.4) | | 66 (2.6) | 155 | 183 | 123 | 505 / 632*** | 68 / 69*** | 71 / 72*** | | | | | | | | |
| | 80 (3 in) | | | 910 (35.83) | 106 (4.17) | | | | | | | 81 (3.19) | (6.10) | (7.20) | (4.84) | (19.88 / 24.88***) | (150 / 152***) | (157 / 159***) | |
| | 100 (4 in) | | | | 119 (4.69) | | | | | | | 100 (3.94) | | | | | | | |

* Devices with terminal boxes made from aluminum.

** Devices with terminal boxes made from stainless steel.

*** Devices with 'Extended tower length' option or 'Pressure rating of sensor secondary housing' option.

Tolerance for dimension L: +0 / -3 mm (+0 / -0.118 in)

Process connection in accordance with ASME BPE, meter tube nominal diameter DN 15 to 80 (½ to 3 in.)

| Meter tube DN | Process connection | | L | Ø DA | Ø Di | Ø A | B | C | E | Approximate weight | |
|------------------|--------------------|----|-------------|--------------|-------------|--------|--------|--------|-------------------------------|---------------------------|------------------------------|
| | DN | PN | | | | | | | | Aluminum ¹ | Stainless steel ² |
| 15 (½ in) | ¾ in-Type A | 10 | – | – | – | 44.5 | 77 | 46 | 340 / 467 ³ | 9 / 10 ³ | 12 / 13 ³ |
| | ½ in-Type A | | 433 (17.05) | 25 (0.98) | 9.4 (0.37) | (1.75) | (3.03) | (1.81) | (13.39 / 18.39 ³) | (20 / 22 ³) | (27 / 29 ³) |
| | ¾ in-Type A | | – | – | – | | | | | | |
| 25 (1 in) | ¾ in-Type A | | – | – | – | 69.5 | 103 | 62 | 379 / 506 ³ | 11 / 12 ³ | 14 / 15 ³ |
| | 1 in-Type B | | 590 (23.23) | 50.4 (1.98) | 22.1 (0.87) | (2.74) | (4.06) | (2.44) | (14.92 / 19.92 ³) | (24 / 27 ³) | (31 / 33 ³) |
| | 1½ in-Type B | | 590 (23.23) | 50.4 (1.98) | 34.8 (1.37) | | | | | | |
| 50 (2 in) | 1½ in-Type B | | – | – | – | 99 | 125 | 80 | 416 / 543 ³ | 27 / 28 ³ | 30 / 31 ³ |
| | 2 in-Type B | | 740 (29.13) | 63.9 (2.52) | 47.5 (1.87) | (3.46) | (4.92) | (3.15) | (16.38 / 21.38 ³) | (60 / 62 ³) | (66 / 68 ³) |
| | 2½ in-Type B | | – | – | – | | | | | | |
| 80 (3 in) | 2½ in-Type B | | 950 (37.40) | 77.4 (3.05) | 60.2 (2.37) | 155 | 183 | 183 | 505 / 632 ³ | 68 / 69 ³ | 71 / 72 ³ |
| | 3 in-Type B | | 910 (35.83) | 90.9 (3.19) | 72.9 (2.87) | (6.10) | (7.20) | (7.20) | (19.88 / 24.88 ³) | (150 / 152 ³) | (157 / 159 ³) |
| | 4 in-Type B | | 910 (35.83) | 118.9 (4.68) | 97.4 (3.83) | | | | | | |

Process connection in accordance with DIN ISO 228 and ASME B 1.20.1, meter tube nominal diameter DN 15 (½ in)

| Meter tube DN | Process connection DN / G PN | L | GL WS ⁴ | | SWL | Ø A | B | C | E | Approximate weight | | |
|------------------|---------------------------------|-----|--------------------|-------------|-----|-----------|--------|-----------|-----------|-------------------------------|------------------------------|-------------------------|
| | | | [Caution] | | | | | | | Aluminum ¹ | Stainless steel ² | |
| 15 (½ in) | 8 (¼ in) / G ¼ in | 100 | 450 | 10 (0.39) | 19 | 10 (0.39) | 44.5 | 77 (3.03) | 46 (1.81) | 340 / 467 ³ | 9 / 10 ³ | 12 / 13 ³ |
| | | | (17.72) | | | | (1.75) | | | (13.39 / 18.39 ³) | (20 / 22 ³) | (27 / 29 ³) |
| | 15 (½ in) / G ½ in. | | | 13.5 (0.53) | 27 | 15 (0.59) | | | | | | |
| | 25 (1 in) / G 1 in | | 490 | 17 (0.67) | 50 | 20 (0.79) | | | | | | |
| | | | (19.29) | | | | | | | | | |
| | 15 (½ in.) / ½ in NPT | | 450 | 15.6 (0.61) | 27 | 15 (0.59) | | | | | | |
| | | | (17.72) | | | | | | | | | |

¹ Devices with terminal boxes made from aluminum.

² Devices with terminal boxes made from stainless steel.

³ Devices with 'Extended tower length' option or 'Pressure rating of sensor secondary housing' option.

⁴ Dimension WS: Width across flats specified in mm.

Tolerance for dimension L: +0 / -3 mm (+0 / -0.118 in)


... Flowmeter sensor

Dimensions for devices with remote mount design

Devices with meter tube nominal diameter DN 15 to 50 and flange DN 10 to 65

Sensor with wetted parts made from stainless steel.

All dimensions and weights are specified in mm (in) or kg (lb).

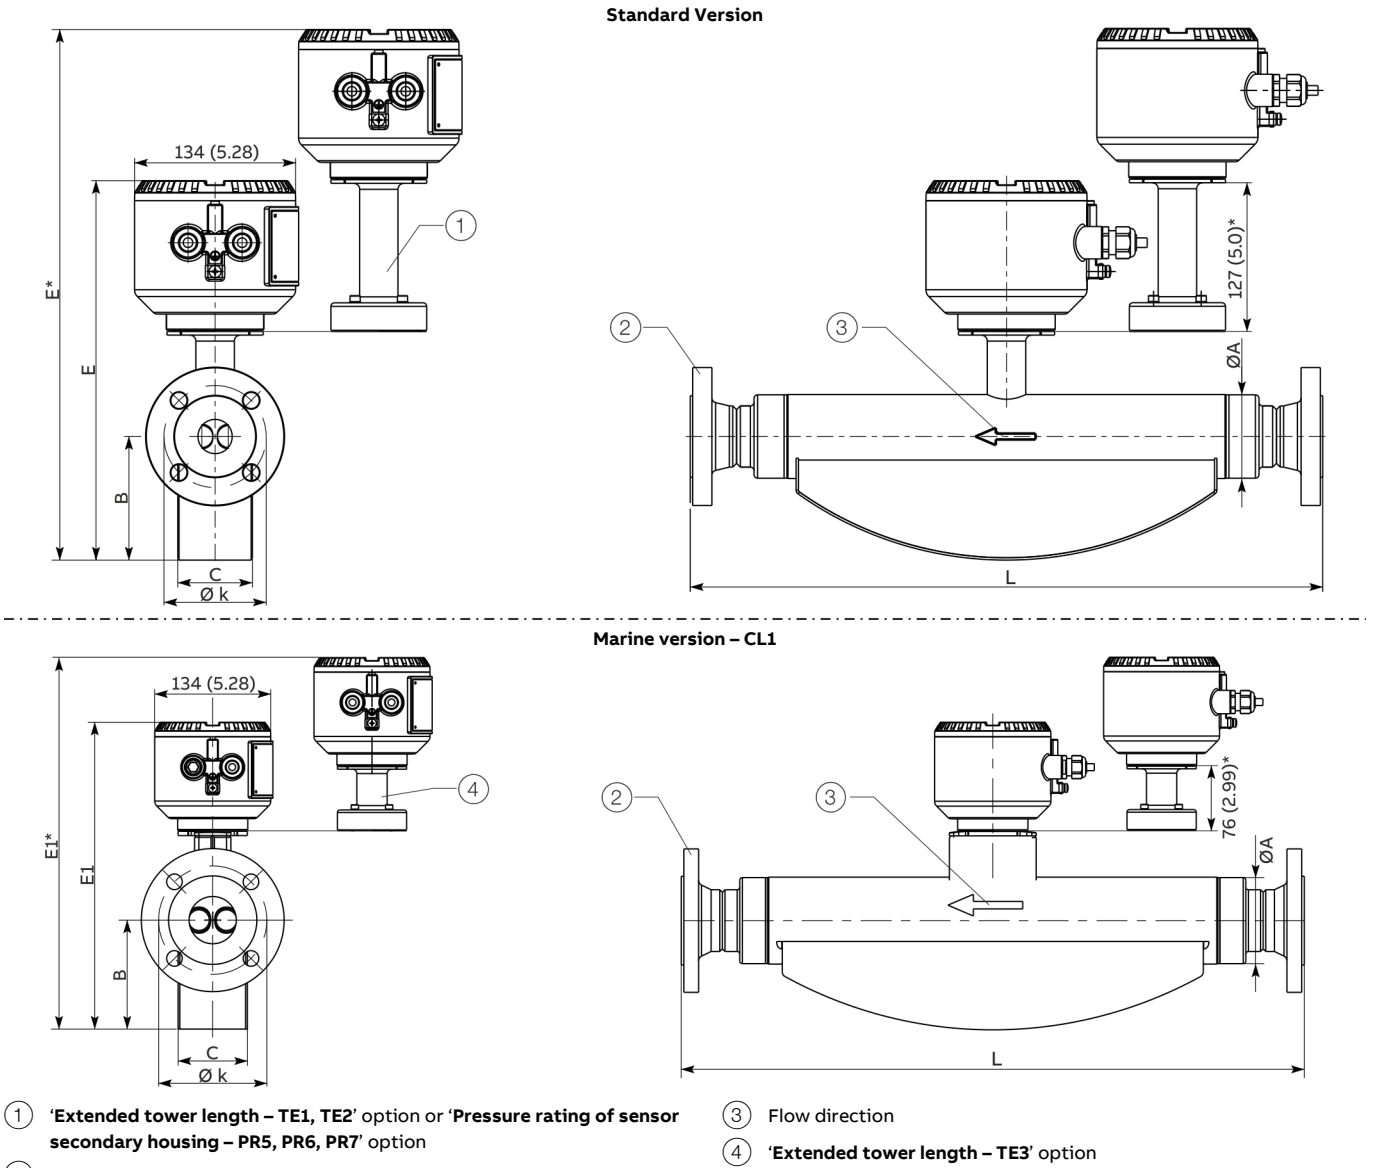

* Standard version: devices with 'Extended tower length – TE1, TE2' option or 'Pressure rating of sensor secondary housing' option

** Marine version – CL1: devices with 'Extended tower length – TE3' option

Figure 6: Remote mount design

Meter tube nominal diameter DN 15 (½ in)

| DN / process connection | | L | Ø k | Ø A | B | C | E | E1 | Weight max. |
|-------------------------|-----------------------|------------|------------|------------|----------|-----------|-----------------|----------------|-------------|
| 10 (¾ in) | PN 40 (EN 1092-1 B1) | 385 (15.2) | 60 (2.4) | 44.5 (1.8) | 80 (3.2) | 49 (1.93) | 283 (11.1) 410* | 283 (11.1) | 13 (28.7) |
| | JIS 10K | 385 (15.2) | 65 (2.6) | | | | (16.1*) | 357** (14.1**) | |
| | JIS 16K | 385 (15.2) | 65 (2.6) | | | | | | |
| | JIS 20K | 385 (15.2) | 65 (2.6) | | | | | | |
| 15 (½ in) | PN 40 (EN 1092-1 B1) | 385 (15.2) | 65 (2.6) | | | | | | |
| | PN 63 (EN 1092-1 B2) | 403 (15.9) | 75 (3.0) | | | | | | |
| | PN 100 (EN 1092-1 B2) | | | | | | | | |
| | CL150 (ASME B16.5) | 435 (17.1) | 60.5 (2.4) | | | | | | |
| | CL300 (ASME B16.5) | 421 (16.6) | 66.5 (2.6) | | | | | | |
| | CL600 (ASME B16.5) | | | | | | | | |
| | CL900 (ASME B16.5) | 421 (16.6) | 82.6 (3.3) | | | | | | |
| | CL1500 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 385 (15.2) | 70 (2.8) | | | | | | |
| | JIS 16K | 385 (15.2) | 70 (2.8) | | | | | | |
| JIS 20K | 385 (15.2) | 70 (2.8) | | | | | | | |
| 20 (¾ in) | PN 40 (EN 1092-1 B1) | 421 (16.6) | 75 (3.0) | | | | | | |
| | CL150 (ASME B16.5) | 421 (16.6) | 69.9 (2.8) | | | | | | |
| | JIS 10K | 421 (16.6) | 75 (3.0) | | | | | | |
| | JIS 16K | 421 (16.6) | 75 (3.0) | | | | | | |
| | JIS 20K | 421 (16.6) | 75 (3.0) | | | | | | |

... Flowmeter sensor

... Dimensions for devices with remote mount design

| Meter tube nominal diameter DN 25 (1 in) | | | | | | | | | |
|--|-----------------------|------------|--------------|-------------|------------|-----------|--------------|----------------|-------------|
| DN / process connection | | L | Ø k | Ø A | B | C | E | E1 | Weight max. |
| 20 (¾ in) | PN 40 (EN 1092-1 B1) | 576 (22.7) | 75 (3.0) | 69.5 (2.74) | 103 (4.06) | 62 (2.44) | 324 (12.8) | 324 (12.8) | 15 (33.1) |
| | CL150 (ASME B16.5) | 575 (22.6) | 69.9 (2.8) | | | | 451* (17.8*) | 398** (15.7**) | |
| | JIS 10K | 576 (22.7) | 75 (3.0) | | | | | | |
| | JIS 16K | 576 (22.7) | 75 (3.0) | | | | | | |
| | JIS 20K | 576 (22.7) | 75 (3.0) | | | | | | |
| 25 (1 in) | PN 40 (EN 1092-1 B1) | 525 (20.7) | 85 (3.3) | | | | | | |
| | PN 63 (EN 1092-1 B2) | 564 (22.2) | 100 (3.9) | | | | | | |
| | PN 100 (EN 1092-1 B2) | | | | | | | | |
| | CL150 (ASME B16.5) | 575 (22.6) | 79.2 (3.1) | | | | | | |
| | CL300 (ASME B16.5) | 576 (22.7) | 88.9 (3.5) | | | | | | |
| | CL600 (ASME B16.5) | | | | | | | | |
| | CL900 (ASME B16.5) | 576 (22.7) | 101.6 (4.0) | | | | | | |
| | CL1500 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 525 (20.7) | 90 (3.54) | | | | | | |
| | JIS 16K | 525 (20.7) | 90 (3.54) | | | | | | |
| JIS 20K | 525 (20.7) | 90 (3.54) | | | | | | | |
| 40 (1½ in) | PN 40 (EN 1092-1 B1) | 576 (22.7) | 110 (4.33) | | | | | | |
| | PN 63 (EN 1092-1 B2) | 572 (22.5) | 125 (4.92) | | | | | | |
| | PN 100 (EN 1092-1 B2) | | | | | | | | |
| | CL150 (ASME B16.5) | 576 (22.7) | 98.6 (3.88) | | | | | | |
| | CL300 (ASME B16.5) | 576 (22.7) | 114.3 (45.0) | | | | | | |
| | CL600 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 576 (22.7) | 105 (4.13) | | | | | | |
| JIS 16K | 576 (22.7) | 105 (4.13) | | | | | | | |
| JIS 20K | 576 (22.7) | 105 (4.13) | | | | | | | |

* Standard version: devices with 'Extended tower length – TE1, TE2' option or 'Pressure rating of sensor secondary housing' option

** Marine version – CL1: devices with 'Extended tower length – TE3' option

Tolerance for dimension L: +0 / -3 mm (+0 / -0.118 in)

Meter tube nominal diameter DN 50 (2 in)

| DN / process connection | | L | Ø k | Ø A | B | C | E | E1 | Weight max. |
|-------------------------|-----------------------|-------------|--------------|----------|------------|-----------|---------------|----------------|-------------|
| 40 (1½ in) | PN 40 (EN 1092-1 B1) | 763 (30) | 110 (4.33) | 99 (3.9) | 126 (4.96) | 80 (3.15) | 354 (13.9) | 354 (13.9) | 31 (68.3) |
| | PN 63 (EN 1092-1 B2) | 745 (29.33) | 125 (4.92) | | | | 481* (18.94*) | 428** (16.9**) | |
| | PN 100 (EN 1092-1 B2) | | | | | | | | |
| | CL150 (ASME B16.5) | 763 (30) | 98.6 (3.88) | | | | | | |
| | CL300 (ASME B16.5) | 756 (29.76) | 114.3 (4.5) | | | | | | |
| | CL600 (ASME B16.5) | | | | | | | | |
| | CL900 (ASME B16.5) | 780 (30.71) | 124 (4.88) | | | | | | |
| | CL1500 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 763 (30) | 105 (4.13) | | | | | | |
| | JIS 16K | 763 (30) | 105 (4.13) | | | | | | |
| JIS 20K | 763 (30) | 105 (4.13) | | | | | | | |
| 50 (2 in) | PN 40 (EN 1092-1 B1) | 715 (28.15) | 125 (4.92) | | | | | | |
| | PN 63 (EN 1092-1 B2) | 745 (29.3) | 135 (5.31) | | | | | | |
| | PN 100 (EN 1092-1 B2) | 745 (29.33) | 145 (5.71) | | | | | | |
| | CL150 (ASME B16.5) | 715 (28.15) | 120.7 (4.75) | | | | | | |
| | CL300 (ASME B16.5) | 763 (30) | 127 (5.0) | | | | | | |
| | CL600 (ASME B16.5) | 773 (30.43) | 127 (5.0) | | | | | | |
| | CL900 (ASME B16.5) | 790 (31.1) | 165.1 (6.5) | | | | | | |
| | CL1500 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 715 (28.15) | 120 (4.72) | | | | | | |
| | JIS 16K | 715 (28.15) | 120 (4.72) | | | | | | |
| JIS 20K | 715 (28.15) | 120 (4.72) | | | | | | | |
| 65 (2½ in) | PN 40 (EN 1092-1 B1) | 763 (30) | 145 (5.71) | | | | | | |
| | CL150 (ASME B16.5) | 756 (29.76) | 139.7 (5.5) | | | | | | |
| | CL900 (ASME B16.5) | 800 (31.5) | 190.5 (7.5) | | | | | | |
| | CL1500 (ASME B16.5) | | | | | | | | |
| | JIS 10K | 763 (30) | 140 (5.51) | | | | | | |
| | JIS 16K | 763 (30) | 140 (5.51) | | | | | | |
| JIS 20K | 763 (30) | 140 (5.51) | | | | | | | |

* Standard version: devices with 'Extended tower length – TE1, TE2' option or 'Pressure rating of sensor secondary housing' option

** Marine version – CL1: devices with 'Extended tower length – TE3' option

Tolerance for dimension L: +0 / -3 mm (+0 / -0.118 in)

... Flowmeter sensor

... Dimensions for devices with remote mount design

Devices with meter tube nominal diameter DN 80 and flange DN 65 to 100

Sensor with wetted parts made from stainless steel.

All dimensions and weights are specified in mm (in) or kg (lb).

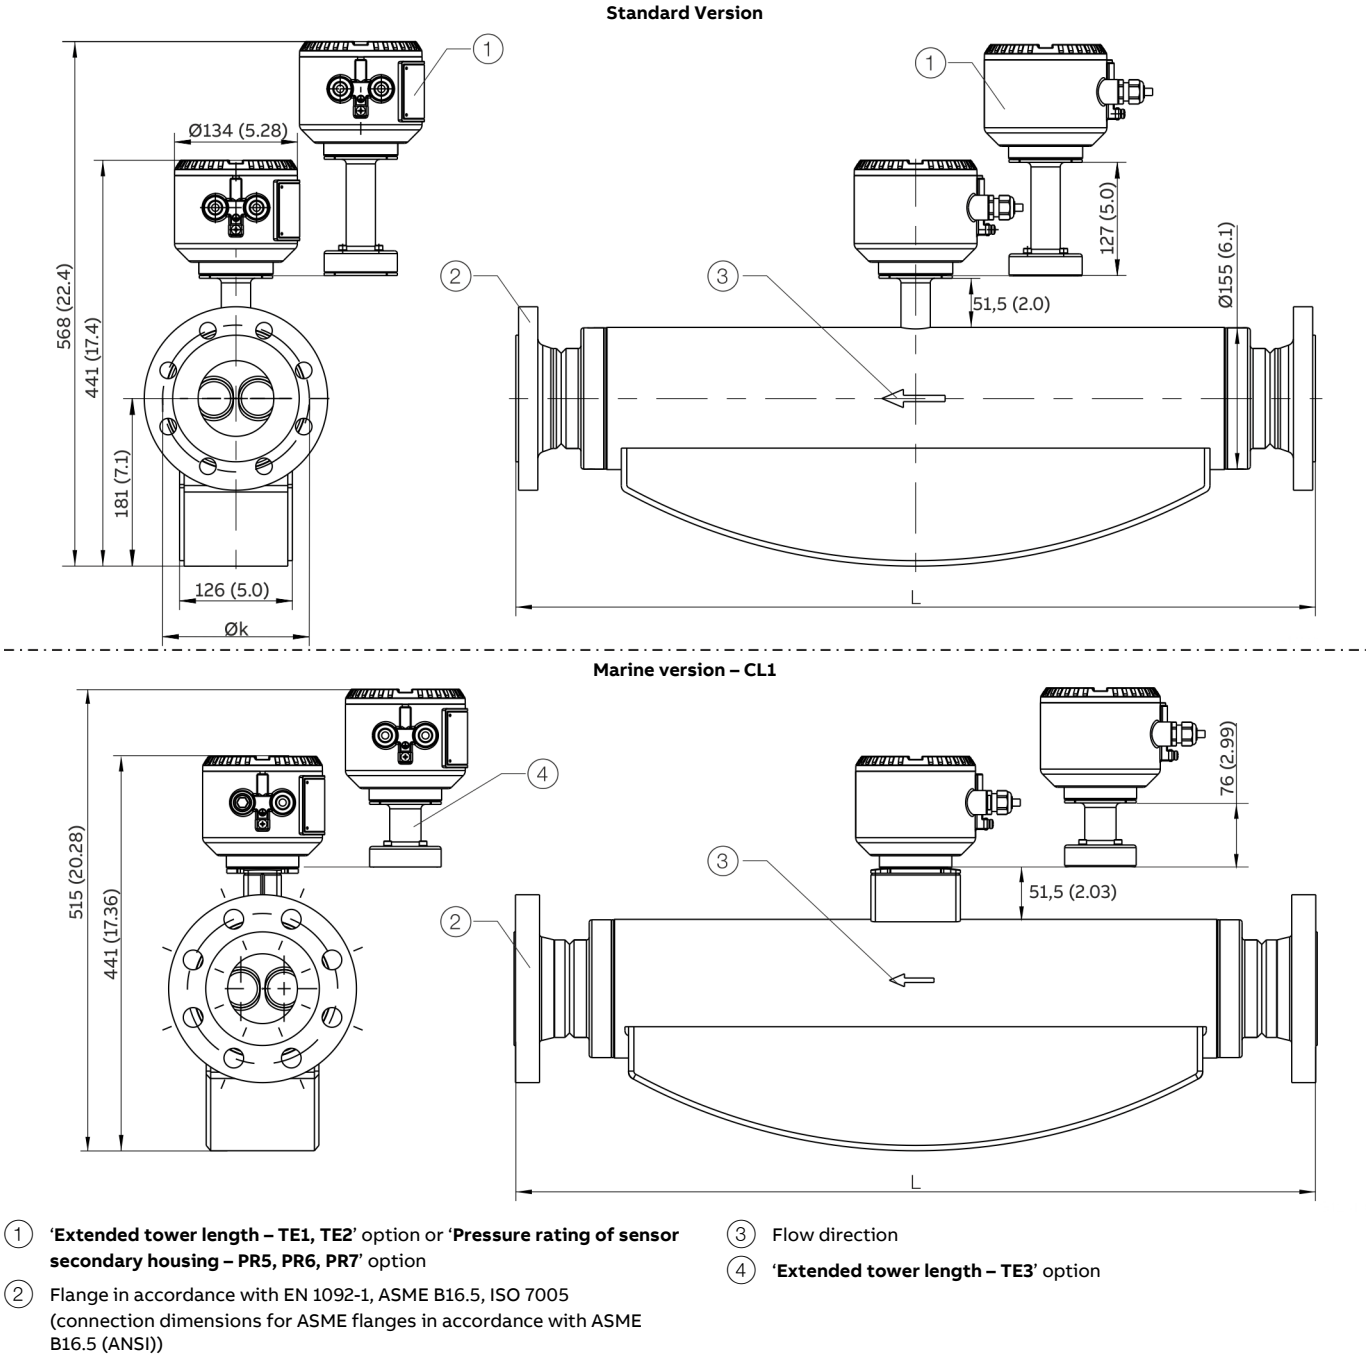


Figure 7: Remote mount design

| Meter tube nominal diameter DN 80 (3 in) | | | | |
|---|-----------------------|----------------------|--------------|--------------------|
| DN / process connection | | L | Ø k | Weight max. |
| 65 (2½ in) | PN 16 (EN 1092-1 B1) | —* | —* | —* |
| | PN 40 (EN 1092-1 B1) | 910 (35.83) | 145 (5.71) | 74 (163.1) |
| | PN 63 (EN 1092-1 B2) | | 160 (6.3) | 78 (172.0) |
| | PN 100 (EN 1092-1 B2) | | 170 (6.69) | 82 (180.8) |
| | CL150 (ASME B16.5) | 920 (36.22) | 123 (4.48) | 74 (163.1) |
| | CL300 (ASME B16.5) | 920 (36.22) | 149.4 (5.88) | 76 (167.6) |
| | CL600 (ASME B16.5) | | | 77 (169.8) |
| | CL900 (ASME B16.5) | 965 (37.99) | 190.5 (7.5) | 94 (207.2) |
| | CL1500 (ASME B16.5) | | | |
| | JIS 10K | 910 (35.83) | 140 (5.5) | 74 (163.1) |
| | JIS 16K | 910 (35.83) | 140 (5.5) | 74 (163.1) |
| | JIS 20K | 920 (36.22) | 140 (5.5) | 74 (163.1) |
| | 80 (3 in) | PN 16 (EN 1092-1 B1) | 870 (34.25) | 160 (6.30) |
| PN 40 (EN 1092-1 B1) | | | | 75 (165.4) |
| PN 63 (EN 1092-1 B2) | | 910 (35.83) | 170 (6.69) | 79 (174.2) |
| PN 100 (EN 1092-1 B2) | | | 180 (7.09) | 85 (187.4) |
| CL150 (ASME B16.5) | | 880 (34.65) | 152.4 (6.00) | 76 (165.4) |
| CL300 (ASME B16.5) | | 895 (35.24) | 168.1 (6.62) | 79 (174.2) |
| CL600 (ASME B16.5) | | 920 (36.22) | | 82 (180.8) |
| CL900 (ASME B16.5) | | 1100 (43.31) | 190.5 (7.50) | 94 (207.2) |
| CL1500 (ASME B16.5) | | 1300 (51.18) | 203.2 (8.00) | 106 (233.7) |
| JIS 10K | | 870 (34.25) | 150 (5.91) | 75 (165.4) |
| JIS 16K | | 870 (34.25) | 150 (5.91) | 75 (165.4) |
| JIS 20K | | 910 (35.83) | 150 (5.91) | 75 (165.4) |
| 100 (4 in) | | PN 16 (EN 1092-1 B1) | 875 (34.45) | 180 (7.09) |
| | PN 40 (EN 1092-1 B1) | | 190 (7.48) | 76 (167.5) |
| | PN 63 (EN 1092-1 B2) | 1060 (41.73) | 200 (7.87) | 86 (189.6) |
| | PN 100 (EN 1092-1 B2) | 1080 (42.52) | 210 (8.27) | 94 (207.2) |
| | CL150 (ASME B16.5) | 880 (34.65) | 190.5 (7.50) | 77 (169.8) |
| | CL300 (ASME B16.5) | 1075 (42.32) | 200.2 (7.88) | 91 (200.6) |
| | CL600 (ASME B16.5) | 1100 (43.31) | 215.9 (8.50) | 101 (222.7) |
| | CL900 (ASME B16.5) | 1130 (44.49) | 234.9 (9.25) | 111 (244.7) |
| | CL1500 (ASME B16.5) | 1150 (45.28) | 241.3 (9.50) | 126 (277.8) |
| | JIS 10K | 1060 (41.7) | 175 (6.9) | 86 (189.6) |
| | JIS 16K | 1060 (41.7) | 175 (6.9) | 85 (187.4) |
| | JIS 20K | 1060 (41.7) | 175 (6.9) | 85 (187.4) |

* On request

Tolerance for dimension L: +0 / -3 mm (+0 / -0.118 in)

... Flowmeter sensor

... Dimensions for devices with remote mount design

Devices with meter tube nominal diameter DN 100 and flange DN 80 to 150

Sensor with wetted parts made from stainless steel.

All dimensions and weights are specified in mm (in) or kg (lb).

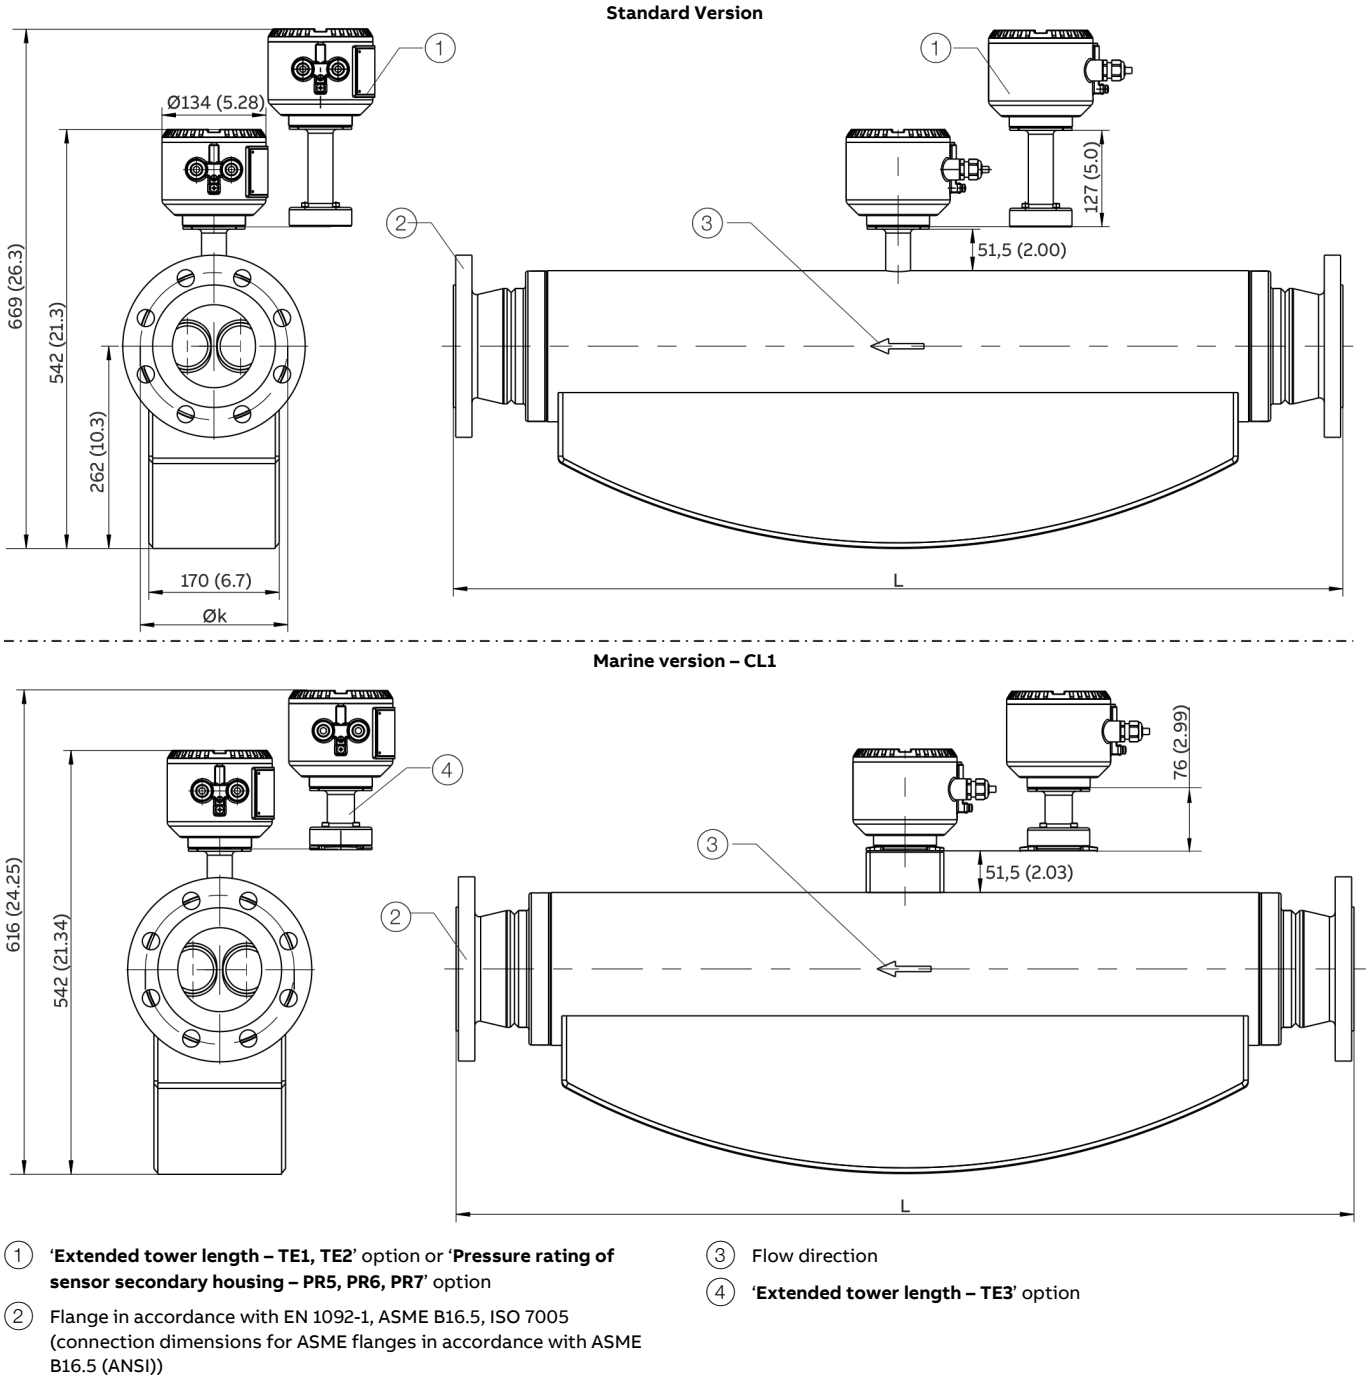


Figure 8: Remote mount design

| Meter tube nominal diameter DN 100 (4 in) | | | | |
|--|-----------------------|----------------------------|----------------------------|--------------------|
| DN / process connection | | L | Ø k | Weight max. |
| 80 (3 in) | PN 16 (EN 1092-1 B1) | 1222 (48.11) ¹⁾ | 160 (6.30) | 126 (278) |
| | PN 40 (EN 1092-1 B1) | | | 126 (278) |
| | PN 63 (EN 1092-1 B2) | 1234 (48.58) ¹⁾ | 170 (6.69) | 130 (287) |
| | PN 100 (EN 1092-1 B2) | | 180 (7.09) | 132 (291) |
| | CL150 (ASME B16.5) | 1244 (48.98) ¹⁾ | 152.4 (6.00) | 127 (280) |
| | CL300 (ASME B16.5) | | 168.1 (6.62) | 135 (298) |
| | CL600 (ASME B16.5) | | 168.1 (6.62) | 138 (304) |
| | CL900 (ASME B16.5) | 1470 (57.87) ¹⁾ | 190.5 (7.50) | 141 (311) |
| | CL1500 (ASME B16.5) | 1500 (59.05) ¹⁾ | 203.2 (8.00) | 153 (337) |
| | JIS 10K | 1275 (50.20) ¹⁾ | 150 (5.91) | 123 (271) |
| | JIS 16K | 1275 (50.20) ¹⁾ | 150 (5.91) | 123 (271) |
| | JIS 20K | 1275 (50.20) ¹⁾ | 150 (5.91) | 123 (271) |
| | 100 (4 in) | PN 16 (EN 1092-1 B1) | 1123 (44.21) ²⁾ | 180 (7.09) |
| PN 40 (EN 1092-1 B1) | | 1146 (45.12) ²⁾ | 190 (7.48) | 126 (278) |
| PN 63 (EN 1092-1 B2) | | 1304 (51.34) ¹⁾ | 138 (5.43) | 133 (293) |
| PN 100 (EN 1092-1 B2) | | 1334 (52.52) ¹⁾ | 150 (5.91) | 141 (311) |
| CL150 (ASME B16.5) | | 1145 (45.08) ²⁾ | 190.5 (7.50) | 127 (280) |
| CL300 (ASME B16.5) | | 1320 (51.97) ²⁾ | 200.2 (7.88) | 139 (306) |
| CL600 (ASME B16.5) | | 1336 (52.60) ³⁾ | 215.9 (8.50) | 141 (311) |
| CL900 (ASME B16.5) | | 1380 (54.33) ¹⁾ | 234.9 (9.25) | 160 (353) |
| CL1500 (ASME B16.5) | | 1400 (55.12) ¹⁾ | 241.3 (9.50) | 174 (384) |
| JIS 10K | | 1150 (45.28) ¹⁾ | 175 (6.89) | 126 (278) |
| JIS 16K | | 1150 (45.28) ¹⁾ | 175 (6.89) | 126 (278) |
| JIS 20K | | 1150 (45.28) ¹⁾ | 175 (6.89) | 126 (278) |
| 150 (6 in) | | PN 16 (EN 1092-1 B1) | 1255 (49.41) ²⁾ | 240 (9.44) |
| | PN 40 (EN 1092-1 B1) | 1297 (51.06) ¹⁾ | 250 (9.84) | 139 (306) |
| | CL150 (ASME B16.5) | 1252 (49.29) ³⁾ | 241.3 (9.50) | 137 (302) |
| | CL600 (ASME B16.5) | 1400 (55.12) ¹⁾ | – | – |
| | JIS 10K | 1300 (51.18) ¹⁾ | 240 (9.44) | 130 (287) |
| | JIS 16K | 1300 (51.18) ¹⁾ | 240 (9.44) | 130 (287) |
| | JIS 20K | 1308 (51.50) ¹⁾ | 240 (9.44) | 130 (287) |

L dimension tolerances

- 1) +0 / -15 mm (+0 / -0.59 in)
2) +0 / -5 mm (+0 / -0.20 in)
3) +0 / -8 mm (+0 / -0.31 in)

... Flowmeter sensor

... Dimensions for devices with remote mount design

Devices with meter tube nominal diameter DN 150 and flange DN 100 to DN 200

Sensor with wetted parts made from stainless steel.

All dimensions and weights are specified in mm (in) or kg (lb).

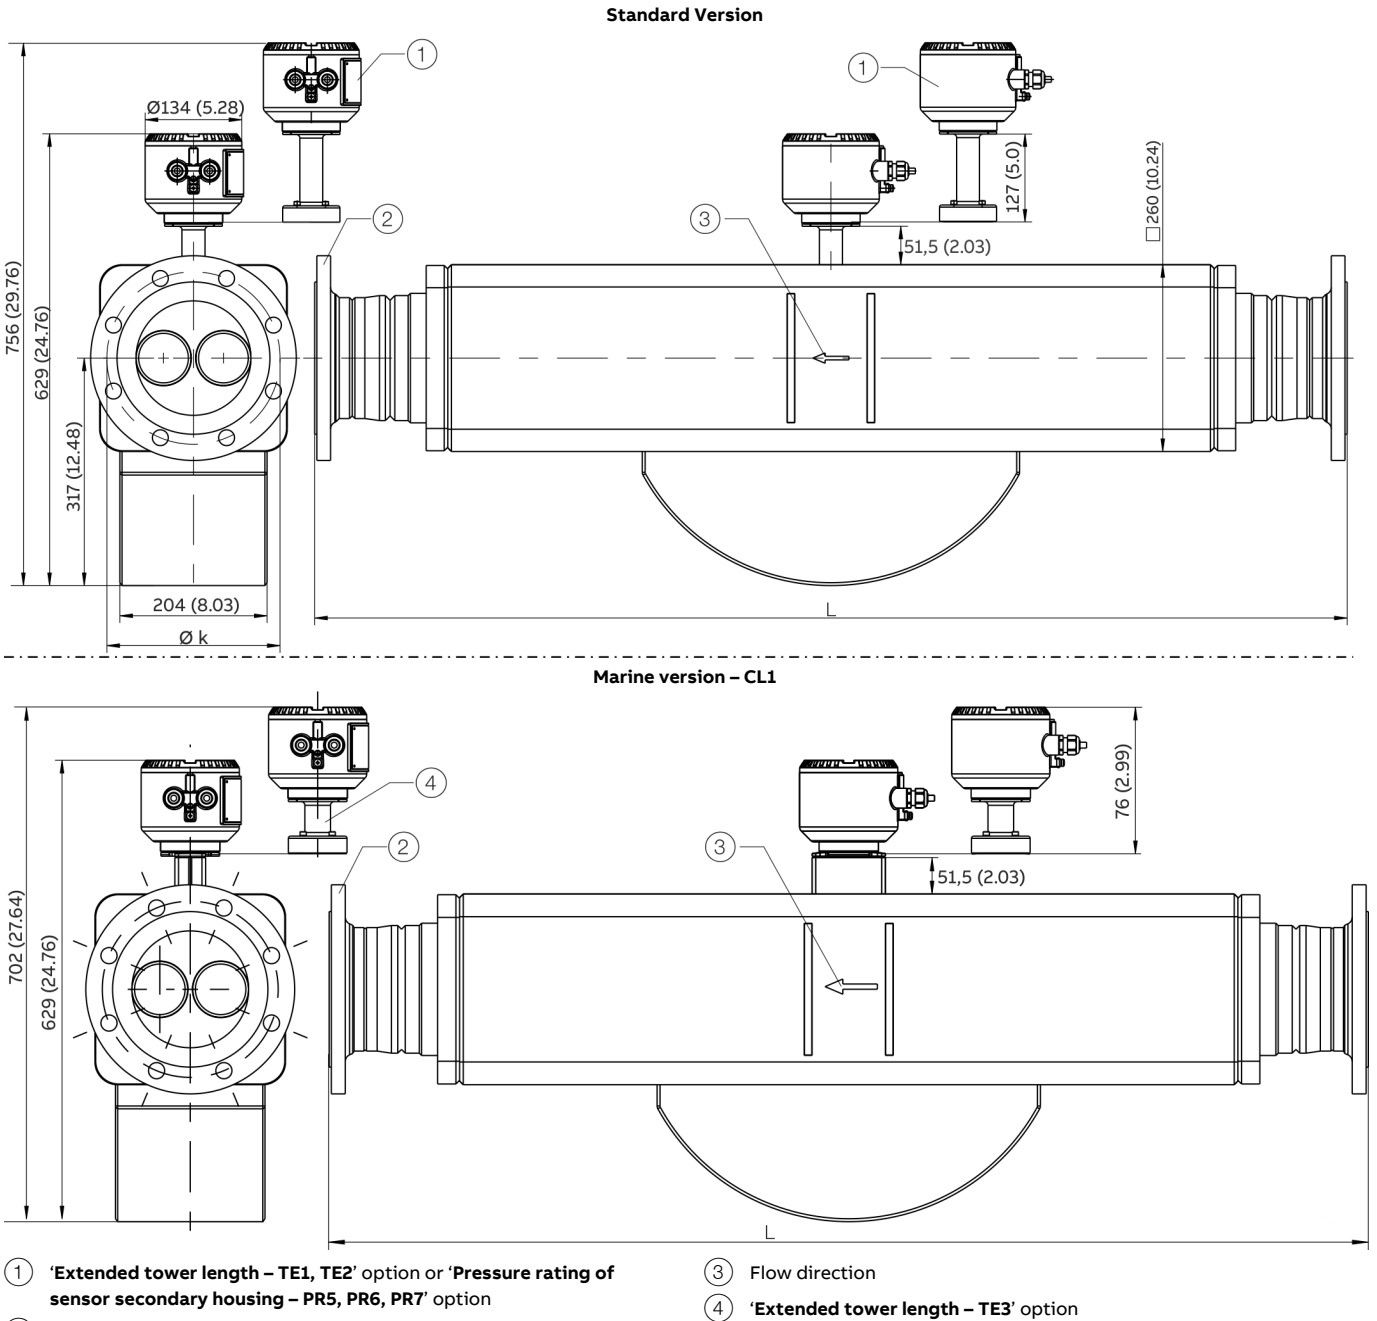


Figure 9: Remote mount design

| Meter tube nominal diameter DN 150 (6 in) | | | | |
|--|----------------------|----------------------------|---------------|--------------------|
| DN / process connection | | L | Ø k | Weight max. |
| 100 (4 in) | PN 16 (EN 1092-1 B1) | 1569 (61.77) ¹⁾ | 180 (7.09) | 175 (386) |
| | PN 40 (EN 1092-1 B1) | 1599 (62.95) ¹⁾ | 190 (7.48) | 179 (395) |
| | CL150 (ASME B16.5) | 1630 (64.17) ¹⁾ | 190.5 (7.50) | 182 (401) |
| | CL300 (ASME B16.5) | 1650 (64.96) ¹⁾ | 200.2 (7.88) | 188 (414) |
| | CL600 (ASME B16.5) | 1675 (65.94) ¹⁾ | 215.9 (8.50) | 198 (437) |
| | CL900 (ASME B16.5) | 1705 (67.13) ¹⁾ | 234.9 (9.25) | 208 (459) |
| | CL1500 (ASME B16.5) | 1725 (67.91) ¹⁾ | 241.3 (9.50) | 223 (492) |
| | JIS 10K | 1485 (58.46) ¹⁾ | 175 (6.89) | 179 (395) |
| | JIS 16K | 1485 (58.46) ¹⁾ | 185 (7.28) | 181 (399) |
| | JIS 20K | 1485 (58.46) ¹⁾ | 185 (7.28) | 181 (399) |
| 150 (6 in) | PN 16 (EN 1092-1 B1) | 1421 (55.94) ¹⁾ | 240 (9.45) | 178 (392) |
| | PN 40 (EN 1092-1 B1) | 1459 (57.44) ²⁾ | 250 (9.84) | 186 (410) |
| | CL150 (ASME B16.5) | 1482 (58.35) ³⁾ | 241.3 (9.50) | 185 (408) |
| | CL300 (ASME B16.5) | 1503 (59.17) ³⁾ | 269.7 (10.62) | 203 (448) |
| | CL600 (ASME B16.5) | 1555 (61.22) ¹⁾ | 292.1 (11.50) | 225 (496) |
| | CL900 (ASME B16.5) | 1605 (63.19) ¹⁾ | 317.5 (12.5) | 249 (549) |
| | CL1500 (ASME B16.5) | 1665 (65.55) ¹⁾ | - | 291 (642) |
| | JIS 10K | 1425 (56.10) ¹⁾ | 240 (9.45) | 186 (410) |
| | JIS 16K | 1456 (57.32) ¹⁾ | 260 (6.30) | 187 (412) |
| | JIS 20K | 1464 (57.64) ¹⁾ | 260 (6.30) | 187 (412) |
| 200 (8 in) | PN 16 (EN 1092-1 B1) | -* | -* | -* |
| | PN 40 (EN 1092-1 B1) | 1637 (64.45) ¹⁾ | 320 (12.6) | 209 (461) |
| | CL150 (ASME B16.5) | 1650 (64.96) ¹⁾ | 298.5 (11.75) | 204 (450) |
| | CL300 (ASME B16.5) | 1664 (65.51) ³⁾ | 330.2 (13.0) | 229 (505) |
| | CL600 (ASME B16.5) | 1730 (68.11) ¹⁾ | - | - |
| | JIS10K | 1583 (62.32) ¹⁾ | 290 (11.42) | 209 (461) |
| | JIS 16K | 1615 (63.58) ¹⁾ | 305 (12.01) | 210 (463) |
| | JIS 20K | 1623 (63.90) ¹⁾ | 305 (12.01) | 210 (463) |

* On request

L dimension tolerances

- 1) +0 / -20 mm (+0 / -0.79 in)
- 2) +0 / -5 mm (+0 / -0.20 in)
- 3) +0 / -8 mm (+0 / -0.31 in)


... Flowmeter sensor

... Dimensions for devices with remote mount design

Devices DN 15 to 150 in NAMUR standard installation lengths (order option S5, S7)

Sensor with wetted parts made from stainless steel.

All dimensions and weights are specified in mm (in) or kg (lb).

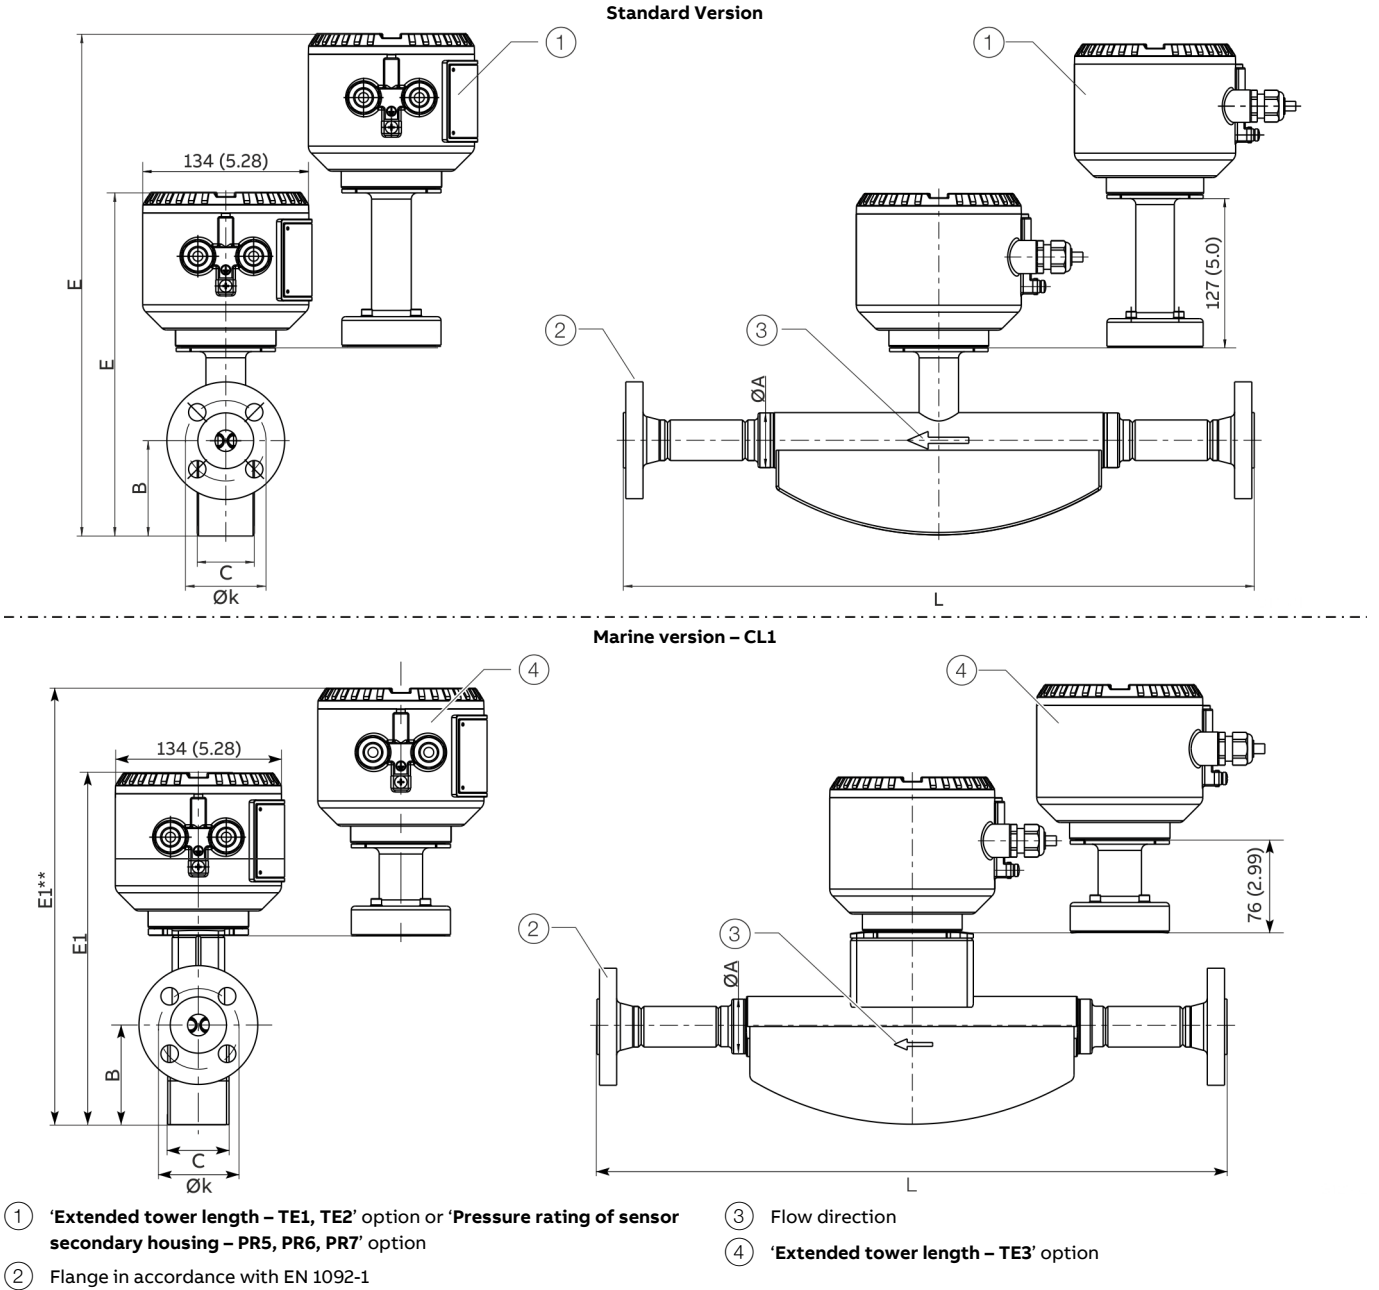

* Standard design: Devices with 'Extended tower length - TE1, TE2' option or 'Pressure rating of sensor secondary housing' option

** Marine version - CL1: Devices with 'Extended tower length - TE3' option

Figure 10: Remote mount design

Devices DN 15 to 150 in NAMUR standard installation lengths

| Meter tube | Process connection | L | Ø k | Ø A | B | C | E | E1 | Approximate weight |
|---------------------|-----------------------|----------------------------|------------|-------------|-------------|------------|------------------------------|------------------------------|--------------------|
| EN 1092-1 B1 | | | | | | | | | |
| DN 15 (½ in) | DN 15 (½ in) / PN 40 | 510 (20.08) ¹⁾ | 60 (2.4) | 44.5 (1.8) | 77 (3.0) | 46 (1.8) | 283 (11.1) 410* (16.1*) | 283 (11.1) 357** (14.1**) | 13.5 (29.8) |
| DN 25 (1 in) | DN 25 (1 in) / PN 40 | 600 (23.62) ¹⁾ | 75 (3.0) | 69.5 (2.74) | 103 (4.06) | 62 (2.44) | 324 (12.8) 451* (17.8*) | 324 (12.8) 398** (15.7**) | 15 (33.1) |
| DN 50 (1 in) | DN 50 (1 in) / PN 40 | 715 (28.15) ¹⁾ | 125 (4.92) | 99 (3.9) | 125 (4.92) | 80 (3.15) | 354 (13.9) 481* (18.94*) | 354 (13.9) 428** (16.9**) | 31 (68.3) |
| DN 80 (3 in) | DN 80 (3 in) / PN 40 | 915 (36.02) ¹⁾ | 160 (6.30) | 155 (6.1) | 183 (7.2) | 123 (4.84) | 445 (17.52) 572* (22.52*) | – | 74 (163) |
| DN 100 (4 in) | DN 100 (4 in) / PN 16 | 1400 (55.12) ²⁾ | 180 (7.09) | 195 (7.68) | 261 (10.28) | 168 (6.61) | 541 (21.3) 668* (26.3*) | – | 123 (271) |
| DN 150 (6 in) | DN 150 (6 in) / PN 16 | 1700 (66.93) ³⁾ | 240 (9.45) | 260 (10.24) | 320 (12.6) | 205 (8.07) | 630 (24.8) 757* (29.8*) | – | 178 (392) |

* Standard design: Devices with 'Extended tower length – TE1, TE2' option or 'Pressure rating of sensor secondary housing' option

** Marine version – CL1: Devices with 'Extended tower length – TE3' option

L dimension tolerances

- 1) +0 / –3 mm (+0 / –0.118 in)
- 2) +0 / –5 mm (+0 / –0.20 in)
- 3) +0 / –20 mm (+0 / –0.79 in)


... Flowmeter sensor

... Dimensions for devices with remote mount design

Devices with meter tube nominal diameter DN 15 to 80 and connections in accordance with SMS 1145, DIN 11851, DIN 32676, DIN ISO 228, ASME BPE and ASME B 1.20.1

Sensor with wetted parts made from stainless steel.

All dimensions and weights are specified in mm (in) or kg (lb).

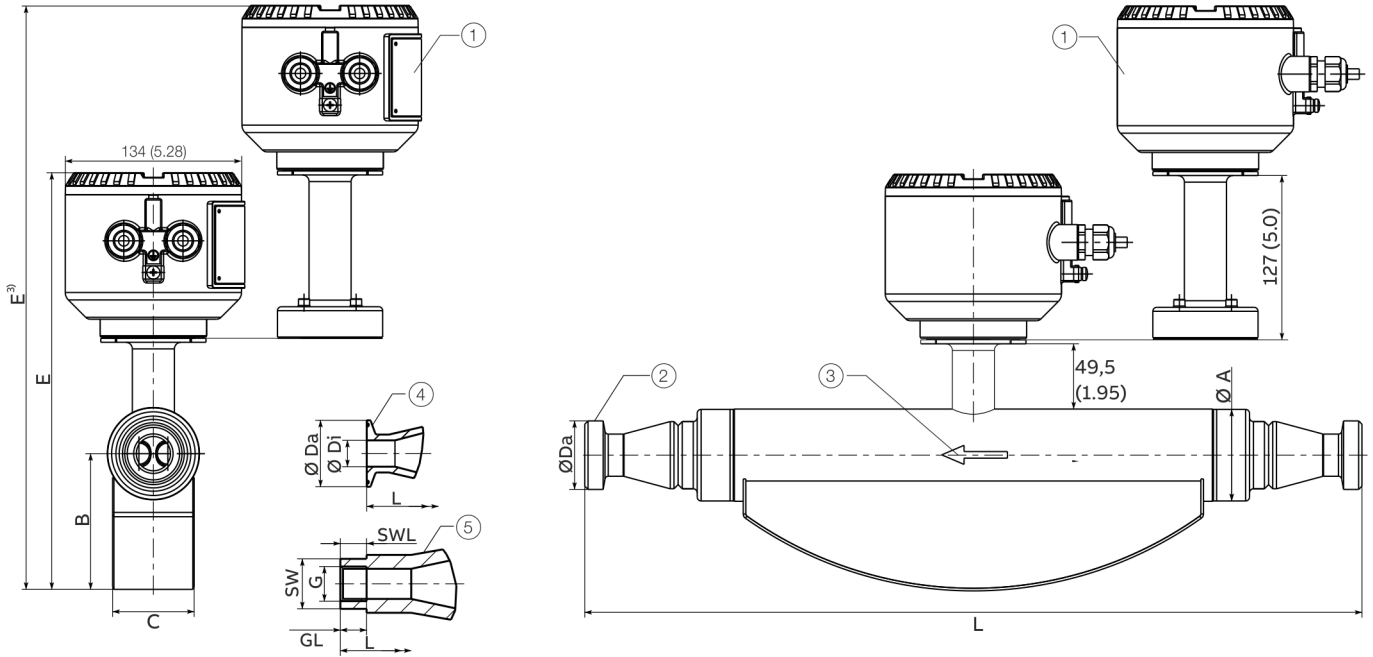

- ① 'Extended tower length – TE1, TE2' option or 'Pressure rating of sensor secondary housing – PR5, PR6, PR7' option
- ② Threaded spuds in accordance with DIN 11851 and SMS 1145
- ③ Flow direction
- ④ Clamping connection in accordance with DIN 32676 and ASME BPE
- ⑤ Female thread connection in accordance with DIN ISO 228 and ASME B 1.20.1

Figure 11: Remote mount design

Process connection in accordance with SMS 1145 meter tube nominal diameter DN 25 to 80 (1 to 3 in)

| Meter tube DN | Process connection | | L | Ø DA | Ø Di | Ø A | B | C | E | Approximate weight | |
|---------------|--------------------|----|------------|------------|-------------|--------|--------|--------|--------------------|--------------------|-------------------|
| | DN | PN | | | | | | | | Aluminum* | Stainless steel** |
| 25 (1 in) | 25 (1 in) | 6 | 590 (23.2) | RD 40x½ in | 22.6 (0.89) | 69.5 | 103 | 62 | 317 / 444*** | 11 / 12*** | 14 / 15*** |
| | 40 (1 ½ in) | | | RD 60x½ in | 38 (1.50) | (2.74) | (4.06) | (2.44) | (12.48 / 17.48***) | (24 / 27***) | (31 / 33***) |
| 50 (2 in) | 40 (1 ½ in) | 6 | 763 (30.0) | RD 60x½ in | 35.5 (1.40) | 99 | 125 | 80 | 354 / 481*** | 27 / 28*** | 30 / 31*** |
| | 50 (2 in) | | 740 (29.1) | RD 70x½ in | 48.5 (1.91) | (3.46) | (4.92) | (3.15) | (13.94 / 18.94***) | (60 / 62***) | (66 / 68***) |
| | 65 (2 ½ in) | | | RD 85x½ in | 60.5 (2.38) | | | | | | |
| 80 (3 in) | 65 (2 ½ in) | | 990 (39.0) | RD 85x½ in | 60.5 (2.38) | 155 | 183 | 123 | 445 / 572*** | 68 / 69*** | 71 / 72*** |
| | 80 (3 in) | | 940 (37.0) | RD 98x¾ in | 72.6 (2.86) | (6.10) | (7.20) | (4.84) | (17.52 / 22.52***) | (150 / 152***) | (157 / 159***) |

* Devices with terminal boxes made from aluminum.

** Devices with terminal boxes made from stainless steel.

*** Devices with 'Extended tower length' option or 'Pressure rating of sensor secondary housing' option.

Process connection in accordance with DIN 11851 meter tube nominal diameter DN 15 to 80 (½ to 3 in.)

| Meter tube DN | Process connection | | L | Ø DA | Ø Di | Ø A | B | C | E | Approximate weight | | | | | | | |
|------------------|--------------------|------------|------------|-------------|------------|-----------|-----------|-----------|--------------|--------------------|-------------------|--------|--------------------|--------------------|--------------------|----------------|----------------|
| | DN | PN | | | | | | | | Aluminum* | Stainless steel** | | | | | | |
| 15 (½ in) | 10 (¾ in) | 40 | 413 (16.3) | RD 28x½ in | 10 (0.39) | 44.5 | 77 (3.03) | 46 (1.81) | 278 / 405*** | 9 / 10*** | 12 / 13*** | | | | | | |
| | 15 (½ in) | | | RD 34x½ in | 16 (0.63) | | | | | | | (1.75) | (10.94 / 15.94***) | (20 / 22***) | (27 / 29***) | | |
| | 20 (¾ in) | | | RD 44x½ in | 20 (0.79) | | | | | | | | | | | | |
| 25 (1 in) | 20 (¾ in) | 590 (23.2) | 590 (23.2) | RD 44x½ in | 20 (0.79) | 69.5 | 103 | 62 | 317 / 444*** | 11 / 12*** | 14 / 15*** | | | | | | |
| | 25 (1 in) | | | RD 52x½ in | 26 (1.02) | | | | | | | (2.74) | (4.06) | (2.44) | (12.48 / 17.48***) | (24 / 27***) | (31 / 33***) |
| | 40 (1 ½ in) | | | RD 65x½ in | 38 (1.5) | | | | | | | | | | | | |
| 50 (2 in) | 40 (1 ½ in) | 763 (30.0) | 763 (30.0) | RD 65x½ in | 38 (1.5) | 99 (3.46) | 125 | 80 | 354 / 481*** | 27 / 28*** | 30 / 31*** | | | | | | |
| | 50 (2 in) | | | RD 78x½ in | 50 (1.97) | | | | | | | (4.92) | (3.15) | (13.94 / 18.94***) | (60 / 62***) | (66 / 68***) | |
| | 65 (2 ½ in) | | | RD 95x½ in | 66 (2.6) | | | | | | | | | | | | |
| 80 (3 in) | 65 (2 ½ in) | 990 (39.0) | 990 (39.0) | RD 95x½ in | 66 (2.6) | 155 | 183 | 123 | 445 / 572*** | 68 / 69*** | 71 / 72*** | | | | | | |
| | 80 (3 in) | | | RD 110x¾ in | 81 (3.19) | | | | | | | (6.10) | (7.20) | (4.84) | (17.52 / 22.52***) | (150 / 152***) | (157 / 159***) |
| | 100 (4 in) | | | RD 130x¾ in | 100 (3.94) | | | | | | | | | | | | |

Process connection in accordance with DIN 32676 meter tube nominal diameter DN 15 to 80 (½ to 3 in.)

| Meter tube DN | Process connection | | L | Ø DA | Ø Di | Ø A | B | C | E | Approximate weight | | | | | | | |
|------------------|--------------------|------------|------------|-------------|------------|------|-----------|--------------|--------------|--------------------|-------------------|--------------------|--------------|--------------|--------------------|----------------|----------------|
| | DN | PN | | | | | | | | Aluminum* | Stainless steel** | | | | | | |
| 15 (½ in) | 10 (¾ in) | 40 | 413 (16.3) | 34 (1.34) | 10 (0.39) | 44.5 | 77 (3.03) | 46 (1.81) | 278 / 405*** | 9 / 10*** | 12 / 13*** | | | | | | |
| | 15 (½ in) | | | 16 (0.63) | (1.75) | | | | | | | (10.94 / 15.94***) | (20 / 22***) | (27 / 29***) | | | |
| | 20 (¾ in) | | | 20 (0.79) | | | | | | | | | | | | | |
| 25 (1 in) | 20 (¾ in) | 590 (23.2) | 590 (23.2) | 20 (0.79) | 20 (0.79) | 69.5 | 103 | 62 | 317 / 444*** | 11 / 12*** | 14 / 15*** | | | | | | |
| | 25 (1 in) | | | 50.5 (1.99) | 26 (1.02) | | | | | | | (2.74) | (4.06) | (2.44) | (12.48 / 17.48***) | (24 / 27***) | (31 / 33***) |
| | 40 (1 ½ in) | | | 38 (1.5) | | | | | | | | | | | | | |
| 50 (2 in) | 40 (1 ½ in) | 763 (30.0) | 763 (30.0) | 38 (1.5) | 99 (3.46) | 125 | 80 | 354 / 481*** | 27 / 28*** | 30 / 31*** | | | | | | | |
| | 50 (2 in) | | | 25 | 740 (29.1) | | | | | | 64 (2.52) | 50 (1.97) | (4.92) | (3.15) | (13.94 / 18.94***) | (60 / 62***) | (66 / 68***) |
| | 65 (2 ½ in) | | | 91 (3.58) | 66 (2.6) | | | | | | | | | | | | |
| 80 (3 in) | 65 (2 ½ in) | 10 | 950 (37.4) | 66 (2.6) | 155 | 183 | 123 | 445 / 572*** | 68 / 69*** | 71 / 72*** | | | | | | | |
| | 80 (3 in) | | | 910 (35.83) | 106 (4.17) | | | | | | 81 (3.19) | (6.10) | (7.20) | (4.84) | (17.52 / 22.52***) | (150 / 152***) | (157 / 159***) |
| | 100 (4 in) | | | 119 (4.69) | 100 (3.94) | | | | | | | | | | | | |

* Devices with terminal boxes made from aluminum.

** Devices with terminal boxes made from stainless steel.

*** Devices with 'Extended tower length' option or 'Pressure rating of sensor secondary housing' option.

Tolerance for dimension L: +0 / -3 mm (+0 / -0.118 in)

... Flowmeter sensor

... Dimensions for devices with remote mount design

| Dimensions for sensors featuring meter tubes with nominal diameter DN 15 to 80 (½ to 3 in.) and process connection in accordance with ASME BPE | | | | | | | | | | | | |
|--|--------------------|----|-------------|--------------|-------------|-----------|-----------|-----------|-------------------------------|---------------------------|------------------------------|--|
| Meter tube | Process connection | | L | Ø DA | Ø Di | Ø A | B | C | E | Approximate weight | | |
| DN | DN | PN | | | | | | | | Aluminum ¹ | Stainless steel ² | |
| 15 (½ in) | ¾ in-Type A | 10 | – | – | – | 44.5 | 77 (3.03) | 46 (1.81) | 278 / 405 ³ | 9 / 10 ³ | 12 / 13 ³ | |
| | ½ in-Type A | | 433 (17.05) | 25 (0.98) | 9.4 (0.37) | (1.75) | | | (10.94 / 15.94 ³) | (20 / 22 ³) | (27 / 29 ³) | |
| | ¾ in-Type A | | – | – | – | | | | | | | |
| 25 (1 in) | ¾ in-Type A | | – | – | – | 69.5 | 103 | 62 | 317 / 444 ³ | 11 / 12 ³ | 14 / 15 ³ | |
| | 1 in-Type B | | 590 (23.23) | 50.4 (1.98) | 22.1 (0.87) | (2.74) | (4.06) | (2.44) | (12.48 / 17.48 ³) | (24 / 27 ³) | (31 / 33 ³) | |
| | 1 ½ in-Type B | | 590 (23.23) | 50.4 (1.98) | 34.8 (1.37) | | | | | | | |
| 50 (2 in) | 1 ½ in-Type B | | – | – | – | 99 (3.46) | 125 | 80 | 354 / 481 ³ | 27 / 28 ³ | 30 / 31 ³ | |
| | 2 in-Type B | | 740 (29.13) | 63.9 (2.52) | 47.5 (1.87) | | (4.92) | (3.15) | (13.94 / 18.94 ³) | (60 / 62 ³) | (66 / 68 ³) | |
| | 2 ½ in-Type B | | – | – | – | | | | | | | |
| 80 (3 in) | 2 ½ in-Type B | | 950 (37.40) | 77.4 (3.05) | 60.2 (2.37) | 155 | 183 | 183 | 445 / 572 ³ | 68 / 69 ³ | 71 / 72 ³ | |
| | 3 in-Type B | | 910 (35.83) | 90.9 (3.19) | 72.9 (2.87) | (6.10) | (7.20) | (7.20) | (17.52 / 22.52 ³) | (150 / 152 ³) | (157 / 159 ³) | |
| | 4 in-Type B | | 910 (35.83) | 118.9 (4.68) | 97.4 (3.83) | | | | | | | |

Process connection in accordance with DIN ISO 228 and ASME B 1.20.1, meter tube nominal diameter DN 15 (½ in)

| Meter tube | Process connection | | L | GL ⁴ | WS ⁵ | SWL ⁵ | Ø A | B | C | E | Approximate weight | |
|------------|----------------------|-----|---------|-----------------|-----------------|------------------|--------|-----------|-----------|-------------------------------|-------------------------|------------------------------|
| DN | DN / G | PN | | | | | | | | | Aluminum ¹ | Stainless steel ² |
| 15 (½ in) | 8 (¼ in) / G ¼ in | 100 | 450 | 10 (0.39) | 19 | 10 (0.39) | 44.5 | 77 (3.03) | 46 (1.81) | 278 / 405 ³ | 9 / 10 ³ | 12 / 13 ³ |
| | | | (17.72) | | | | (1.75) | | | (10.94 / 15.94 ³) | (20 / 22 ³) | (27 / 29 ³) |
| | 15 (½ in) / G ½ in | | | 13.5 (0.53) | 27 | 15 (0.59) | | | | | | |
| | 25 (1 in) / G 1 in | | 490 | 17 (0.67) | 50 | 20 (0.79) | | | | | | |
| | | | (19.29) | | | | | | | | | |
| | 15 (½ in) / ½ in NPT | | 450 | 15.6 (0.61) | 27 | 15 (0.59) | | | | | | |
| | | | (17.72) | | | | | | | | | |

¹ Devices with terminal boxes made from aluminum.

² Devices with terminal boxes made from stainless steel.

³ Devices with 'Extended tower length' option or 'Pressure rating of sensor secondary housing' option.

⁴ Dimension GL: Provide thread length of female thread.

⁵ Dimension SW: Provide width across flats in mm, Dimension SWL: Provide length of wrench flats in mm.

Tolerance for dimension L: +0 / -3 mm (+0 / -0.118 in)

Sensor with wetted parts made from C4 or C22 nickel alloy

For devices with wetted parts made from C4 or C22 nickel alloy, the installation length (L) is different from previous tables. All other dimensions and the weight are unchanged.

Dimensions in mm (in).

| Dimensions for sensors with process connection in accordance with EN 1092-1 and ASME B16.5 (ANSI) | | | | | | | | | |
|--|--------------------|--------------|--------------|--------------|--------------|-------------|-------------|-------------|-------------|
| Meter tube nominal diameter | Process connection | L | | L | | L | | L | |
| | | EN 1092-1 B1 | EN 1092-1 B1 | EN 1092-1 B2 | EN 1092-1 B2 | ASME | ASME | ASME | JIS 10K |
| | | PN 16 | PN 40 | PN 63 | PN 100 | CL150 | CL300 | CL600 | |
| DN 15 (½ in) | DN 10 (¾ in) | – | 449 (17.7) | 449 (17.7) | 449 (17.7) | – | – | – | 449 (17.7) |
| | DN 15 (½ in) | – | 442 (17.4) | 442 (17.4) | 442 (17.4) | 442 (17.4) | 442 (17.4) | 442 (17.4) | 442 (17.4) |
| | DN 20 (¾ in) | – | 428 (16.9) | 428 (16.9) | 428 (16.9) | 428 (16.9) | 428 (16.9) | 428 (16.9) | 428 (16.9) |
| DN 25 (1 in) | DN 20 (¾ in) | – | 646 (25.4) | 646 (25.4) | 646 (25.4) | 646 (25.4) | 646 (25.4) | 646 (25.4) | 646 (25.4) |
| | DN 25 (1 in) | – | 614 (24.2) | 614 (24.2) | 614 (24.2) | 614 (24.2) | 614 (24.2) | 614 (24.2) | 614 (24.2) |
| | DN 40 (1½ in) | – | 576 (22.7) | 576 (22.7) | 576 (22.7) | 576 (22.7) | 576 (22.7) | 576 (22.7) | 576 (22.7) |
| DN 50 (2 in) | DN 40 (1½ in) | – | 814 (32.0) | 814 (32.0) | 814 (32.0) | 814 (32.0) | 814 (32.0) | 814 (32.0) | 814 (32.0) |
| | DN 50 (2 in) | – | 764 (30.1) | 764 (30.1) | 764 (30.1) | 764 (30.1) | 764 (30.1) | 764 (30.1) | 764 (30.1) |
| | DN 65 (2½ in) | – | 819 (32.2) | 819 (32.2) | 819 (32.2) | 792 (31.2) | 792 (31.2) | 792 (31.2) | 819 (32.2) |
| DN 80 (3 in) | DN 65 (2½ in) | – | 1021 (40.2) | 1021 (40.2) | 1021 (40.2) | 1021 (40.2) | 1021 (40.2) | 1021 (40.2) | 1021 (40.2) |
| | DN 80 (3 in) | – | 971 (38.2) | – | 971 (38.2) | 971 (38.2) | 971 (38.2) | 971 (38.2) | 971 (38.2) |
| | DN 100 (4 in) | 971 (38.2) | 971 (38.2) | 971 (38.2) | 971 (38.2) | 971 (38.2) | 971 (38.2) | 971 (38.2) | 971 (38.2) |
| DN 100 (4 in) | DN 80 (3 in) | 1357 (53.4) | 1357 (53.4) | 1357 (53.4) | 1357 (53.4) | 1357 (53.4) | 1357 (53.4) | 1357 (53.4) | 1357 (53.4) |
| | DN 100 (4 in) | 1280 (50.4) | 1280 (50.4) | 1280 (50.4) | 1280 (50.4) | 1280 (50.4) | 1280 (50.4) | 1280 (50.4) | 1280 (50.4) |
| | DN 150 (6 in) | 1261 (49.6) | 1261 (49.6) | 1261 (49.6) | 1261 (49.6) | 1261 (49.6) | 1261 (49.6) | 1261 (49.6) | 1261 (49.6) |
| DN 150 (6 in) | DN 100 (4 in) | 1592 (62.7) | 1592 (62.7) | 1632 (64.3) | 1632 (64.3) | 1592 (62.7) | 1632 (64.3) | 1632 (64.3) | 1592 (62.7) |
| | DN 150 (6 in) | 1502 (59.1) | 1502 (59.1) | 1542 (60.7) | 1542 (60.7) | 1502 (59.1) | 1542 (60.7) | 1542 (60.7) | 1502 (59.1) |

L dimension tolerance:

- Meter tube nominal diameter DN 15 to 50 (½ to 2 in): +0 / –3 mm (+0 / –0.118 in)
- Meter tube nominal diameter DN 80 (3 in): +0 / –5 mm (+0 / –0.197 in)
- Meter tube nominal diameter DN 100 (4 in): +0 / –15 mm (+0 / –0.59 in)
- Meter tube nominal diameter DN 150 (6 in): +0 / –20 mm (+0 / –0.79 in)

Ordering information

Note

For additional information on dependencies and restrictions, and for help on product selection, please refer to the Online Product Selection Assistant (PSA) at www.abb.us/flow-selector.

CoriolisMaster FCB430, FCB450

Main ordering information

| | | | | | | | | | | | |
|---|--------|----|----|-------|----|----|---|---|----|----|---|
| CoriolisMaster FCB430 Coriolis Mass Flowmeter | FCB430 | XX | XX | XXXXX | XX | XX | X | X | XX | XX | X |
| CoriolisMaster FCB450 Coriolis Mass Flowmeter | FCB450 | XX | XX | XXXXX | XX | XX | X | X | XX | XX | X |

Explosion Protection Certification

| | |
|--|----|
| General Purpose | Y0 |
| ATEX / IECEx (Zone 2 / 22) | A2 |
| ATEX / IECEx (Zone 1 / 21) | A1 |
| cFMus version Class 1 Div. 2 (Zone 2 / 21) | F2 |
| cFMus version Class 1 Div. 1 (Zone 1 / 21) | F1 |
| NEPSI (Zone 2 / 22) | S2 |
| NEPSI (Zone 1 / 21) | S1 |
| UKEX (Zone 2 / 22) | U2 |
| UKEX (Zone 1 / 21) | U1 |

Connection Design / Connection Box Material / Cable Glands

| | |
|--|----|
| Integral, defined by Transmitter housing | Y0 |
| Remote / Aluminium / 1 x M20 x 1.5 | U1 |
| Remote / Aluminium / 1 x NPT ½ in | U2 |
| Remote / Stainless Steel / 1 x M20 x 1.5 | A1 |
| Remote / Stainless Steel / 1 x NPT ½ in | A2 |

Meter Size / Connection Size

| | |
|-------------------------------|-------|
| DN 15 (½ in) / DN 10 (¾ in) | 015E1 |
| DN 15 (½ in) / DN 15 (½ in) | 015R0 |
| DN 15 (½ in) / DN 20 (¾ in) | 015R1 |
| DN 25 (1 in) / DN 20 (¾ in) | 025E1 |
| DN 25 (1 in) / DN 25 (1 in) | 025R0 |
| DN 25 (1 in) / DN 40 (1½ in) | 025R2 |
| DN 50 (2 in) / DN 40 (1½ in) | 050E1 |
| DN 50 (2 in) / DN 50 (2 in) | 050R0 |
| DN 50 (2 in) / DN 65 (2½ in) | 050R1 |
| DN 80 (3 in) / DN 65 (2½ in) | 080E1 |
| DN 80 (3 in) / DN 80 (3 in) | 080R0 |
| DN 80 (3 in) / DN 100 (4 in) | 080R1 |
| DN 100 (4 in) / DN 80 (3 in) | 100E1 |
| DN 100 (4 in) / DN 100 (4 in) | 100R0 |
| DN 100 (4 in) / DN 150 (6 in) | 100R2 |
| DN 150 (6 in) / DN 100 (4 in) | 150E2 |
| DN 150 (6 in) / DN 150 (6 in) | 150R0 |
| DN 150 (6 in) / DN 200 (8 in) | 150R2 |

Continued see next page

| Main ordering information | | | | | | | |
|--|----|----|---|---|----|----|------|
| CoriolisMaster FCB430 Coriolis Mass Flowmeter | XX | XX | X | X | XX | XX | X |
| CoriolisMaster FCB450 Coriolis Mass Flowmeter | XX | XX | X | X | XX | XX | X |
| Process Connection Type | | | | | | | |
| Flanges DIN PN 16 | D2 | | | | | | |
| Flanges DIN PN 40 | D4 | | | | | | |
| Flanges DIN PN 63 | D5 | | | | | | |
| Flanges DIN PN 100 | D6 | | | | | | |
| Flanges EN 1092-1 PN 40, NAMUR length (DN 15, DN 25, DN 50) | S5 | | | | | | |
| Flanges with groove PN40 EN1092-10-D | S6 | | | | | | |
| Flanges EN 1092-1 PN 16, NAMUR length (DN 100, DN 150) | S7 | | | | | | |
| Flanges ANSI / ASME B16.5 Class 150 | A1 | | | | | | |
| Flanges ANSI / ASME B16.5 Class 300 | A3 | | | | | | |
| Flanges ANSI / ASME B16.5 Class 600 | A6 | | | | | | |
| Flanges ANSI / ASME B16.5 Class 900 (p-t rating CI 600) | A7 | | | | | | |
| Flanges ANSI / ASME B16.5 Class 1500 (p-t rating CI 600) | A8 | | | | | | |
| Flanges JIS 10K | J1 | | | | | | |
| Flanges JIS 20K | J3 | | | | | | |
| Sanitary Couplings SMS1145 for pipes acc. DIN11866 Series A | K1 | | | | | | |
| Tri-Clamp acc. DIN 32676 | T1 | | | | | | |
| Tri-Clamp acc. BPE | T3 | | | | | | |
| Food industry fittings acc. DIN 11851 | F1 | | | | | | |
| Female NPT thread | N5 | | | | | | |
| Female G thread | M5 | | | | | | |
| Others | Z9 | | | | | | |
| Material of Wetted Parts | | | | | | | |
| Stainless steel | | | | | | | A1 |
| Ni-Alloy | | | | | | | Cl* |
| Flow Calibration | | | | | | | |
| Flow forward ± 0.40 % of flow rate, Gas 1 % of flow rate | | | | | | | A** |
| Flow forward ± 0.25 % of flow rate, Gas 1 % of flow rate | | | | | | | B** |
| Flow forward ± 0.2 % of flow rate, Gas 1 % of flow rate | | | | | | | E** |
| Forward ±0.15% of flow rate, Gas 0.5 % of flow rate | | | | | | | C*** |
| Forward ±0.10% of flow rate, Gas 0.5 % of flow rate | | | | | | | D*** |
| Flow forward / reverse ± 0.40 % of flow rate, Gas 1 % of flow rate | | | | | | | J** |
| Flow forward / reverse ± 0.25 % of flow rate, Gas 1 % of flow rate | | | | | | | K** |
| Flow forward / reverse ± 0.20 % of flow rate, Gas 1 % of flow rate | | | | | | | N** |
| Flow forward / reverse ± 0.15 % of flow rate, Gas 0.5 % of flow rate | | | | | | | L*** |
| Flow forward / reverse ± 0.10 % of flow rate, Gas 0.5 % of flow rate | | | | | | | M*** |
| Others | | | | | | | Z |

* If the sensor wetted parts are Ni-Alloy based, parts of the sensor housing are Ni-Alloy based too.

** Only with CoriolisMaster FCB430

*** Only with CoriolisMaster FCB450

Continued see next page

... Flowmeter sensor

... Ordering information

Main ordering information

| | | | | |
|---|----------------|----|-----------------|---|
| CoriolisMaster FCB430 Coriolis Mass Flowmeter | X | XX | XX | X |
| CoriolisMaster FCB450 Coriolis Mass Flowmeter | X | XX | XX | X |
| Density Calibration | | | | |
| Density 10 g/l | 1 ¹ | | | |
| Density 2 g/l | 3 ² | | | |
| Density 1 g/l | 4 ² | | | |
| Density 0.4 g/l | 5 ² | | | |
| Others | 9 | | | |
| Connection Design / Transmitter Housing Type / Transmitter Housing Material / Cable Glands | | | | |
| Integral / Dual compartment / Aluminum / 3 × M20 × 1.5 | | | D1 | |
| Integral / Dual compartment / Aluminum / 3 × NPT ½ in | | | D2 | |
| Integral / Dual compartment / Aluminum / 3 × NPT ½ in (Exd, XP) | | | D5 | |
| Integral / Dual compartment / Aluminum / 3 × M20 × 1.5 (Exd, XP) | | | D6 | |
| Integral / Single-compartment / Aluminum / 3 × M20 × 1,5 | | | S1 | |
| Integral / Single-compartment / Aluminum / 3 × NPT ½ in | | | S2 | |
| Remote / Not specified | | | Y0 | |
| Others | | | Z9 | |
| Outputs | | | | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART, PROFIBUS DP | | | D1 | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART, MODBUS | | | M1 | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART | | | G0 | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART 1 Port Ethernet | | | E2 ³ | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART 2 Port Ethernet | | | E3 ³ | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART, 1 PortEthernet + POE | | | E4 ³ | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), 24 V DC transmitter loop power supply, HART | | | G1 | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), current output 2 (passive), HART | | | G2 | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), current output 2 (passive), current output 3 (passive), HART | | | G3 | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), current output 2 (passive), 24 V DC transmitter loop power supply, HART | | | G4 | |
| Without | | | Y0 | |
| Power Supply | | | | |
| 100 to 230 V AC | | | | A |
| 11 to 30 V DC | | | | C |
| Without | | | | Y |

1 Only with CoriolisMaster FCB430

2 Only with CoriolisMaster FCB450

3 Available with single compartment housing only, Non-Ex or Zone 2, Div. 2 only

Continued see next page

Additional ordering information

| Additional ordering information | | | | | | | | |
|---|----|-----|-----|-----|-----|-----|-------|----|
| CoriolisMaster FCB430 Coriolis Mass Flowmeter | XX | XXX | XXX | XXX | XXX | XXX | XX | XX |
| CoriolisMaster FCB450 Coriolis Mass Flowmeter | XX | XXX | XXX | XXX | XXX | XXX | XX | XX |
| Certificates | | | | | | | | |
| Test report 2.2 acc. EN 10204 confirmation of material | C1 | | | | | | | |
| Material monitoring with inspection certificate 3.1 acc. EN 10204 | C2 | | | | | | | |
| Material monitoring with inspection certificate 3.2 acc. EN 10204 | C3 | | | | | | | |
| Material monitoring NACE MR 01-75 with inspection certificate 3.1 acc. EN 10204 | CN | | | | | | | |
| Declaration of compliance with the order 2.1 acc. EN 10204 | C4 | | | | | | | |
| Inspection certificate 3.1 acc. EN 10204 for visual, dimensional and functional test | C6 | | | | | | | |
| Inspection certificate 3.1 acc. EN 10204 for positive material identification PMI (confirmation only) | CA | | | | | | | |
| Pressure test acc. AD2000 | CB | | | | | | | |
| Test package (pressure test, non-destructive test, welder & welding procedure certificate) | CT | | | | | | | |
| Inspection certificate 3.1 acc. EN 10204 for NDE of welds | C8 | | | | | | | |
| Certificate of accuracy 2.1 acc. EN 10204 | CM | | | | | | | |
| Inspection certificate 3.1 acc. EN 10204 for positive material identification PMI (inclusive heat analysis) | CR | | | | | | | |
| Others | CZ | | | | | | | |
| Other Usage Certifications | | | | | | | | |
| UKCA conformity | | | | | | | CU1 | |
| Ships Register Certifications | | | | | | | | |
| DNVGL | | | | | | | CL1 | |
| Bureau Veritas | | | | | | | CL4 | |
| Custody Transfer Certifications | | | | | | | | |
| Custody transfer acc. MID (OIML CI 0.5/0.3) | | | | | | | CT3 | |
| Custody transfer acc. MID (OIML CI 0.5) | | | | | | | CT4 | |
| Additional Output 1 | | | | | | | | |
| 1 × Digital input | | | | | | | DRN | |
| 1 × Digital output passive | | | | | | | DRG | |
| 1 × Analog output passive (4 to 20 mA) | | | | | | | DRA | |
| 1 × Digital output active | | | | | | | DRH | |
| 24 V DC transmitter loop power supply | | | | | | | DRT | |
| MODBUS | | | | | | | DRM | |
| PROFIBUS DP | | | | | | | DRD | |
| 2 port Ethernet (various protocols) | | | | | | | DR6** | |
| Additional Output 2 | | | | | | | | |
| 1 × Digital input | | | | | | | DSN | |
| 1 × Digital output passive | | | | | | | DSG | |
| 1 × Analog output passive (4 to 20 mA) | | | | | | | DSA | |
| 1 × Digital output active | | | | | | | DSH | |
| Modul Power over Ethernet / Modbus (for Single Comp Hsg) | | | | | | | DS8** | |

* Only with CoriolisMaster FCB450

** Available with single compartment housing only, Non-Ex or Zone 2, Div. 2 only

Continued see next page

... Flowmeter sensor

... Ordering information

| Zusätzliche Bestellinformationen | | | | | |
|---|------|----|----|----|-----|
| CoriolisMaster FCB430 Coriolis Masse-Durchflussmesser | XXX | XX | XX | XX | XXX |
| CoriolisMaster FCB450 Coriolis Masse-Durchflussmesser | XXX | XX | XX | XX | XXX |
| Communication Option activated | | | | | |
| Ethernet IP | GCE* | | | | |
| Modbus TCP | GCM* | | | | |
| Webserver | GCW* | | | | |
| PROFINET | CGP* | | | | |
| Connector Type | | | | | |
| Without | | | | | U0* |
| 1 x M12 Plug for Ethernet 1 Port (4 Signal Leads) | | | | | UE* |
| 2 x M12 Plug for Ethernet 2 Port (4 Signal Leads) | | | | | UF* |
| 1 x M12 Plug for Ethernet 1 Port (8 Signal Leads) | | | | | UG* |
| 1 x RJ45 connector with 5m (15ft) cable length fitted (4 Signal Leads) | | | | | U5* |
| 2 x RJ45 connector with 5m (15ft) cable length fitted (4 Signal Leads) | | | | | UB* |
| 1 x RJ45 connector with 5m (15ft) cable length fitted (8 Signal Leads) | | | | | UC* |
| 1 x RJ45 connector with 10m (30ft) cable length fitted (4 Signal Leads) | | | | | U6* |
| 2 x RJ45 connector with 10m (30ft) cable length fitted (4 Signal Leads) | | | | | DU* |
| 1 x RJ45 connector with 10m (30ft) cable length fitted (8 Signal Leads) | | | | | UH* |
| 1 x RJ45 connector with 15m (49ft) cable length fitted (4 Signal Leads) | | | | | U7* |
| 2 x RJ45 connector with 15m (49ft) cable length fitted (4 Signal Leads) | | | | | UJ* |
| 1 x RJ45 connector with 15m (49ft) cable length fitted (8 Signal Leads) | | | | | UK* |
| 1 x RJ45 connector with 20m (66ft) cable length fitted (4 Signal Leads) | | | | | U8* |
| 2 x RJ45 connector with 20m (66ft) cable length fitted (4 Signal Leads) | | | | | UN* |
| 1 x RJ45 connector with 20m (66ft) cable length fitted (8 Signal Leads) | | | | | UP* |
| Integrated Digital Display (LCD) | | | | | |
| No Display, with Blind Cover | | | | | L0 |
| With capacitive sensorbuttons / Display (TTG) / Glass cover | | | | | L2 |
| Functional Safety | | | | | |
| SIL2 certificate | | | | | CS |
| Device Display Language | | | | | |
| German | | | | | BM1 |
| English | | | | | BM5 |
| French | | | | | BM4 |
| Spanish | | | | | BM3 |
| Italien | | | | | BM2 |
| Portuguese | | | | | BMA |
| Chinese | | | | | BM6 |

* Only available with Outputs code E2, E3, E4

Continued see next page

Additional ordering information

| | | | | | | | | |
|---|----|----|--|-----|-----|----|-----|-----|
| CoriolisMaster FCB430 Coriolis Mass Flowmeter | XX | XX | | XXX | XXX | XX | XXX | XXX |
| CoriolisMaster FCB450 Coriolis Mass Flowmeter | XX | XX | | XXX | XXX | XX | XXX | XXX |
| Documentation Language | | | | | | | | |
| German | M1 | | | | | | | |
| English | M5 | | | | | | | |
| Language package Western Europe / Scandinavia (Languages: DA, ES, FR, IT, NL, PT, FI, SV) | MW | | | | | | | |
| Language package Eastern Europe (Languages: EL, CS, ET, LV, LT, HU, HR, PL, SK, SL, RO, BG) | ME | | | | | | | |
| Others | MZ | | | | | | | |
| Additional Software Features | | | | | | | | |
| Standard + DensiMass concentration measurement | | | | | | | | N6* |
| Standard + Filling application | | | | | | | | N5* |
| VeriMass - Meter verification | | | | | | | | N7 |
| CoriolisControl (ECC) | | | | | | | | N8 |
| Configuration Type | | | | | | | | |
| Parameters set to factory default | | | | | | | | NC1 |
| Parameters set customer specification | | | | | | | | NCC |
| Pressure Rating of Sensor Secondary Containment | | | | | | | | |
| Maximum burst pressure 6 MPa / 60 bar / 870 psi inclusive tower length extension | | | | | | | | PR5 |
| Maximum burst pressure 10 MPa / 100 bar / 1450 psi inclusive tower length extension | | | | | | | | PR6 |
| Maximum burst pressure 15 MPa / 150 bar / 2175 psi inclusive tower length extension | | | | | | | | PR7 |
| Signal Cable Length | | | | | | | | |
| Without signal cable | | | | | | | | SC0 |
| 5 m (approx. 15 ft) | | | | | | | | SC1 |
| 10 m (approx. 30 ft) | | | | | | | | SC2 |
| 20 m (approx. 66 ft) | | | | | | | | SC4 |
| 25 m (approx. 82 ft) | | | | | | | | SC5 |
| 30 m (approx. 98 ft) | | | | | | | | SC6 |
| 40 m (approx. 131 ft) | | | | | | | | SC8 |
| 50 m (approx. 164 ft) | | | | | | | | SCA |
| 100 m (approx. 328 ft) | | | | | | | | SCE |
| 150 m (approx. 492 ft) | | | | | | | | SCG |
| 200 m (approx. 656 ft) | | | | | | | | SCJ |
| Others | | | | | | | | SCZ |
| Device Identification Plate | | | | | | | | |
| Stainless steel plate with TAG no. | | | | | | | | T1 |
| Others | | | | | | | | TZ |
| Ambient Temperature Range | | | | | | | | |
| -40 to 70 °C (-40 to 158 °F) | | | | | | | | TA9 |
| Extended Tower Length | | | | | | | | |
| Tower length extension - meter insulation capability | | | | | | | | TE1 |
| Tower length extension - meter insulation capability with double sealing | | | | | | | | TE2 |
| Tower length extension -short- insulation capability | | | | | | | | TE3 |

* Only with CoriolisMaster FCB450

... Flowmeter sensor

... Ordering information

CoriolisMaster FCH430, FCH450

Main ordering information

| | | | | | | | | | | | |
|---|---------------|-----------|-----------|--------------|-----------|----|---|---|----|----|---|
| CoriolisMaster FCH430 Coriolis Mass Flowmeter | FCH430 | XX | XX | XXXXX | XX | XX | X | X | XX | XX | X |
| CoriolisMaster FCH450 Coriolis Mass Flowmeter | FCH450 | XX | XX | XXXXX | XX | XX | X | X | XX | XX | X |

Explosion Protection Certification

| | |
|--|----|
| General Purpose | Y0 |
| ATEX / IECEx (Zone 2 / 22) | A2 |
| ATEX / IECEx (Zone 1 / 21) | A1 |
| cFMus version Class 1 Div. 2 (Zone 2 / 21) | F2 |
| cFMus version Class 1 Div. 1 (Zone 1 / 21) | F1 |
| NEPSI (Zone 2 / 22) | S2 |
| NEPSI (Zone 1 / 21) | S1 |
| UKEX (Zone 2 / 22) | U2 |
| UKEX (Zone 1 / 21) | U1 |

Connection Design / Connection Box Material / Cable Glands

| | |
|--|----|
| Integral, defined by Transmitter housing | Y0 |
| Remote / Aluminium / 1 x M20 x 1.5 | U1 |
| Remote / Aluminium / 1 x NPT ½ in | U2 |
| Remote / Stainless Steel / 1 x M20 x 1.5 | A1 |
| Remote / Stainless Steel / 1 x NPT ½ in | A2 |

Meter Size / Connection Size

| | |
|------------------------------|-------|
| DN 25 (1 in) / DN 20 (¾ in) | 025E1 |
| DN 25 (1 in) / DN 25 (1 in) | 025R0 |
| DN 25 (1 in) / DN 40 (1½ in) | 025R2 |
| DN 50 (2 in) / DN 40 (1½ in) | 050E1 |
| DN 50 (2 in) / DN 50 (2 in) | 050R0 |
| DN 50 (2 in) / DN 65 (2½ in) | 050R1 |
| DN 80 (3 in) / DN 65 (2½ in) | 080E1 |
| DN 80 (3 in) / DN 80 (3 in) | 080R0 |
| DN 80 (3 in) / DN 100 (4 in) | 080R1 |

Process Connection Type

| | |
|---------------------------------------|----|
| Tri-Clamp acc. DIN 32676 | T1 |
| Tri-Clamp acc. BPE | T3 |
| Food industry fittings acc. DIN 11851 | F1 |
| Others | Z9 |

Continued see next page

| Main ordering information | | | | | |
|--|----|---|------|-----|---|
| CoriolisMaster FCH430 Coriolis Mass Flowmeter | XX | X | XX | XX | X |
| CoriolisMaster FCH450 Coriolis Mass Flowmeter | XX | X | XX | XX | X |
| Material of Wetted Parts | | | | | |
| Stainless steel polished 316L (1.4404 / 1.4435) | H2 | | | | |
| Flow Calibration | | | | | |
| Flow forward +/- 0.40 % of flow rate, Gas 1 % of flow rate | | | A** | | |
| Flow forward +/- 0.25 % of flow rate, Gas 1 % of flow rate | | | B** | | |
| Flow forward +/- 0.2 % of flow rate, Gas 1 % of flow rate | | | E** | | |
| Forward +/-0.15% of flow rate, Gas 0.5 % of flow rate | | | C*** | | |
| Forward +/-0.10% of flow rate, Gas 0.5 % of flow rate | | | D*** | | |
| Flow forward / reverse +/- 0.40 % of flow rate, Gas 1 % of flow rate | | | J** | | |
| Flow forward / reverse +/- 0.25 % of flow rate, Gas 1 % of flow rate | | | K** | | |
| Flow forward / reverse +/- 0.20 % of flow rate, Gas 1 % of flow rate | | | N** | | |
| Flow forward / reverse +/- 0.15 % of flow rate, Gas 0.5 % of flow rate | | | L*** | | |
| Flow forward / reverse +/- 0.10 % of flow rate, Gas 0.5 % of flow rate | | | M*** | | |
| Others | | | Z | | |
| Density Calibration | | | | | |
| Density 10 g/l | | | | 1* | |
| Density 2 g/l | | | | 3** | |
| Density 1 g/l | | | | 4** | |
| Density 0.4 g/l | | | | 5** | |
| Others | | | | 9 | |

* If the wetted parts of the sensor are made from nickel alloy then parts of the sensor housing are also manufactured from nickel alloy.

** Only with CoriolisMaster FCH430

*** Only with CoriolisMaster FCH450

Continued see next page

... Flowmeter sensor

... Ordering information

Main ordering information

| | | | |
|---|----|----|---|
| CoriolisMaster FCH430 Coriolis Mass Flowmeter | XX | XX | X |
| CoriolisMaster FCH450 Coriolis Mass Flowmeter | XX | XX | X |

Connection Design / Transmitter Housing Type / Transmitter Housing Material / Cable Glands

| | | | |
|--|----|--|--|
| Integral / Dual compartment / Aluminium / 3 x M20 x 1.5 | D1 | | |
| Integral / Dual compartment / Aluminium / 3 x NPT 1/2 in | D2 | | |
| Integral / Dual compartment / Aluminium / 3 x NPT 1/2 in (Exd, XP) | D5 | | |
| Integral / Dual compartment / Aluminium / 3 x M20 x 1.5 (Exd, XP) | D6 | | |
| Integral / Single compartment / Aluminium / 3 x M20 x 1.5 | S1 | | |
| Integral / Single compartment / Aluminium / 3 x NPT 1/2 in. | S2 | | |
| Remote / Not specified | Y0 | | |
| Others | Z9 | | |

Outputs

| | | | |
|---|-----|--|--|
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART, PROFIBUS DP | D1 | | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART, MODBUS | M1 | | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART | G0 | | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART 1 Port Ethernet | E2* | | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART 2 Port Ethernet | E3* | | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART, 1 PortEthernet + POE | E4* | | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), 24 V DC transmitter loop power supply, HART | G1 | | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), current output 2 (passive), HART | G2 | | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), current output 2 (passive), current output 3 (passive), HART | G3 | | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), current output 2 (passive), 24 V DC transmitter loop power supply, HART | G4 | | |
| Without | Y0 | | |

Power Supply

| | | | |
|-----------------|--|--|---|
| 100 to 230 V AC | | | A |
| 11 to 30 V DC | | | C |
| Without | | | Y |

* Available with single compartment housing only, Non-Ex or Zone 2, Div. 2 only

Continued see next page

Additional ordering information

Additional ordering information

| | | | | | | | |
|---|----|-----|-----|-----|----|-----|----|
| CoriolisMaster FCH430 Coriolis Mass Flowmeter | XX | XXX | XXX | XXX | XX | XXX | XX |
| CoriolisMaster FCH450 Coriolis Mass Flowmeter | XX | XXX | XXX | XXX | XX | XXX | XX |

Certificates

| | |
|---|----|
| Test report 2.2 acc. EN 10204 | C1 |
| Material monitoring with inspection certificate 3.1 acc. EN 10204 | C2 |
| Material monitoring NACE MR 01-75 with inspection certificate 3.1 acc. EN 10204 | CN |
| Declaration of compliance with the order 2.1 acc. EN 10204 | C4 |
| Inspection certificate 3.1 acc. EN 10204 for visual, dimensional and functional test | C6 |
| Inspection certificate 3.1 acc. EN 10204 for positive material identification PMI (confirmation only) | CA |
| Pressure test acc. AD2000 | CB |
| Test package (pressure test, non-destructive test, welder & welding procedure certificate) | CT |
| Certificate of compliance for calibration 2.1 acc. EN 10204 | CM |
| Inspection certificate 3.1 acc. EN 10204 for positive material identification PMI (inclusive heat analysis) | CR |
| Others | CZ |

Other Usage Certifications

| | |
|-----------------|-----|
| UKCA conformity | CU1 |
|-----------------|-----|

Additional Output 1

| | |
|--|-------|
| 1 × Digital input | DRN |
| 1 × Digital output | DRG |
| 1 × Analog output passive (4 to 20 mA) | DRA |
| 1 × Digital output active | DRH |
| 24 V DC transmitter loop power supply | DRT |
| MODBUS | DRM |
| PROFIBUS DP | DRD |
| 2 port Ethernet (various protocols) | DR6** |

Additional Output 2

| | |
|--|-------|
| 1 × Digital input | DSN |
| 1 × Digital output | DSG |
| 1 × Analog output passive (4 to 20 mA) | DSA |
| 1 × Digital output active | DSH |
| Modul Power over Ethernet / Modbus (for Single Comp Hsg) | DS8** |

* Only with CoriolisMaster FCH450

** Available with single compartment housing only, Non-Ex or Zone 2, Div. 2 only

Continued see next page

... Flowmeter sensor

... Ordering information

Additional ordering information

| | | | | | | |
|---|-----|----|----|-----|----|-----|
| CoriolisMaster FCH430 Coriolis Mass Flowmeter | XXX | XX | XX | XXX | XX | XXX |
| CoriolisMaster FCH450 Coriolis Mass Flowmeter | XXX | XX | XX | XXX | XX | XXX |

Communication Option activated

| | |
|-------------|------|
| Ethernet IP | GCE* |
| Modbus TCP | GCM* |
| Websserver | GCW* |
| PROFINET | GCP* |

Connector Type

| | |
|---|-----|
| Without | U0* |
| 1 x M12 Plug for Ethernet 1 Port (4 Signal Leads) | UE* |
| 2 x M12 Plug for Ethernet 2 Port (4 Signal Leads) | UF* |
| 1 x M12 Plug for Ethernet 1 Port (8 Signal Leads) | UG* |
| 1 x RJ45 connector with 5m (15ft) cable length fitted (4 Signal Leads) | U5* |
| 2 x RJ45 connector with 5m (15ft) cable length fitted (4 Signal Leads) | UB* |
| 1 x RJ45 connector with 5m (15ft) cable length fitted (8 Signal Leads) | UC* |
| 1 x RJ45 connector with 10m (30ft) cable length fitted (4 Signal Leads) | U6* |
| 2 x RJ45 connector with 10m (30ft) cable length fitted (4 Signal Leads) | DU* |
| 1 x RJ45 connector with 10m (30ft) cable length fitted (8 Signal Leads) | UH* |
| 1 x RJ45 connector with 15m (49ft) cable length fitted (4 Signal Leads) | U7* |
| 2 x RJ45 connector with 15m (49ft) cable length fitted (4 Signal Leads) | UJ* |
| 1 x RJ45 connector with 15m (49ft) cable length fitted (8 Signal Leads) | UK* |
| 1 x RJ45 connector with 20m (66ft) cable length fitted (4 Signal Leads) | U8* |
| 2 x RJ45 connector with 20m (66ft) cable length fitted (4 Signal Leads) | UN* |
| 1 x RJ45 connector with 20m (66ft) cable length fitted (8 Signal Leads) | UP* |

Integrated Digital Display (LCD)

| | |
|---|----|
| No Display, with Blind Cover | L0 |
| With capacitive sensorbuttons / Display (TTG) / Glass cover | L2 |

Hygienic Approval

| | |
|-------|-------|
| EHEDG | CWL** |
|-------|-------|

Functional Safety

| | |
|------------------|----|
| SIL2 certificate | CS |
|------------------|----|

Device Display Language

| | |
|------------|-----|
| German | BM1 |
| English | BM5 |
| French | BM4 |
| Spanish | BM3 |
| Italien | BM2 |
| Portuguese | BMA |
| Chinese | BM6 |

* Only available with Outputs code E2, E3, E4


** EHEDG (optional), FDA conform

Additional ordering information

| | | | | | | | |
|---|----|----|-----|-----|-----|-----|-----|
| CoriolisMaster FCH430 Coriolis Mass Flowmeter | XX | XX | XXX | XXX | | | |
| CoriolisMaster FCH450 Coriolis Mass Flowmeter | XX | XX | XXX | XXX | | | |
| Documentation Language | | | | | | | |
| German | M1 | | | | | | |
| English | M5 | | | | | | |
| Language package Western Europe / Scandinavia (Languages: DA, ES, FR, IT, NL, PT, FI, SV) | MW | | | | | | |
| Language package Eastern Europe (Languages: EL, CS, ET, LV, LT, HU, HR, PL, SK, SL, RO, BG) | ME | | | | | | |
| Others | MZ | | | | | | |
| Additional Software Features | | | | | | | |
| Standard + DensiMass concentration measurement | | | | | N6* | | |
| Standard + Filling application | | | | | N5* | | |
| VeriMass - Meter verification | | | | | N7 | | |
| CoriolisControl (ECC) | | | | | N8 | | |
| Configuration Type | | | | | | | |
| Parameters set to factory default | | | | | | NC1 | |
| Parameters set customer specification | | | | | | NCC | |
| Signal Cable Length | | | | | | | |
| Without signal cable | | | | | | | SC0 |
| 5 m (ca. 15 ft) | | | | | | | SC1 |
| 10 m (ca. 30 ft) | | | | | | | SC2 |
| 20 m (ca. 66 ft) | | | | | | | SC4 |
| 25 m (ca. 82 ft) | | | | | | | SC5 |
| 30 m (ca. 98 ft) | | | | | | | SC6 |
| 40 m (ca. 131 ft) | | | | | | | SC8 |
| 50 m (ca. 164 ft) | | | | | | | SCA |
| 100 m (ca. 328 ft) | | | | | | | SCE |
| 150 m (ca. 492 ft) | | | | | | | SCG |
| 200 m (ca. 656 ft) | | | | | | | SCJ |
| Others | | | | | | | SCZ |
| Device Identification Plate | | | | | | | |
| Stainless steel plate with TAG no. | | | | | | | T1 |
| Others | | | | | | | TZ |
| Ambient Temperature Range | | | | | | | |
| -40 to 70 °C (-40 to 158 °F) | | | | | | | TA9 |
| Extended Tower Length | | | | | | | |
| Tower length extension - meter insulation capability | | | | | | | TE1 |
| Tower length extension - meter insulation capability with double sealing | | | | | | | TE2 |

* Only with CoriolisMaster FCH450

Transmitter

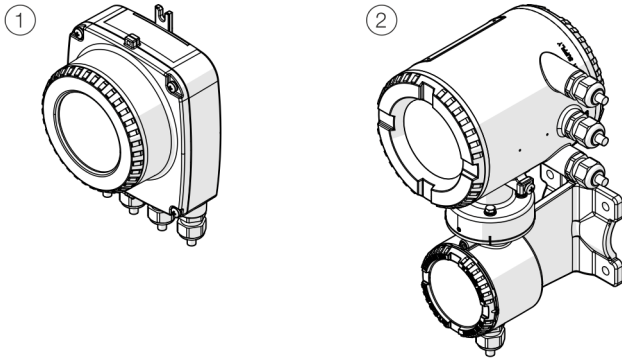

① Single-compartment housing ② Dual-compartment housing

Figure 20: Transmitter FCT4xx in field mount housing (remote mount design)

Features

- 4 to 20 mA current / HART 7.1 output.
- In the event of an alarm, current output can be adjusted to 21 to 22.6 mA (NAMUR NE43).
- Measuring range: can be adjusted between 0.001 to $2 \times Q_{\max}$ DN.
- Programmable digital output. Can be configured as a frequency, pulse or binary output.
- Two slots for optional plug-in cards for retrofitting additional current / digital outputs or a digital input.
- Parameterization by means of HART communication.
- Response time ≥ 1 s, as step function 0 to 99 % (corresponds to 5τ)
- Damping: can be adjusted 0.04 to 300 s (1τ).
- Low flow cut-off: 0 to 5 % for current and pulse output.
- Measuring medium parameters can be changed at any time (pressure and temperature influence, density, units, etc.).
- Simulation of current and binary output (manual process execution).

LCD indicator (option)

- Indicator for all measured values of CoriolisMaster (for example mass flow, volume flow rate, density, temperature and many others).
- Application-specific visualizations which the user can select. Four operator pages can be configured to display multiple values in parallel.
- Plain text fault diagnostics
- Menu-guided parameterization with four buttons.
- Easy Set-up function for fast commissioning.
- Operation through the front glass via capacitive buttons.

Diagnostic functions (option)

- VeriMass erosion monitor
- Monitoring function for current output 31 / 32 (analysis and read back of the output value).

For detailed information on optional diagnostic functions, consult the associated operating instruction OI/FCB400/FCH400.

Optional plug-in cards

The transmitter has two slots (OC1, OC2) into which plug-in cards can be inserted to provide additional inputs and outputs.

The slots are located on the transmitter motherboard and can be accessed after removing the front housing cover.

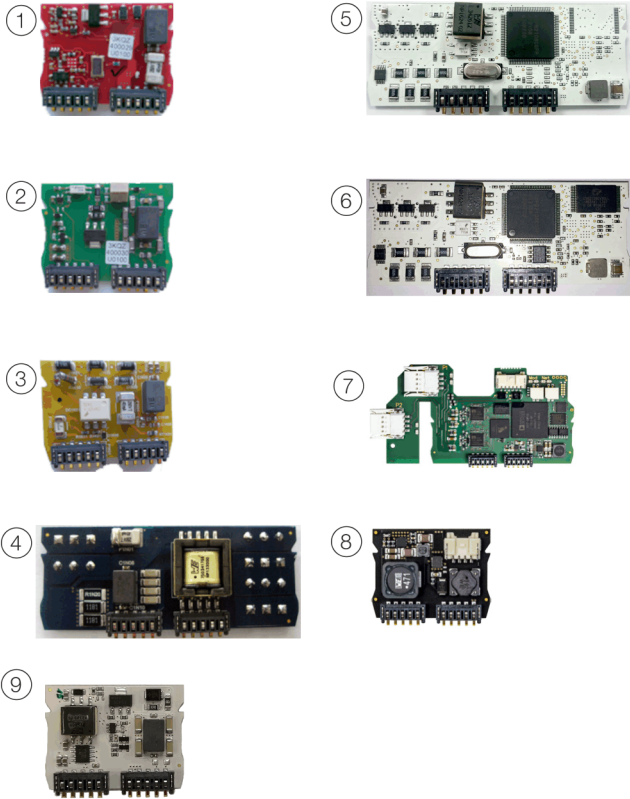


Figure 21: Plug-in cards

| Plug-in card | Quantity |
|--|----------|
| ① Current output, 4 to 20 mA passive (red) Order no.: 3KQZ400029U0100 | 2 |
| ② Passive digital output (green) Order no.: 3KQZ400030U0100 | 1** |
| ③ Passive digital input (yellow) Order no.: 3KQZ400032U0100 | 1 |
| ④ 24 V DC voltage supply (blue) Order no.: 3KQZ400031U0100 | 1 |
| ⑤ Modbus RTU® RS485 (white) Order no.: 3KQZ400028U0100 | 1 |
| ⑥ PROFIBUS DP® (white) Order no.: 3KQZ400027U0100 | 1 |
| ⑦ Ethernet (various protocols) Order no.: 3KQZ400037U0100 | 1 |
| ⑧ Power over Ethernet (POE) Order no.: 3KQZ400039U0100 | 1 |
| ⑨ Active digital output (white) Order no.: 3KQZ400056U0100 | 1** |

* The 'Number' column indicates the maximum number of plug-in cards of the same type that can be used.

* Only one plug-in card of the active digital output type or passive digital output type can be inserted in Pos. ②.

Note

For an overview of the possible plug-in card combinations, refer to **Possible plug-in card combinations** on page 84.

... Transmitter

IP rating

In accordance with EN 60529: IP 65 / IP 67, NEMA 4X

Vibration

In accordance with EN 60068-2-6

- In the 10 to 58 Hz range, maximum deflection* 0.15 mm (0.006 in.)
- In the range from 58 to 150 Hz, maximum acceleration 1 g*

* Isolated peak load: 2 g

Approved relative humidity

In accordance with EN 60068-2-30

Temperature data

| | Standard | Optional |
|---------------------|--------------------------------|---------------------------------|
| Ambient temperature | -20 to 70 °C (-4 to 158 °F) | -40 to 70 °C (-40 to 158 °F) |
| Storage temperature | -20 to 70 °C (-4 to 158 °F) | — |

Note

When operating below -20 °C (-4 °F), the LCD display can no longer be read and the electronics should be operated with as few vibrations as possible.

Full functionality is assured at temperatures above -20 °C (-4 °F).

Storage temperature of the devices in the 'Standard' version without cable glands is also -40 to 70 °C (-40 to 158°F).

Housing design

Integral mount design

| | |
|-------------|--|
| Housing | Cast aluminum, painted |
| Paint | ≥ 80 µm thick, RAL 9002 (gray white) |
| Cable gland | Polyamide, M20 x 1.5 or ½ in. NPT |
| | Stainless steel*, M20 x 1.5 or ½ in. NPT |

Remote mount design

| | |
|-------------|---|
| Housing | Cast aluminum, painted |
| Paint | ≥ 80 µm thick, mid-section RAL 7012 (basalt gray), front cover / rear cover RAL 9002 (gray white) |
| Cable gland | Polyamide, M20 x 1.5 or ½ in. NPT |
| | Stainless steel*, M20 x 1.5 or ½ in. NPT |
| Weight | 4.5 kg (9.92 lb) |

* in the case of explosion-proof design for -40 °C (-40 °F) ambient temperature)

Signal cables

The signal cable used for the connection of the transmitter and sensor must fulfill at least the following technical specifications.

| Cable specification | |
|-------------------------|--|
| Impedance | 100 to 120 Ω |
| Withstand voltage | 120 V |
| Outer diameter | 6 to 12 mm (0.24 to 0.47 in) |
| Cable design | Two wire pairs as a star-quad cable |
| Conductor cross-section | Length-dependent |
| Shield | Copper braid with approximately 85 % coverage |
| Temperature range | Application-dependent, for use in potentially explosive atmospheres, observe the information in Temperature resistance for the connecting cable on page 93! |

| Maximum signal cable length | |
|-------------------------------|----------------|
| 0.25 mm ² (AWG 24) | 50 m (164 ft) |
| 0.34 mm ² (AWG 22) | 100 m (328 ft) |
| 0.5 mm ² (AWG 20) | 150 m (492 ft) |
| 0.75 mm ² (AWG 19) | 200 m (656 ft) |

Recommended cables

It is recommended to use an ABB signal cable for standard applications. The ABB signal cable fulfills the above-mentioned cable specification and can be utilized unrestrictedly up to an ambient temperature of $T_{amb.} = 80\text{ }^{\circ}\text{C}$ (176 $^{\circ}\text{F}$).

| ABB signal cable | Ordering number |
|------------------|-----------------|
| 5 m (16 ft) | 3KQZ407123U0500 |
| 10 m (33 ft) | 3KQZ407123U1000 |
| 20 m (65 ft) | 3KQZ407123U2000 |
| 50 m (164 ft) | 3KQZ407123U5000 |
| 100 m (328 ft) | 3KQZ407123U1H00 |
| 150 m (492 ft) | 3KQZ407123U1F00 |
| 200 m (656 ft) | 3KQZ407123U2H00 |


For marine applications, an appropriate certified signal cable must be used.

ABB recommends the cable HELKAMA RFE-FRHF 2×2×0,75 QUAD 250V (HELKAMA order number 20522).

... Transmitter

Electrical connections

Electrical connection (HART protocol)

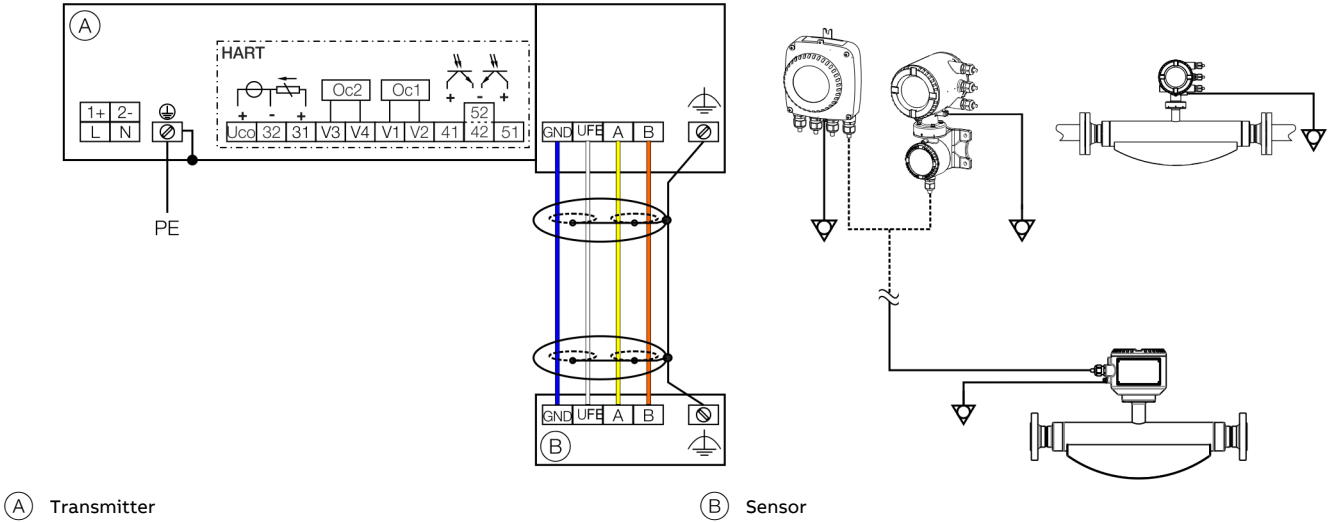

(A) Transmitter

(B) Sensor

Figure 22: Electrical connection

Connections for the power supply

| AC voltage | |
|------------|------------------------|
| Terminal | Function / comments |
| L | Phase |
| N | Neutral conductor |
| PE / ⊕ | Protective earth (PE) |
| ▽ | Potential equalization |

| DC voltage | |
|------------|------------------------|
| Terminal | Function / comments |
| 1+ | + |
| 2- | - |
| PE / ⊕ | Protective earth (PE) |
| ▽ | Potential equalization |

Connections for inputs and outputs

| Terminal | Function / comments |
|----------|---|
| Uco / 32 | Current output 4 to 20 mA- / HART® output, active or |
| 31 / 32 | Current output 4 to 20 mA- / HART® output, passive |
| 41 / 42 | Passive digital output DO1 |
| 51 / 52 | Passive digital output DO2 |
| V1 / V2 | Plug-in card, slot OC1 |
| V3 / V4 | Plug-in card, slot OC2 |

For details, see **Optional plug-in cards** on page 67.

Connecting the signal cable

Only for remote mount design.

The sensor housing and transmitter housing must be connected to potential equalization.

| Terminal | Function / comments |
|-----------------|------------------------------|
| U _{FE} | Sensor power supply |
| GND | Ground |
| A | Data line |
| B | Data line |
| ⊕ | Functional earth / Shielding |

Electrical data for inputs and outputs

Note

When using the device in potentially explosive atmospheres, note the additional connection data in **Use in potentially explosive atmospheres** on page 88!

Power supply L / N, 1+ / 2-

| AC voltage | |
|-------------------|-----------------------------|
| Terminals | L / N |
| Operating voltage | 100 to 240 V AC, 50 / 60 Hz |
| Power consumption | < 20 VA |
| DC voltage | |
| Terminals | 1+ / 2- |
| Operating voltage | 19 to 30 V DC |
| Power consumption | < 20 W |

Requirements for inputs and outputs

For reasons of electromagnetic compatibility (EMC), shielded cables should be used in certain output configurations; this is presented in the table below.

The cable shielding must be inserted in the device, see operating instruction / commissioning instruction.


| Use of shielded cables | | | | | | |
|-----------------------------------|-----------------------------|-----------|-------|-------|-------|-------|
| Transmitter | Plug-in card used | Terminal | | | | |
| | | Uco/31/32 | 41/42 | 51/52 | V1/V2 | V3/V4 |
| Dual-compartment housing | Active digital output V1/V2 | — | — | — | X | — |
| | Active digital output V3/V4 | — | — | — | — | X |
| | Modbus V1/V2 | — | — | — | X | — |
| Single-compartment housing | Active digital output V1/V2 | X | X | X | — | X |
| | Active digital output V3/V4 | X | X | X | X | — |
| | Modbus V1/V2* | — | — | — | X | — |
| | Profibus DP | — | — | — | X | — |
| | Ethernet V1/V2 | X | X | X | X | X |
| | Ethernet V1/V2, POE V3/V4 | X | X | X | X | X |

X Use shielded cables

* Use in remote mount design only


Current output 32 / Uco, 31 / 32 (basic device)

Can be configured for outputting mass flow, volume flow, density and temperature via on-site software.

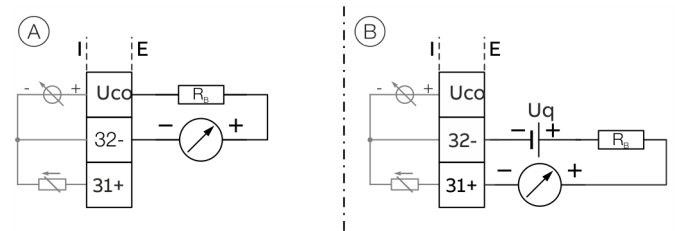

(A) Current output 31 / Uco, active (B) Current output 31 / 32, passive

Figure 23: (I = internal, E = external, R_B = load)

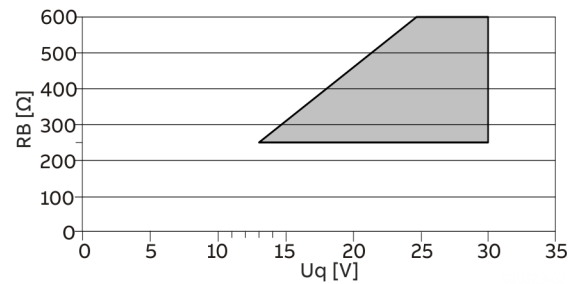

Permissible source voltage U_q for passive outputs in relation to load resistance R_B where I_{max} = 22 mA. ■ = Permissible range

Figure 24: Source voltage for passive outputs

| Current output | Active | Passive |
|---------------------------------|---|--------------------------------|
| Terminals | Uco / 32 | 31 / 32 |
| Output signal | 4 to 20 mA or 4 to 12 to 20 mA switchable | |
| Load R _B | 250 Ω ≤ R _B ≤ 300 Ω | 250 Ω ≤ R _B ≤ 600 Ω |
| Source voltage U _q * | — | 13 V ≤ U _q ≤ 30 V |
| Measuring error | < 0.1 % of measured value | |
| Resolution | 0.4 μA per digit | |


* The source voltage U_q is dependent of the load R_B and must be placed in an additional area.

For information on communication via the HART protocol, refer to **HART® Communication** on page 78.

... Transmitter

... Electrical connections

Current output Uco / 32 as loop power supply for digital output 41 / 42 or 51 / 52

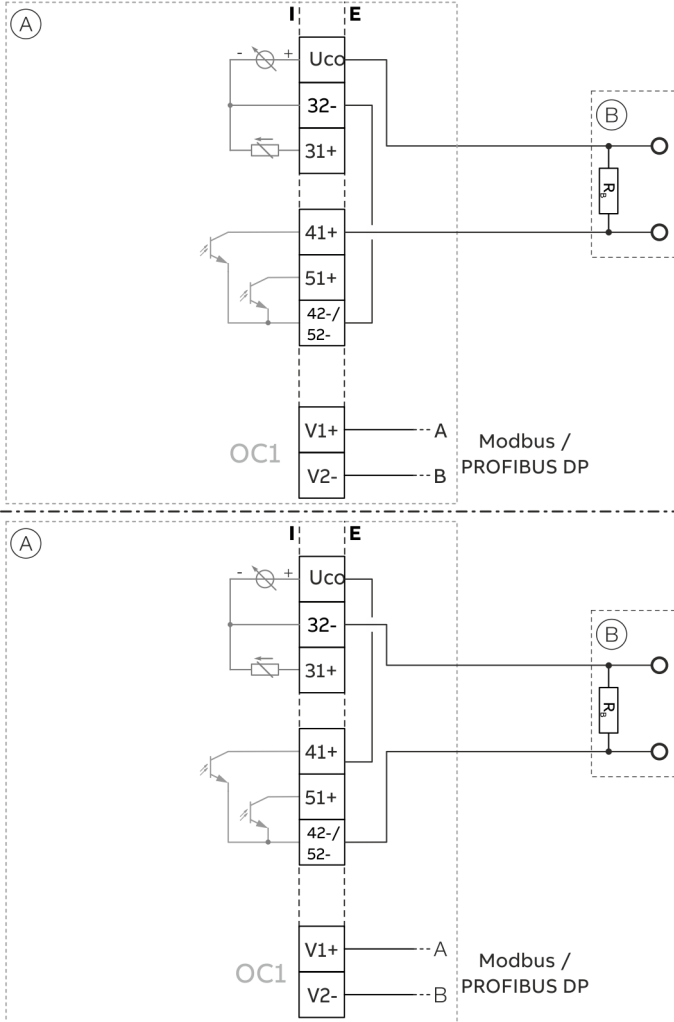

(A) Transmitter FCx400
 (B) Customer wiring
 OC1 Modbus / PROFIBUS DP plug-in card
 R_B Load resistance

Figure 25: Current output Uco / 32 in power mode

In the case of digital communication via Modbus / PROFIBUS DP, the current output Uco / 32 can be switched to the 'Power Mode' operating mode through the software. The current output 31/32/Uco is set permanently to 22.6 mA and no longer follows the selected process variable. HART communication is deactivated. As a result, the passive digital outputs 41 / 42 or 51 / 52 can also be operated as active digital outputs.

The load resistance R_B needs to be integrated by the customer outside of the transmitter housing.

Loop power supply 24 V DC pperating mode

| | |
|-----------------------|--|
| Terminals | Uco / 32 |
| Function | For active connection of passive outputs |
| Output Voltage | Load dependent, see Figure 26. |
| Load rating I_{max} | 22.6 mA, permanently short circuit-proof |

Table 1: Specification current output Uco / 32 in power mode


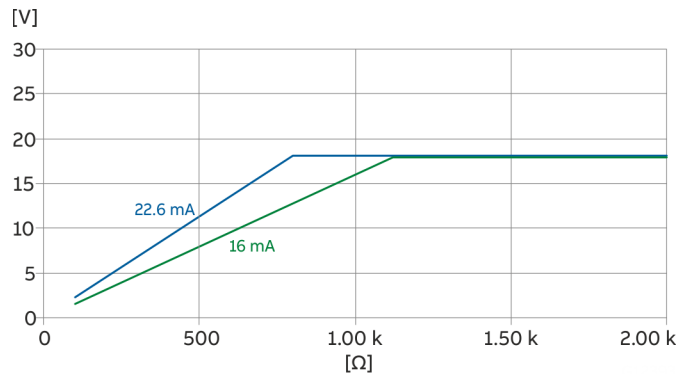


Figure 26: Output voltage dependent on load resistance

Digital output 41 / 42, 51 / 52 (basic device)

Can be configured as pulse, frequency or binary output via on-site software.

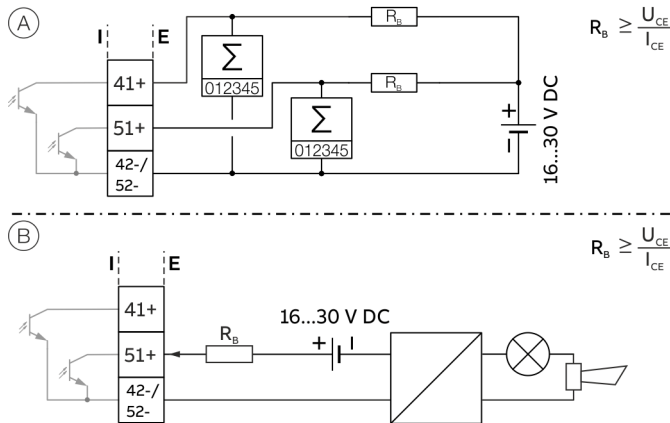

(A) Digital output 41 / 42, 51 / 52 passive as a pulse or frequency output
 (B) Passive digital output 51 / 52 as binary output

Figure 27: (I = internal, E = external, R_B = load)

| Pulse / frequency output (passive) | |
|------------------------------------|---|
| Terminals | 41 / 42, 51 / 52 |
| Output 'closed' | 0 V ≤ U _{CEL} ≤ 3 V For f < 2.5 kHz: 2 mA < I _{CEL} < 30 mA For f > 2.5 kHz: 10 mA < I _{CEL} < 30 mA |
| Output 'open' | 16 V ≤ U _{CEH} ≤ 30 V DC 0 mA ≤ I _{CEH} ≤ 0.2 mA |
| f _{max} | 10.5 kHz |
| Pulse width | 0.05 to 2000 ms |

| Binary output (passive) | |
|-------------------------|--|
| Terminals | 41 / 42, 51 / 52 |
| Output 'closed' | 0 V ≤ U _{CEL} ≤ 3 V 2 mA ≤ I _{CEL} ≤ 30 mA |
| Output 'open' | 16 V ≤ U _{CEH} ≤ 3 V DC 0 mA ≤ I _{CEH} ≤ 0.2 mA |
| Switching function | Can be configured using software. |

Note

- Terminals 42 / 52 have the same potential. Digital outputs DO 41 / 42 and DO 51 / 52 are not electrically isolated from each other. If an additional electrically isolated digital output is required, a corresponding plug-in module must be used.
- If you are using a mechanical counter, we recommend setting a pulse width of ≥ 30 ms and a maximum frequency of f_{max} ≤ 30 Hz.

Modbus® / PROFIBUS DP® interface V1 / V2 (plug-in card)

A Modbus or PROFIBUS DP interface can be implemented by using the 'Modbus RTU, RS485 (white)' or 'PROFIBUS DP, RS485 (white)' plug-in cards.

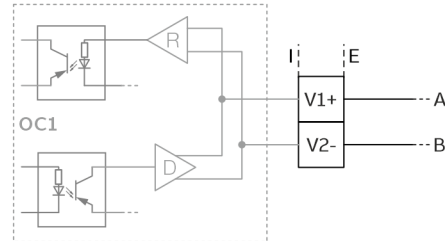


Figure 28: Plug-in card as a Modbus / PROFIBUS DP interface (I = internal, E = external)

The corresponding plug-in card can only be used in slot OC1.

For information on communication through the Modbus or PROFIBUS DP protocols, refer to chapters **Modbus® communication** on page 79 and **PROFIBUS DP® communication** on page 80.


... Transmitter

... Electrical connections

Current output V1 / V2, V3 / V4 (plug-in module)

Up to two additional plug-in modules can be implemented via the 'Passive current output (red)' option module.


Can be configured for outputting mass flow, volume flow, density and temperature via on-site software.

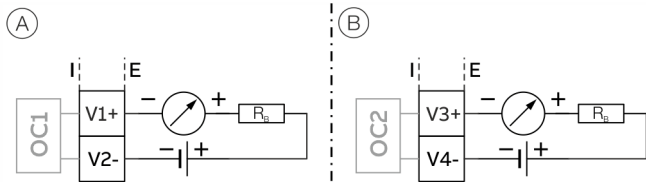

(A) Current output V1 / V2, passive (B) Current output V3 / V4, passive

Figure 29: (I = internal, E = external, R_B = load)

The plug-in module can be used in slot OC1 and OC2.

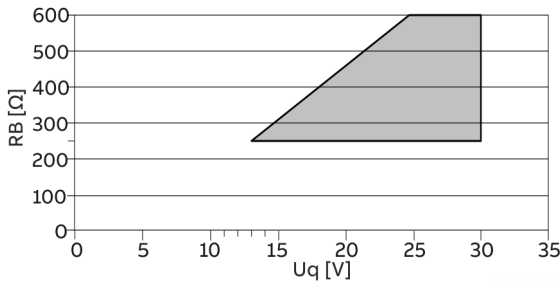

Permissible source voltage U_q for passive outputs in relation to load resistance R_B where I_{max} = 22 mA. ■ = Permissible range

Figure 30: Source voltage for passive outputs

Passive current output

| | |
|---------------------------------|--------------------------------|
| Terminals | V1 / V2, V3 / V4 |
| Output signal | 4 to 20 mA |
| Load R _B | 250 Ω ≤ R _B ≤ 600 Ω |
| Source voltage U _q * | 13 V ≤ U _q ≤ 30 V |
| Measuring error | < 0.1 % of measured value |
| Resolution | 0.4 μA per digit |

* The source voltage U_q is dependent of the load R_B and must be placed in an additional area.

Passive digital output V1 / V2, V3 / V4 (plug-in card)

An additional binary output can be implemented via the 'Passive digital output (green)' plug-in module.

Can be configured as an output for flow direction signaling, alarm output etc. via on-site software.

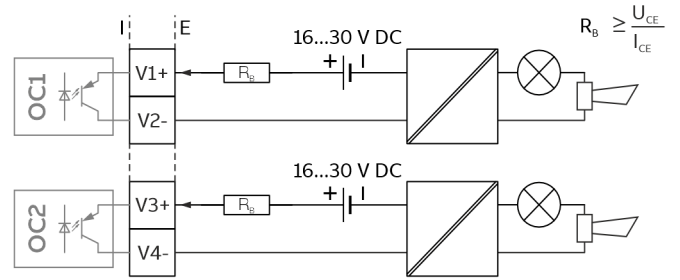


Figure 31: Plug-in card as binary output (I = internal, E = external, R_B = load)

The plug-in module can be used in slot OC1 or OC2.

Binary output (passive)

| | |
|--------------------|---|
| Terminals | V1 / V2, V3 / V4 |
| Output 'closed' | 0 V ≤ U _{CEL} ≤ 3 V 2 mA < I _{CEL} < 30 mA |
| Output 'open' | 16 V ≤ U _{CEH} ≤ 30 V DC 0 mA ≤ I _{CEH} ≤ 0.2 mA |
| Switching function | Can be configured using software. |

Active digital output V1 / V2, V3 / V4 (plug-in card)

An additional binary output can be implemented via the 'Active digital output (white)' plug-in card.

Can be configured on-site as a logical output for V1 / V2 (flow direction signaling, alarm output, etc.) via software.

Can be configured on-site for V3 / V4 as a frequency output, pulse output or logical output via software.

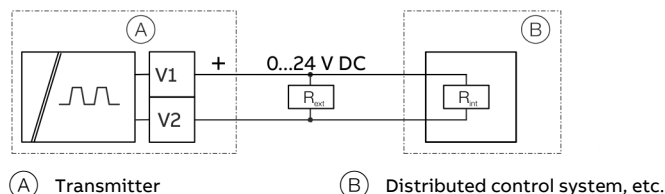


Figure 32: Plug-in card V1 / V2

OR

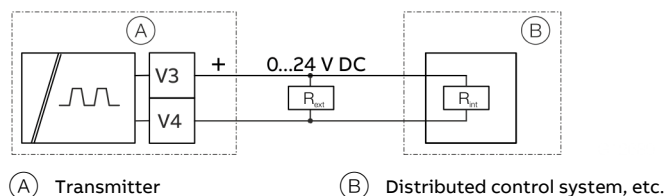


Figure 33: Plug-in card V3 / V4

The plug-in module can be used in slot OC1 or OC2.

External voltage cannot be connected to the active binary output.

Only one of the two digital output plug-in cards (passive or active) will be supported at the same time.

Note

Requirements for inputs and outputs

For reasons of electromagnetic compatibility (EMC), shielded cables should be used in certain output configurations; this is presented in Table **Use of shielded cables** on page 71.

Dependency of the output voltage U from the load R_B . Load R_B is the parallel connection of the internal resistance R_{int} and optional external resistance R_{ext} .


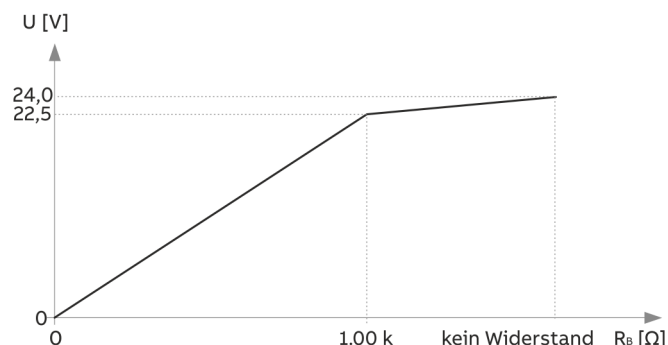


Figure 34: Dependency of the output voltage U from the load R_B .

Permissible ambient temperature single-compartment housing: 70 °C

Permissible ambient temperature dual-compartment housing dependent on the load R_B :

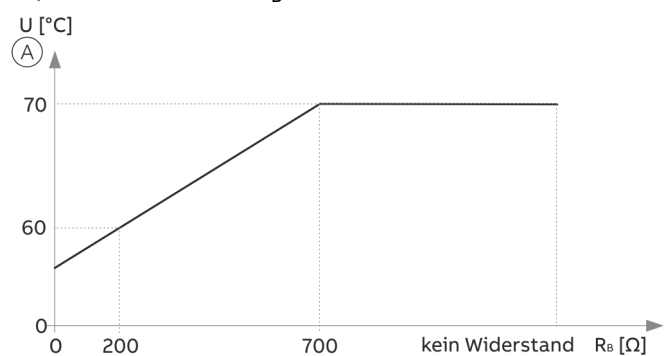

(A) Ambient temperature (°C)

Figure 35: Permissible ambient temperature dual-compartment housing

| Binary output (active) | |
|----------------------------|--|
| Terminals | V1 / V2, V3 / V4 |
| 'Off' output | $U_L \leq 200 \text{ mV}$ $I_L < 0 \text{ mA}$ |
| 'On' output | $0 \text{ V} \leq U_H \leq 24 \text{ V}$ (dependent on R_B) $0 \text{ mA} \leq I_H \leq 22.5 \text{ mA}$ (dependent on R_B) |
| For pulse/frequency output | |
| Terminals | V3 / V4 |
| 'Off' output | $U_L \leq 200 \text{ mV}$ $I_L < 0 \text{ mA}$ |
| 'On' output | $0 \text{ V} \leq U_H \leq 24 \text{ V}$ (dependent on R_B) $0 \text{ mA} \leq I_H \leq 22.5 \text{ mA}$ (dependent on R_B) |
| f_{max} | 10.5 kHz |
| Pulse width | 0.05 to 2000 ms |

... Transmitter

... Electrical connections

Digital input V1 / V2, V3 / V4 (plug-in module)

A digital input can be implemented via the 'Passive digital input (yellow)' plug-in module.

Can be configured as an input for external counter reset, external output deactivation etc. via on-site software.

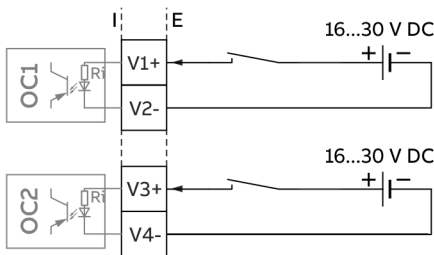


Figure 36: Plug-in card as digital input (I = internal, E = external)

The plug-in module can be used in slot OC1 or OC2.

Digital input

| | |
|---------------------------|---|
| Terminals | V1 / V2, V3 / V4 |
| Input 'On' | $16 \text{ V} \leq U_{\text{KL}} \leq 30 \text{ V}$ |
| Input 'Off' | $0 \text{ V} \leq U_{\text{KL}} \leq 3 \text{ V}$ |
| Internal resistance R_i | 6.5 k Ω |
| Function | Can be configured using software. |

24 V DC loop power supply (plug-in card)

Use of the 'loop power supply (blue)' plug-in card allows a passive output on the transmitter to be used as an active output. See also **Connection examples** on page 76.

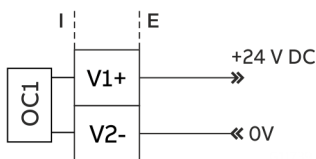


Figure 37: (I = Internal, E = External)

The plug-in card can only be used in slot OC1.

Loop power supply 24 V DC

| | |
|------------------------------|--|
| Terminals | V1 / V2 |
| Function | For active connection of passive outputs |
| Output Voltage | 24 V DC at 0 mA, 17 V DC at 25 mA |
| Load rating I_{max} | 25 mA, permanently short circuit-proof |

Connection examples

Input and output functions are configured via the device software in accordance with the desired application.


Digital output 41 / 42, 51 / 52, V3 / V4 active

When the 'loop power supply 24 V DC (blue)' plug-in card is used, the digital outputs on the basic device and on the option modules can also be wired as active digital outputs.

Note

Each 'loop power supply (blue)' plug-in card must only power one output.


It must not be connected to two outputs (for example digital output 41 / 42 and 51 / 52)!

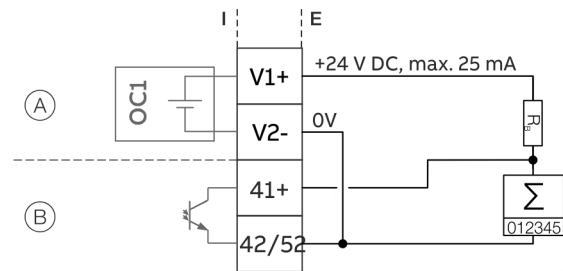

- (A) 'Loop power supply (blue)' plug-in card in slot 1
- (B) Digital output, digital output 41 / 42

Figure 38: Active digital output 41 / 42 (example)


The connection example shows usage for digital output 41 / 42; the same applies to usage for digital output 51 / 52.

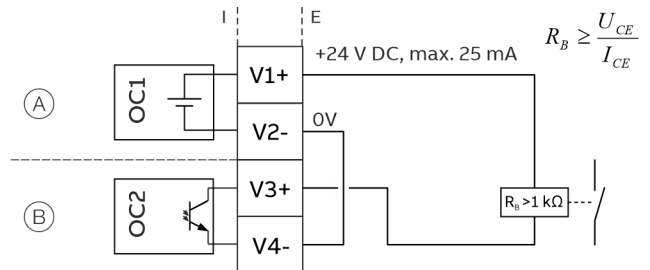

- (A) 'Loop power supply (blue)' plug-in card in slot 1
- (B) 'Digital output (green)' plug-in card in slot 2

Figure 39: Active digital output V3 / V4 (example)

Digital output 41 / 42, 51 / 52 passive on distributed control system

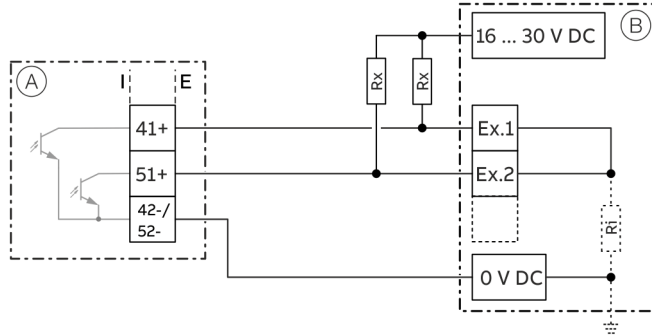

- (A) Transmitter
- (B) Distributed control system / Memory programmable controller
- Ex. 1 Input 1
- Ex. 2 Input 2
- R_x Resistor for current limitation
- R_i Distributed control system internal resistance


Figure 40: Digital output 41 / 42 on distributed control system (example)

The R_x resistors limit the maximum current through the optoelectronic coupler of the digital outputs in the transmitter.

The maximum permissible current is 25 mA. An R_x value of $1000 \Omega / 1 \text{ W}$ is recommended at a voltage level of 24 V DC. The input on the distributed control system is reduced from 24 V DC to 0 V DC (falling edge) with '1' at the digital output.

Current output V3 / V4 active

When the 'loop power supply 24 V DC, blue' plug-in card is used, the current output on the plug-in card can also be wired as the active current output.

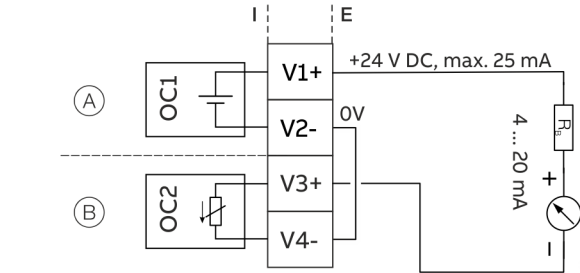


- (A) 'Loop power supply (blue)' plug-in card in slot 1
- (B) 'Passive current output (red)' plug-in card in slot 2

Figure 41: Active current output V3 / V4 (example)

Digital input V3 / V4 active

When the 'loop power supply 24 V DC, blue' plug-in card is used, the current output on the plug-in card can also be wired as the active current output.

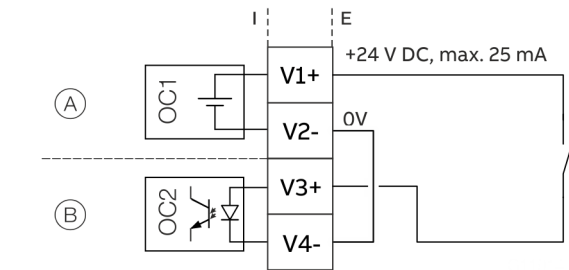

- (A) 'Loop power supply (blue)' plug-in card in slot 1
- (B) 'Passive digital input (yellow)' plug-in card in slot 2

Figure 42: Active digital output V3 / V4 (example)

... Transmitter

... Electrical connections

Connection versions digital output 41 / 42, 51 / 52

Depending on the wiring of digital outputs DO 41 / 42 and 51 / 52, they can be used parallel or only individually. The electrical isolation between the digital outputs also depends on the wiring.

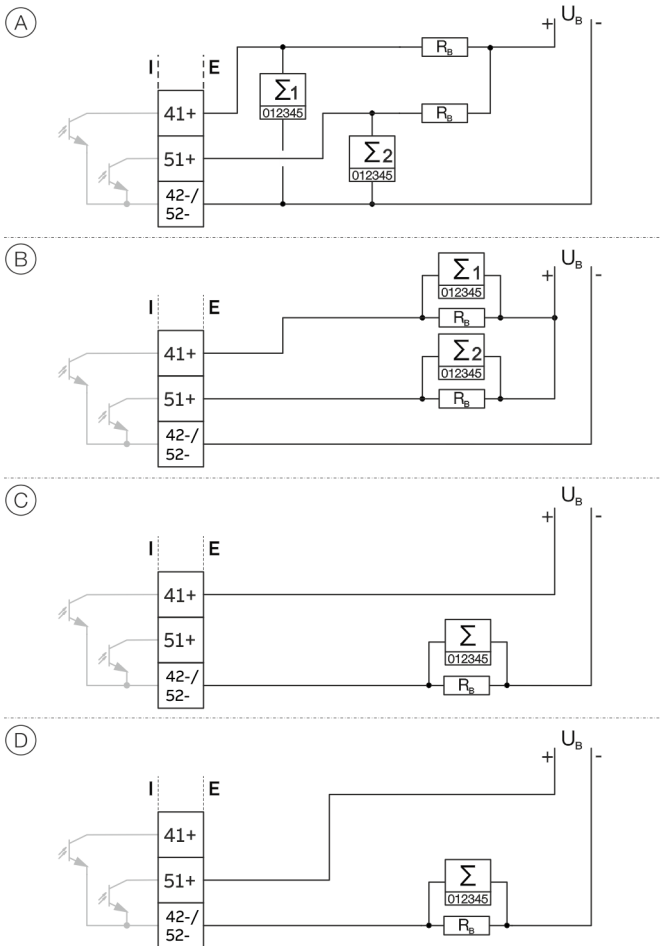


Figure 43: Connection versions digital output 41 / 42 and 51 / 52

| | DO 41 / 42 and 51 / 52 can be used parallel | DO 41 / 42 and 51 / 52 electrically isolated |
|-----|--|---|
| (A) | Yes | No |
| (B) | Yes | No |
| (C) | No, only DO 41 / 42 can be used | No |
| (D) | No, only DO 51 / 52 can be used | No |

Digital communication

HART® Communication

Note

The HART® protocol is an unsecured protocol, as such the intended application should be assessed to ensure that these protocols are suitable before implementation.

In connection with the DTM (Device Type Manager) available to the device, communication (configuration, parameterization) can be carried out FDT 0.98 or 1.2. Other tool or system integrations (e.g. Emerson AMS / Siemens PCS7) on request.

The necessary DTMs and other files can be downloaded from www.abb.com/flow.

HART output

| | |
|------------------|--|
| Terminals | Active: Uco / 32 Passive: 31 / 32 |
| Protocol | HART 7.1 |
| Transmission | FSK modulation on current output 4 to 20 mA in accordance with the Bell 202 standard |
| Baud rate | 1200 baud |
| Signal amplitude | Maximum 1.2 mAss |

Factory setting of the HART process variables

| HART process variable | Process value |
|-----------------------|--------------------------------------|
| Primary Value (PV) | Q_m – Mass flow |
| Secondary Value (SV) | Q_v – Volume flow rate |
| Tertiary Value (TV) | ρ – Density |
| Quaternary Value (QV) | T_m – Measuring medium temperature |

The process values of the HART variables can be set in the device menu.

Modbus® communication

Note

The Modbus® protocol is an unsecured protocol, as such the intended application should be assessed to ensure that these protocols are suitable before implementation.

Modbus is an open standard owned and administrated by an independent group of device manufacturers styled the Modbus Organization (www.modbus.org/).

Using the Modbus protocol allows devices made by different manufacturers to exchange information via the same communication bus, without the need for any special interface devices to be used.

Modbus protocol

| | |
|-----------------------|--|
| Terminals | V1 / V2 |
| Configuration | Via the Modbus interface or via the local operating interface in connection with a corresponding Device Type Manager (DTM) |
| Transmission | Modbus RTU - RS485 serial connection |
| Baud rate | 2400, 4800, 9600, 19200, 38400, 56000, 57600, 115200 baud Factory setting: 9600 baud |
| Parity | None, even, odd Factory setting: odd |
| Stop bit | One, two Factory setting: One |
| IEEE format | Little endian, big endian Factory setting: Little endian |
| Typical response time | < 100 ms |
| Response delay time | 0 to 200 milliseconds Factory setting: 10 milliseconds |

Cable specification

The maximum permissible length is dependent on the baud rate, the cable (diameter, capacity and surge impedance), the number of loads in the device chain, and the network configuration (2-core or 4-core).

- At a baud rate of 9600 and with a conductor cross-section of at least 0.14 mm² (AWG 26), the maximum length is 1000 m (3280 ft).
- When using a 4-core cable as a 2-wire wiring system, the maximum length must be halved.
- The spur lines must be short, a maximum of 20 m (66 ft).
- When using a distributor with 'n' connections, each branch must have a maximum length of 40 m (131 ft) divided by 'n.'

The maximum cable length depends on the type of cable used. The following standard values apply:

- Up to 6 m (20 ft): cable with standard shielding or twisted-pair cable.
- Up to 300 m (984 ft): double twisted-pair cable with overall foil shielding and integrated earth cable.
- Up to 1200 m (3937 ft): double twisted-pair cable with individual foil shielding and integrated earth cables. Example: Belden 9729 or equivalent cable.

A category 5 cable can be used for Modbus RS485 up to a maximum length of 600 m (1968 ft). For the symmetrical pairs in RS485 systems, a surge impedance of more than 100 Ω is preferred, especially at a baud rate of 19200 and above.

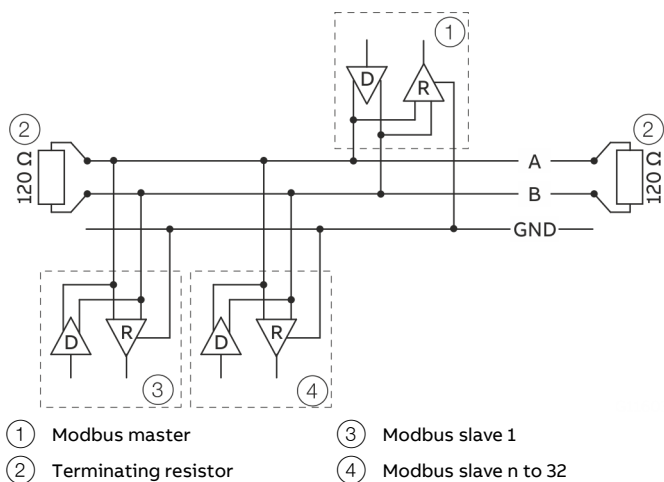


Figure 44: Communication with the Modbus protocol

... Transmitter

... Digital communication

PROFIBUS DP® communication

Note

The PROFIBUS DP® protocol is an unsecured protocol, as such the intended application should be assessed to ensure that these protocols are suitable before implementation.

PROFIBUS DP interface

| | |
|----------------|--|
| Terminals | V1 / V2 |
| Configuration | Via the PROFIBUS DP interface or via the local operating interface in connection with a corresponding Device Type Manager (DTM) |
| Transmission | Based on IEC 61158-2 |
| Baud rate | 9.6 kbps, 19.2 kbps, 45.45 kbps, 93.75 kbps, 187.5 kbps, 500 kbps, 1.5 Mbps The baud rate is automatically detected and does not need to be configured manually |
| Device profile | PA Profile 3.02 |
| Bus address | Address range 0 to 126 Factory setting: 126 |

For commissioning purposes, you will need a device driver in EDD (Electronic Device Description) or DTM (Device Type Manager) format plus a GSD file.

You can download EDD, DTM and GSD from www.abb.com/flow.

The files required for operation can also be downloaded from www.profibus.com.

ABB provides three different GSD files which can be integrated in the system.

| ID number | GSD file name | |
|-----------|---------------|-------------------------------|
| 0x9741 | PA139741.gsd | 2xAI, 1xTOT |
| 0x9742 | PA139742.gsd | 3xAI, 1xTOT |
| 0x3434 | ABB_3434.gsd | 8xAI, 3xTOT, 2xAO, 1xDI, 3xDO |

Users decide at system integration whether to install the full range of functions or only part. Switching is made using the 'Ident Nr. Selector' parameter.

Refer to Parameter description in the operating instruction.

Limits and rules when using ABB fieldbus accessories

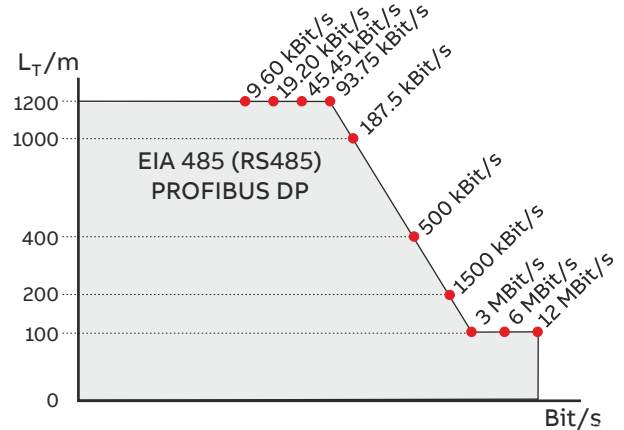


Figure 45: Bus cable length depends on the transmission rate

Pro PROFIBUS Line

(Line = Starts at DP Master and goes to last DP/PA Slave)

- Approximately 4 to 8 DP segments through the repeater (see repeater data sheets)
- Recommended DP transfer rate 500 to 1500 kBit/s
- The slowest DP node determines the transfer rate of the DP line
- Number of PROFIBUS DP and PA nodes ≤ 126 (addresses 0 to 125)

Per PROFIBUS DP segment

- Number of DP nodes ≤ 32
(Node = Devices with / without PROFIBUS address)
- Bus termination required at the beginning and end of each DP segment!
- Trunk cable length (L_T) see diagram (length dependent on transfer rate)
- Cable length of at least 1 m between two DP nodes at ≥ 1500 kBit/s!
- Spur cable length (L_S), at ≤ 1500 kBit/s: $L_S \leq 0.25$ m, at > 1500 kBit/s: $L_S = 0.00$ m!
- At 1500 kBit/s and ABB DP cable type A:
 - Sum of all spur cable lengths (L_S) ≤ 6.60 m, trunk cable length (L_T) > 6.60 m, total length = $L_T + (\sum L_S) \leq 200$ m, maximum 22 DP nodes (= 6.60 m / (0.25 m + 0.05 m spare))

EtherNet/IP™ communication

Note

You will find detailed information regarding the “Ethernet” in the interface description “COM/FCB400/FCH400/E/MB”.

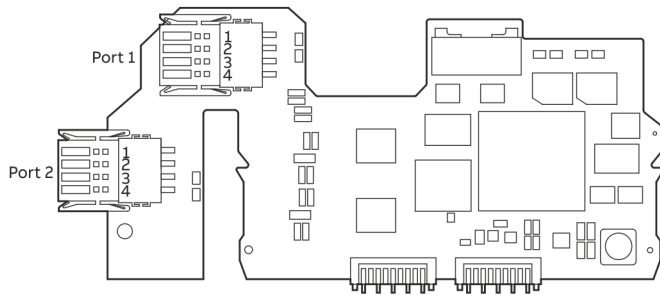


Figure 46: Plug-in card for Ethernet communication

Single port connection without Power over Ethernet

Standard Ethernet 10/100 BASE-T/TX (IEEE802.3) Single port connection.

Terminal designation:

| Connection | Pin | Function | Color codes |
|------------|-------|----------|----------------|
| 1 | Pin 1 | RD+ | White / Orange |
| | Pin 2 | RD- | Orange |
| | Pin 3 | TD+ | White / Green |
| | Pin 4 | TD- | Green |

Single port connection with Power over Ethernet

Standard Ethernet 10/100 BASE-T/TX (IEEE802.3) Single port connection.

Terminal designation:

| Connection | Pin | Function | Color codes |
|------------|-------|----------|----------------|
| 1 | Pin 1 | RD+ | White / Orange |
| | Pin 2 | RD- | Orange |
| | Pin 3 | TD+ | White / Green |
| | Pin 4 | TD- | Green |
| 2 | Pin 1 | PWR+ | White / Blue |
| | Pin 2 | PWR+ | Blue |
| | Pin 3 | PWR- | White / Brown |
| | Pin 4 | PWR- | Brown |

Dual port connection without Power over Ethernet

Terminal designation:

| Connection | Pin | Function | Color codes |
|------------|-------|----------|----------------|
| 1 | Pin 1 | RD+ | White / Orange |
| | Pin 2 | RD- | Orange |
| | Pin 3 | TD+ | White / Green |
| | Pin 4 | TD- | Green |
| 2 | Pin 1 | RD+ | White / Orange |
| | Pin 2 | RD- | Orange |
| | Pin 3 | TD+ | White / Green |
| | Pin 4 | TD- | Green |

Ethernet Communication

The CoriolisMaster is equipped with an Ethernet card has 2 Ethernet connections that support ring, star or daisy chain network configurations.

In addition to the Ethernet card, a plug-in card for ‘Power over Ethernet’ is available. Using this card, the 24 V DC version of the flowmeter can be supplied with power via the Ethernet without any additional power supply.

EtherNet/IP™ and PROFINET® protocol

Note

The protocol as such is not secure. The application should be assessed before implementation to determine the suitability of the protocol.

Cyclic communication is supported in the implemented CoriolisMaster Ethernet/IP and PROFINET protocol. Process variables, diagnosis data and information on the device status can be cyclically accessed.

Both protocols support DHCP (Dynamic Host Configuration Protocol), only PROFINET also supports DCP (Discovery and Configuration Protocol).

A web server is available for device configuration with full access to all parameters and diagnosis data.

Ethernet/IP interface

| | |
|---------------------------------|--|
| Configuration | Via the web server or the local operating interface (display). |
| Ethernet/IP product code | 5001 |
| EDS data | FCB4_FCH4_01_01.eds |
| Device profile | Profile 0x43, generic device (can be set individually). |
| Support standards and protocols | Common Industrial Protocol (CIP™) Vol1, Ed. 3.25 EtherNet/IP™ CIP™ adaptation, Vol2, Ed. 1.23 |
| Cable | Cat 5 |

... Transmitter

... Digital communication

PROFINET interface

| | |
|---------------------------------|---|
| Configuration | Via the web server or the local operating interface (display). |
| Device profile | Manufacturer-specific and PA Profile 4.02MU1* |
| GSDML data | GSDML-V2.42-ABB_001A-3436_FLOW_CORIOLIS-20230127.xml |
| Device ID | ABB 0x3436 (manufacturer-specific) or PNO 0xB333 (PA Profile) |
| Support standards and protocols | Common Industrial Protocol (CIP™) Vol1, Ed. 3.25 EtherNet/IP™ CIP™ adaptation, Vol2, Ed. 1.23 PROFINET PNIO_Version V2.42 |

* The standard for this PA Profile has currently not yet been released; the device can however work with the GSDML PA Profile.

Additional Ethernet communications protocols



Note

The device support the following security modes:

| Secure protocol | Non-secure protocol |
|--|---|
| Webserver https <ul style="list-style-type: none"> Ports used by the web server: TCP 443 Security based on .x509 certificates | EtherNet/IP, Modbus TCP and PROFINET <ul style="list-style-type: none"> Ports used by EtherNet/IP: TCP 44818, UDP 2222 Ports used by Modbus TCP: TCP 502 Ports used by PROFINET: UDP 34964, 49152 |



All the protocols can be activated / deactivated in the HMI Menu.

Dimensions

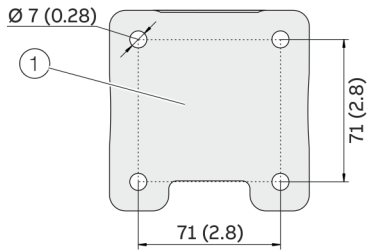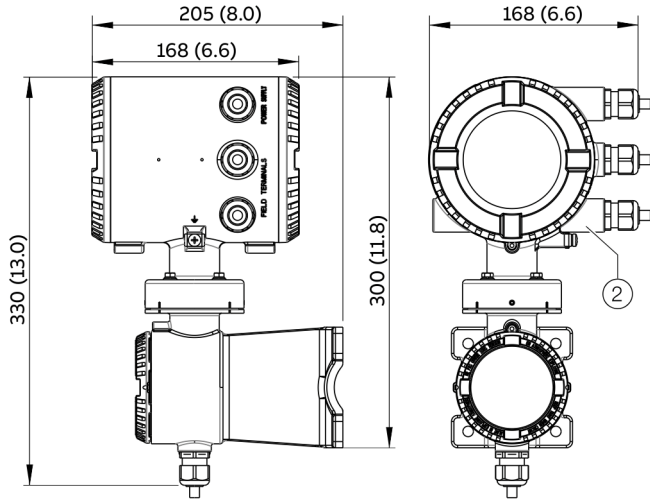

- ① Hole pattern for mounting holes
- ② Female thread (either 1/2 in NPT or M20 x 1.5), see model coding. In the case of a 1/2 in NPT, there is a plug instead of a cable gland.

Figure 47: Mounting dimensions dual-compartment housing

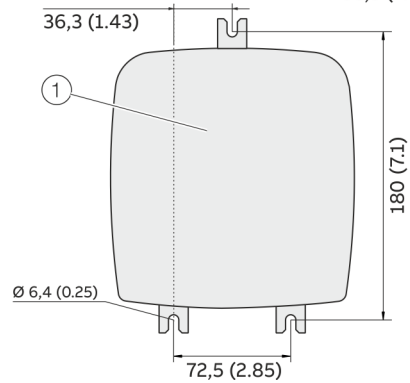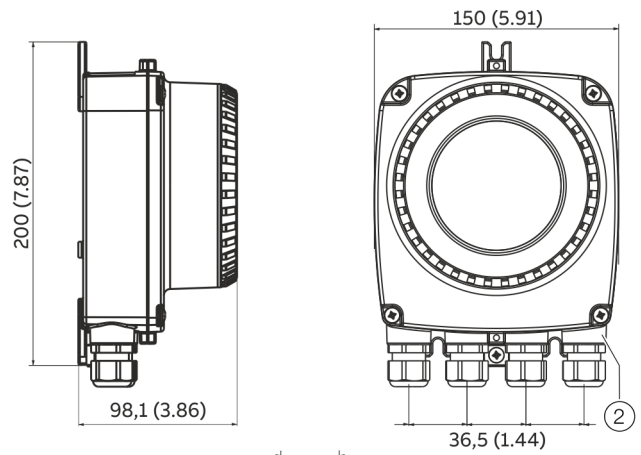

- ① Hole pattern for mounting holes
- ② Female thread (either 1/2 in NPT or M20 x 1.5), see model coding. In the case of a 1/2 in NPT, there is a plug instead of a cable gland.

Figure 49: Mounting dimensions single-compartment housing

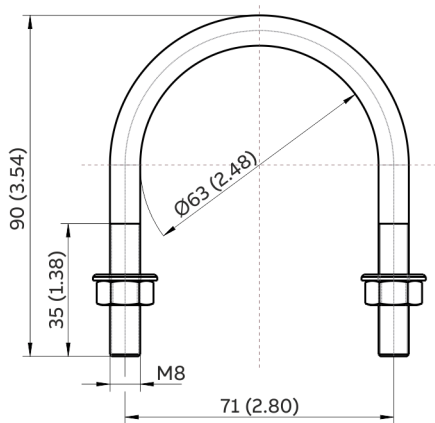


Figure 48: Assembly set for 2" pipe mounting

... Transmitter

Ordering information

Possible plug-in card combinations

The following table provides an overview of the possible plug-in card combinations that can be selected when ordering the device.

Because of the wide variety of options, not all combinations can be presented. Possible combinations are presented in our Online ABB Product Selection Assistant (PSA) for flow at www.abb.com/flow.

| Main ordering information (outputs) | Additional ordering information | | Slot OC1 | Slot OC2 |
|-------------------------------------|---------------------------------|-------------------|--|--|
| | Additional output | Additional output | Terminals V1 / V2 | Terminals V3 / V4 |
| | 1 | 2 | | |
| G0 | – | – | – | – |
| G1 | – | – | Loop power supply 24 V DC (blue) | – |
| G2 | – | – | – | Current output, 4 to 20 mA passive (red) |
| G3 | – | – | Current output, 4 to 20 mA passive (red) | Current output, 4 to 20 mA passive (red) |
| G4 | – | – | Loop power supply 24 V DC (blue) | Passive current output (red) |
| D1 | – | – | Profibus DP, RS485 (white) | |
| M1 | – | – | Modbus RTU RS485 (white) | |
| M6 | – | – | Modbus RTU RS485 (white) | Active digital output (white) |
| E2 | – | – | Ethernet (green) | |
| E3 | – | – | Ethernet (green) | |
| E4 | – | – | Ethernet (green) | Power over Ethernet (green) |
| G0 | DRT | – | Loop power supply 24 V DC (blue) | – |
| G0 | DRT | DSN | Loop power supply 24 V DC (blue) | Passive digital input (yellow) |
| G0 | DRT | DSG | Loop power supply 24 V DC (blue) | Passive digital output (green) |
| G0 | DRT | DSA | Loop power supply 24 V DC (blue) | Current output, 4 to 20 mA passive (red) |
| G0 | DRN | – | Passive digital input (yellow) | – |
| G0 | DRN | DSG | Passive digital input (yellow) | Passive digital output (green) |
| G0 | DRN | DSA | Passive digital input (yellow) | Current output, 4 to 20 mA passive (red) |
| G0 | DRG | DSN | Passive digital output (green) | Passive digital input (yellow) |
| G0 | DRG | DSA | Passive digital output (green) | Current output, 4 to 20 mA passive (red) |
| G0 | DRA | DSA | Current output, 4 to 20 mA passive (red) | Current output, 4 to 20 mA passive (red) |
| G0 | DRN | DSH | Passive digital input (yellow) | Active digital output (white) |
| G0 | DRA | DSG | Current output, 4 to 20 mA passive (red) | Passive digital output (green) |
| G0 | DRA | DSN | Current output, 4 to 20 mA passive (red) | Passive digital input (yellow) |
| G0 | DRM | – | Modbus RTU RS485 (white) | – |
| G0 | DRA | DSH | Current output, 4 to 20 mA passive (red) | Active digital output (white) |
| G0 | DRD | – | Profibus DP, RS485 (white) | – |
| G0 | DRM | DSN | Modbus RTU RS485 (white) | Passive digital input (yellow) |
| G0 | DRM | DSG | Modbus RTU RS485 (white) | Passive digital output (green) |
| G0 | DRD | DSN | Profibus DP, RS485 (white) | Passive digital input (yellow) |
| G0 | DRA | DSH | Modbus RTU RS485 (white) | Active digital output (white) |
| G0 | DRD | DSG | Profibus DP, RS485 (white) | Passive digital output (green) |
| G0 | DR6 | – | Ethernet | – |
| G0 | DR6 | DS8 | Ethernet (green) | Power over Ethernet (green) |
| G0 | DR6 | DSN | Ethernet (green) | Passive digital input (yellow) |
| G0 | DR6 | DSG | Ethernet (green) | Passive digital output (green) |

Note

For additional information on dependencies and restrictions, and for help on product selection, please refer to the Online Product Selection Assistant (PSA) at www.abb.us/flow-selector.

CoriolisMaster FCT430, FCT450 Coriolis Mass Flowmeter Transmitter

| Main ordering information | | | | | |
|--|---------------|-----------|-----------|-----------|----------|
| CoriolisMaster FCT430 Coriolis Mass Flowmeter Transmitter | FCT430 | XX | XX | XX | X |
| CoriolisMaster FCT450 Coriolis Mass Flowmeter Transmitter | FCT450 | XX | XX | XX | X |
| Explosion Protection Certification | | | | | |
| General Purpose | | Y0 | | | |
| ATEX / IECEx (Zone 2 / 22) | | A2 | | | |
| ATEX / IECEx (Zone 1 / 21) | | A1 | | | |
| cFMus version Class 1 Div. 2 (Zone 2 / 21) | | F2 | | | |
| cFMus version Class 1 Div. 1 (Zone 1 / 21) | | F1 | | | |
| NEPSI (Zone 2 / 22) | | S2 | | | |
| NEPSI (Zone 1 / 21) | | S1 | | | |
| UKEX (Zone 2 / 22) | | U2 | | | |
| UKEX (Zone 1 / 21) | | U1 | | | |
| Connection Design / Transmitter Housing Type / Transmitter Housing Material / Cable Glands | | | | | |
| Remote / Dual compartment, wall mounted / Aluminum / 4 × M20 × 1.5 | | | | | R1 |
| Remote / Dual compartment, wall mounted / Aluminum / 4 × NPT ½ in | | | | | R2 |
| Remote / Dual compartment, wall mounted / Aluminum / 4 × M20 × 1.5 (Exd, XP) | | | | | R5 |
| Remote / Dual compartment, wall mounted / Aluminum / 4 × NPT ½ in (Exd, XP) | | | | | R6 |
| Remote / Single-compartment / Aluminum / 4 × M20 × 1.5 | | | | | W1 |
| Remote / Single-compartment / Aluminum / 4 × NPT ½ in | | | | | W2 |
| Others | | | | | Z9 |
| Outputs | | | | | |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART, PROFIBUS DP | | | | | D1 |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART, MODBUS | | | | | M1 |
| Current output 1 (active or passive), digital output 1 & 2 (passive), digital output 3 (active), HART, MODBUS | | | | | M6 |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART | | | | | G0 |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART 1 Port Ethernet | | | | | E2* |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART 2 Port Ethernet | | | | | E3* |
| Current output 1 (active or passive), digital output 1 & 2 (passive), HART, 1 PortEthernet + POE | | | | | E4* |
| Current output 1 (active or passive), digital output 1 & 2 (passive), 24 V DC transmitter loop power supply, HART | | | | | G1 |
| Current output 1 (active or passive), digital output 1 & 2 (passive), current output 2 (passive), HART | | | | | G2 |
| Current output 1 (active or passive), digital output 1 & 2 (passive), current output 2 (passive), current output 3 (passive), HART | | | | | G3 |
| Current output 1 (active or passive), digital output 1 & 2 (passive), current output 2 (passive), 24 V DC transmitter loop power supply, HART | | | | | G4 |
| Others | | | | | Z9 |
| Power Supply | | | | | |
| 100 to 230 V AC | | | | | A |
| 11 to 30 V DC | | | | | C |

* Available with single compartment housing only, Non-Ex or Zone 2, Div. 2 only

... Transmitter

... Ordering information

Additional ordering information

| Additional ordering information | | | | | | | | | | |
|--|----|-----|----|-----|-----|-----|-----|----|----|------|
| CoriolisMaster FCT430 Coriolis Mass Flowmeter Transmitter | XX | XXX | XX | XXX | XXX | XXX | XXX | XX | XX | XXX |
| CoriolisMaster FCT450 Coriolis Mass Flowmeter Transmitter | XX | XXX | XX | XXX | XXX | XXX | XXX | XX | XX | XXX |
| Mounting Bracket Shape / Material | | | | | | | | | | |
| For 2 in pipe mounting / Carbon steel | B1 | | | | | | | | | |
| Certificates | | | | | | | | | | |
| Declaration of compliance with the order 2.1 acc. EN 10204 | | | | | | | | | | C4 |
| Inspection certificate 3.1 acc. EN 10204 for visual, dimensional and functional test | | | | | | | | | | C6 |
| Other Usage Certifications | | | | | | | | | | |
| UKCA conformity | | | | | | | | | | CU1 |
| Ships Register Certifications | | | | | | | | | | |
| DNVGL | | | | | | | | | | CL1 |
| Bureau Veritas | | | | | | | | | | CL4 |
| Custody Transfer Certifications | | | | | | | | | | |
| Custody transfer acc. MID (OIML Cl 0.5/0.3) | | | | | | | | | | CT3 |
| Custody transfer acc. MID (OIML Cl 0.5) | | | | | | | | | | CT4 |
| Additional Output 1 | | | | | | | | | | |
| 1 × Digital input | | | | | | | | | | DRN |
| 1 × Digital output | | | | | | | | | | DRG |
| 1 × Analog output passive (4 to 20 mA) | | | | | | | | | | DRA |
| 1 × Digital output active | | | | | | | | | | DRH |
| 24 V DC transmitter loop power supply | | | | | | | | | | DRT |
| 1 × MODBUS | | | | | | | | | | DRM |
| 1 × PROFIBUS DP | | | | | | | | | | DRD |
| 2 port Ethernet (various protocols) | | | | | | | | | | DR6* |
| Additional Output 2 | | | | | | | | | | |
| 1 × Digital input | | | | | | | | | | DSN |
| 1 × Digital output | | | | | | | | | | DSG |
| 1 × Analog output passive (4 to 20 mA) | | | | | | | | | | DSA |
| 1 × Digital output active | | | | | | | | | | DSH |
| Modul Power over Ethernet / Modbus (for Single Comp Hsg) | | | | | | | | | | DS8* |
| Integrated Digital Display (LCD) | | | | | | | | | | |
| No Display, with Blind Cover | | | | | | | | | | L0 |
| With capacitive sensorbuttons / Display (TTG) / Glass cover | | | | | | | | | | L2 |
| Functional Safety | | | | | | | | | | |
| SIL2 certificate | | | | | | | | | | CS |
| Device Display Language | | | | | | | | | | |
| German | | | | | | | | | | BM1 |
| English | | | | | | | | | | BM5 |
| French | | | | | | | | | | BM4 |
| Spanish | | | | | | | | | | BM3 |
| Italien | | | | | | | | | | BM2 |
| Portuguese | | | | | | | | | | BMA |
| Chinese | | | | | | | | | | BM6 |

* Available with single compartment housing only, Non-Ex or Zone 2, Div. 2 only

Continued see next page

| Additional ordering information | | | | | |
|--|----|----|-----|-----|------|
| CoriolisMaster FCT430 Coriolis Mass Flowmeter Transmitter | XX | XX | XXX | XXX | XX |
| CoriolisMaster FCT450 Coriolis Mass Flowmeter Transmitter | XX | XX | XXX | XXX | XX |
| Documentation Language | | | | | |
| German | M1 | | | | |
| English | M5 | | | | |
| Language package Western Europe / Scandinavia (Languages: DA, ES, FR, IT, NL, PT, FI, SV) | MW | | | | |
| Language package Eastern Europe (Languages: EL, CS, ET, LV, LT, HU, HR, PL, SK, SL, RO, BG) | ME | | | | |
| Others | MZ | | | | |
| Device Identification Plate | | | | | |
| Stainless steel plate with TAG no. | | | T1 | | |
| Ambient Temperature | | | | | |
| -40 to 70 °C (-40 to 158 °F) | | | | TA9 | |
| Communication Option activated | | | | | |
| Ethernet IP | | | | | GCE* |
| Modbus TCP | | | | | GCM* |
| Webserver | | | | | GCW* |
| PROFINET | | | | | GCP* |
| Connector type | | | | | |
| Without | | | | | U0 |
| 1 × M 12 Plug for Ethernet 1 Port (4 signal leads) | | | | | UE* |
| 2 × M 12 Plug for Ethernet 2 Port (4 signal leads) | | | | | UF* |
| 1 × M 12 Plug for Ethernet 1 Port (8 signal leads) | | | | | UG* |
| 1 × RJ45 connector with 5 m (15 ft) cable length fitted (4 signal leads) | | | | | U5* |
| 2 × RJ45 connector with 5 m (15 ft) cable length fitted (4 signal leads) | | | | | UB* |
| 1 × RJ45 connector with 5 m (15 ft) cable length fitted (8 signal leads) | | | | | UC* |
| 1 × RJ45 connector with 10 m (30 ft) cable length fitted (4 signal leads) | | | | | U6* |
| 2 × RJ45 connector with 10 m (30 ft) cable length fitted (4 signal leads) | | | | | DU* |
| 1 × RJ45 connector with 10 m 30 ft cable length fitted (8 signal leads) | | | | | UH* |
| 1 × RJ45 connector with 15 m (49 ft) cable length fitted (4 signal leads) | | | | | U7* |
| 2 × RJ45 connector with 15 m (49 ft) cable length fitted (4 signal leads) | | | | | UJ* |
| 1 × RJ45 connector with 15 m 49 ft cable length fitted (8 signal leads) | | | | | UK* |
| 1 × RJ45 connector with 20 m (66 ft) cable length fitted (4 signal leads) | | | | | U8* |
| 2 × RJ45 connector with 20 m (66 ft) cable length fitted (4 signal leads) | | | | | UN* |
| 1 × RJ45 connector with 20 m (66 ft) cable length fitted (8 signal leads) | | | | | UP* |

* Available with single compartment housing, Ethernet Card, Non-Ex or ATEX Zone 2

Note

When using the outputs of the M6 option digital output or the DRH/DSH option active digital output option cards, all the option cards used and all pre-installed output circuits must use the 'Increased safety' (Ex-e) IP rating.

The 'Intrinsic safety' (Ex i) IP rating is not permitted.

Use in potentially explosive atmospheres

Note

Further information on the approval of devices for use in potentially explosive atmospheres can be found in the type examination certificates or the relevant certificates at www.abb.com/flow.

Device overview

ATEX, IECEx and UKEX

| | Standard / No explosion protection | | Zone 2, 21, 22 | | Zone 1, 21 (Zone 0) | |
|--|------------------------------------|-----------|----------------|-----------|---------------------|-----------|
| Model number | FCx4xx Y0 | | FCx4xx A2, U2 | | FCx4xx A1, U1 | |
| Integral mount design | | | | | | |
| <ul style="list-style-type: none"> Standard Zone 2, 21, 22 Zone 1, 21 Zone 0 | | | | | | |
| Model number | FCT4xx Y0 | FCx4xx Y0 | FCT4xx A2 | FCx4xx A2 | FCT4xx A1 | FCx4xx A1 |
| Remote mount design | | | | | | |
| <ul style="list-style-type: none"> Standard Zone 2, 21, 22 Zone 1, 21 Zone 0 | | | | | | |
| Model number | FCT4xx Y0 | | FCT4xx A2 | | FCx4xx A1 | |
| Remote mount design | | | | | | |
| <ul style="list-style-type: none"> Standard Zone 2, 21, 22 Zone 1, 21 Zone 0 | | | | | | |
| Model number | — | | FCT4xx A2 | | FCx4xx A1 | |
| Remote mount design | | | | | | |
| <ul style="list-style-type: none"> Zone 2, 21, 22 Zone 1, 21 | | | | | | |

- ① Single-compartment housing
- ② Dual-compartment housing
- ③ Zone 0 within the meter tube

cFMus

| | Standard / No explosion protection | | Class I Div. 2 / Zone 2 | | Class I Div. 1 / Zone 1 (Zone 0) | |
|---|------------------------------------|-----------|-------------------------|-----------|----------------------------------|-----------|
| Model number | FCx4xx Y0 | | FCx4xx F2 | | FCx4xx F1 | |
| Integral mount design | | | | | | |
| <ul style="list-style-type: none"> • Standard • Div. 2 / Zone 2 • Div. 1 / Zone 1 (Zone 0) | | | | | | |
| Model number | FCT4xx Y0 | FCx4xx Y0 | FCT4xx F2 | FCx4xx F2 | FCT4xx F1 | FCx4xx F1 |
| Remote mount design | | | | | | |
| Transmitter and flowmeter sensor <ul style="list-style-type: none"> • Div. 2 / Zone 2 • Div. 1 / Zone 1 (Zone 0) | | | | | | |
| Model number | FCT4xx Y0 | | FCT4xx F2 | | FCx4xx F1 | |
| Remote mount design | | | | | | |
| Transmitter <ul style="list-style-type: none"> • Standard Sensor <ul style="list-style-type: none"> • Div. 2 / Zone 2 • Div. 1 / Zone 1 (Zone 0) | | | | | | |
| Model number | — | | FCT4xx F2 | | FCx4xx F1 | |
| Remote mount design | — | | | | | |
| Transmitter <ul style="list-style-type: none"> • Div. 2 / Zone 2 Sensor <ul style="list-style-type: none"> • Div. 1 / Zone 1 (Zone 0) | — | | | | | |

- ① Single-compartment housing
- ② Dual-compartment housing
- ③ Zone 0 within the meter tube

ATEX, IECEx and UKEX

| Model number for use in Zone 2, 21 | Ex marking | Certificate |
|--|---|---|
| FCa4c – A2Y0fghjD; FCa4c – U2Y0fghjD Integral mount design with dual-compartment housing | II3G Ex ec IIC T6...T1 Gc II2D Ex tb IIIC T80°C...Tmedium Db | ATEX: FM15ATEX0014X, FM15ATEX0016X |
| FCa4c – A2efghjY; FCa4c – U2efghjY Sensor in remote mount design with dual-compartment housing | | IECEx: IECEx FME 15.0005X |
| FCT4c – A2R; FCT4c – U2R Transmitter in remote mount design with dual-compartment housing | II3G Ex ec IIC T6 Gc II2D Ex tb IIIC T80°C Db | UKEX: FM22UKEX0095X, FM22UKEX0097X |
| Model number for use in Zone 1, 21 | Ex marking | Certificate |
| FCa4c – A1Y0fghjDx; FCa4c – U1Y0fghjDx (x = 1 to 4) Integral mount design with dual-compartment housing | II 1/2 (1) G Ex db eb ia mb [ia Ga] IIC T6...T1 Gb II 2 (1) D Ex ia tb [ia Da] IIIC T80°C Db | ATEX: FM15ATEX0015X |
| FCa4c – A1Y0fghjDx; FCa4c – U1Y0fghjDx (x = 5 to 8) Integral mount design with dual-compartment housing (flameproof enclosure 'Ex d') | II 1/2 (1) G Ex db ia mb [ia Ga] IIB+H2 T6...T1 Gb II 2 (1) D Ex ia tb [ia Da] IIIC T80°C Db | IECEx: IECEx FME 15.0005X |
| FCa4cA1Y0fghM6jDx; FCa4cU1Y0fghM6jDx (x = 1 to 4) or DRH or DSH option card Integral mount design with dual-compartment housing and active digital output option card | II 1/2 G Ex db eb mb ia IIC T6...T1 Gb II 2 D Ex ia tb IIIC T80°C Db | UKEX: FM22UKEX0096X |
| FCa4c – A1efghjY; FCa4c – U1efghjY Sensor in remote mount design with dual-compartment housing | II 1/2 G Ex eb ia mb IIB+H2 T6...T1 Ga/Gb II 2 D Ex ia tb IIIC T80°C Db | |
| FCa4cA1Y0fghM6jDx; FCa4cU1Y0fghM6jDx (x = 5 to 8) or DRH or DSH option card Integral mount design with dual-compartment housing (flameproof enclosure 'Ex d') and active digital output option card | II 1/2 G Ex db mb ia IIB+H2 T6...T1 Gb II 2 D Ex ia tb IIIC T80°C Db | |
| FCT4c – A1R; FCT4c – U1R (x = 1 to 4) Transmitter in remote mount design with dual-compartment housing | II 2 (1) G Ex db e ia mb [ia Ga] IIC T6...T1 Gb II 2 (1) D Ex ia mb tb [ia Da] IIIC T80°C Db | |
| FCT4c – A1R; FCT4c – U1R (x = 5 to 8) Transmitter in remote mount design with dual-compartment housing (flameproof enclosure 'Ex d') | II 2 (1) G Ex db ia mb [ia Ga] IIB+H2 T6...T1 Gb II 2 (1) D Ex ia tb [ia Da] IIIC T80°C Db | |
| FCT4c – A1R; FCT4c – U1R (x = 1 to 4) fghM6 or DRH or DSH option card Transmitter in remote mount design with dual-compartment housing and active digital output option card | II 2 G Ex db eb mb IIC T6...T1 Gb II 2 D Ex mb tb IIIC T80°C Db | |
| FCT4c – A1R; FCT4c – U1R (x = 5 to 8) fghM6 or DRH or DSH option card Transmitter in remote mount design with dual-compartment housing (flameproof enclosure 'Ex d') and active digital output option card | II 2 G Ex db mb IIB+H2 T6...T1 Gb II 2 D Ex tb IIIC T80°C Db | |

Note

- Depending on the design, a specific marking in accordance with ATEX or IECEx applies.
- ABB reserves the right to modify the Ex-marking. Refer to the name plate for the exact marking.

... Use in potentially explosive atmospheres

... Ex marking

cFMus

| Model number for use in Division 2 | Ex marking | |
|---|--|--|
| | Certificate: FM18US0160X | Certificate: FM18CA0073X |
| FCa4c – F2Y0fghjD Integral mount design with dual-compartment housing | NI: CL I,II,III Div 2, GPS ABCDEFG, T6...T1 CL I, ZN 2, AEx ec IIC T6...T1 | DIP: CL II,III, Div 1, GPS EFG, T6 ZN 21, AEx ia tb IIIC T80°C |
| FCa4c – F2efghijY Sensor in remote mount design with dual-compartment housing Design in accordance with ANSI / ISA 12.27.01 as 'Single Seal Device' or as 'Dual Seal Device' (option TE2) | CL I, ZN 2, Ex ec IIC T6...T1 | ZN21, Ex ia tb IIIC T80°C |
| FCT4c – F2R Transmitter in remote mount design with dual-compartment housing | See handbook for temperature class information | |
| FCT4c – F2W Sensor in remote mount design with single-compartment housing | NI: CL I,II,III Div 2, GPS ABCDEFG, T6...T1 | DIP: CL II,III, Div 1, GPS EFG, T6 |
| | See handbook for temperature class information | |
| Model number for use in Division 1 | Ex marking | |
| | Certificate: FM18US0160X | Certificate: FM18CA0073X |
| FCa4c – F1Y0fghjDx (x = 1 to 4) Integral mount design with dual-compartment housing | XP-IS: CL I, Div 1, GPS ABCD, T6...T1 (USA) DIP: CL II,III, Div 1, GPS EFG, T6 | XP-IS: CL I, Div 1, GPS BCD, T6...T1 (CAN) ZN21, AEx ia tb IIIC T80°C |
| FCa4c – F1Y0fghjDx (x = 5 to 8) Integral mount design with dual-compartment housing (Explosionproof 'XP'). Design in accordance with ANSI / ISA 12.27.01 as 'Single Seal Device' or as 'Dual Seal Device' (option TE2). | CL I, ZN 1, AEx db ia IIB+H2 T6...T1 CL I, ZN 1, Ex db ia IIB+H2 T6...T1 | ZN21, Ex ia tb IIIC T80°C |
| FCa4c – F1Y0fghM6jDx (x = 1 to 4) or DRH or DSH option card Integral mount design with dual-compartment housing | XP-IS: CL I, Div 1, GPS ABCD, T6...T1 (USA) DIP: CL II,III, Div 1, GPS EFG, T6 | XP-IS: CL I, Div 1, GPS BCD, T6...T1 (CAN) ZN21, AEx ia tb IIIC T80°C |
| FCa4c – F1Y0fghM6jDx (5 to 8) or DRH or DSH option card Integral mount design with dual-compartment housing (Explosionproof „XP“). | CL I, ZN 1, AEx db ia IIB+H2 T6...T1 CL I, ZN 1, Ex db ia IIB+H2 T6...T1 | ZN21, Ex ia tb IIIC T80°C |
| | See handbook for temperature class information and installation drawing 3KXF000028G0009 | |
| FCa4c – F1efghijY Sensor in remote mount design with dual-compartment housing Design in accordance with ANSI / ISA 12.27.01 as 'Single Seal Device' or as 'Dual Seal Device' (option TE2). | XP-IS: CL I, Div 1, GPS BCD T6...T1 CL I, ZN 1, AEx db ia IIB+H2 T6...T1 CL I, ZN 1, Ex db ia IIB+H2 T6...T1 | DIP: CL II,III, Div 1, GPS EFG, T6 ZN 21, AEx ia tb IIIC T80°C ZN21, Ex ia tb IIIC T80°C |
| | See handbook for temperature class information and installation drawing 3KXF000028G0009 | |
| FCT4c – F1Rx (x = 1 to 4) Transmitter in remote mount design with dual-compartment housing | XP-IS: CL I, Div 1, GPS BCD, T6...T1 (USA) DIP: CL II,III, Div 1, GPS EFG, T6 | XP-IS: CL I, Div 1, GPS BCD, T6...T1 (CAN) ZN 21, AEx ia tb IIIC T80°C |
| FCT4c – F1Rx (x = 5 to 8) Sensor in remote mount design with dual-compartment housing (Explosionproof 'XP'). | CL I, ZN 1, AEx db ia IIB+H2 T6...T1 CL I, ZN 1, Ex db ia IIB+H2 T6...T1 | ZN21, Ex ia tb IIIC T80°C |
| | See handbook for temperature class information and installation drawing 3KXF000028G0009 | |
| FCT4c – F1Rx (x = 1 to 4) fghM6 or DRH or DSH option card Transmitter in remote mount design with dual-compartment housing | XP-IS: CL I, Div 1, GPS BCD, T6...T1 (USA) DIP: CL II,III, Div 1, GPS EFG, T6 | XP-IS: CL I, Div 1, GPS BCD, T6...T1 (CAN) ZN 21, AEx tb IIIC T80°C |
| FCT4c – F1Rx (x = 5 to 8) fghM6 or DRH or DSH option card Sensor in remote mount design with dual-compartment housing (Explosionproof 'XP'). | CL I, ZN 1, AEx db IIB+H2 T6...T1 CL I, ZN 1, Ex db IIB+H2 T6...T1 | ZN21, Ex tb IIIC T80°C |
| | See handbook for temperature class information and installation drawing 3KXF000028G0009 | |

Note

- Depending on the design, a specific marking in accordance with FM applies.
- ABB reserves the right to modify the Ex-marking. Refer to the name plate for the exact marking.


Temperature data

Temperature resistance for the connecting cable

The temperature at the cable entries of the device depends on the design, the measuring medium temperature T_{medium} and the ambient temperature $T_{\text{amb.}}$.


For the electric connection of the device, use only cables with sufficient temperature resistance in accordance with the following table.

Devices in integral mount design with dual-compartment housing




| $T_{\text{amb.}}$ | Temperature resistance |
|--|--|
| $\leq 50\text{ °C}$ ($\leq 122\text{ °F}$) | $\geq 70\text{ °C}$ ($\geq 158\text{ °F}$) |
| $\leq 60\text{ °C}$ ($\leq 140\text{ °F}$) | $\geq 80\text{ °C}$ ($\geq 176\text{ °F}$) |
| $\leq 70\text{ °C}$ ($\leq 158\text{ °F}$) | $\geq 90\text{ °C}$ ($\geq 194\text{ °F}$) |

Devices in integral mount design with single-compartment housing



| $T_{\text{amb.}}$ | Temperature resistance |
|--|--|
| $\leq 50\text{ °C}$ ($\leq 122\text{ °F}$) | $\geq 75\text{ °C}$ ($\geq 167\text{ °F}$) |
| $\leq 60\text{ °C}$ ($\leq 140\text{ °F}$) | $\geq 85\text{ °C}$ ($\geq 185\text{ °F}$) |
| $\leq 70\text{ °C}$ ($\leq 158\text{ °F}$) | $\geq 95\text{ °C}$ ($\geq 203\text{ °F}$) |

Sensor in remote mount design




| $T_{\text{amb.}}$ | Temperature resistance |
|--|---|
| $\leq 50\text{ °C}$ ($\leq 122\text{ °F}$) | $\geq 105\text{ °C}$ ($\geq 221\text{ °F}$) |
| $\leq 60\text{ °C}$ ($\leq 140\text{ °F}$) | $\geq 110\text{ °C}$ ($\geq 230\text{ °F}$) |
| $\leq 70\text{ °C}$ ($\leq 158\text{ °F}$) | $\geq 120\text{ °C}$ ($\geq 248\text{ °F}$) |

For sensors in remote mount design, the wires in the connection box must be additionally insulated with the enclosed silicone hoses starting from ambient temperatures of $T_{\text{amb.}} \geq 60\text{ °C}$ ($\geq 140\text{ °F}$).

... Use in potentially explosive atmospheres

... Temperature data

Measuring medium temperature for sensors in remote mount design



Model FCx4xx-A1..., Model FCx4xx-U1... and FCx4xx-F1... in Zone 1

The table shows the maximum permissible measuring medium temperature as a function of ambient temperature and temperature class.

| Ambient temperature T_{amb} | Temperature class | | | | | |
|--|-------------------|-----------------|-----------------|-----------------|----------------|----------------|
| | T1 | T2 | T3 | T4 | T5 | T6 |
| $\leq 30\text{ °C}$ ($\leq 86\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F) | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) |
| $\leq 40\text{ °C}$ ($\leq 104\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F) | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) |
| $\leq 50\text{ °C}$ ($\leq 122\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F) | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) |
| $\leq 60\text{ °C}$ ($\leq 140\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F) | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) |
| $\leq 70\text{ °C}$ ($\leq 158\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F) | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) |


Model FCx4xx-A2..., Model FCx4xx-U2... and FCx4xx-F2... in Zone 2, Division 2

The table shows the maximum permissible measuring medium temperature as a function of ambient temperature and temperature class.

| Ambient temperature T_{amb} | Temperature class | | | | | |
|--|-------------------|------------------|------------------|------------------|-----------------|----------------|
| | T1 | T2 | T3 | T4 | T5 | T6 |
| $\leq 30\text{ °C}$ ($\leq 86\text{ °F}$) | 205 °C (400 °F)* | 205 °C (400 °F)* | 195 °C (383 °F)* | 130 °C (266 °F)* | 95 °C (203 °F)* | 80 °C (176 °F) |
| | 195 °C (383 °F) | 195 °C (383 °F) | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) | |
| $\leq 40\text{ °C}$ ($\leq 104\text{ °F}$) | 205 °C (400 °F)* | 205 °C (400 °F)* | 195 °C (383 °F)* | 130 °C (266 °F)* | 95 °C (203 °F)* | — |
| | 180 °C (356 °F) | 180 °C (356 °F) | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) | |
| $\leq 50\text{ °C}$ ($\leq 122\text{ °F}$) | 205 °C (400 °F)* | 205 °C (400 °F)* | 130 °C (266 °F)* | 130 °C (266 °F)* | 80 °C (176 °F)* | — |
| | 140 °C (284 °F) | 140 °C (284 °F) | 130 °C (266 °F) | 95 °C (203 °F) | 60 °C (140 °F) | |
| $\leq 60\text{ °C}$ ($\leq 140\text{ °F}$) | 205 °C (400 °F)* | 205 °C (400 °F)* | 130 °C (266 °F)* | 130 °C (266 °F)* | — | — |
| | 120 °C (248 °F) | 120 °C (248 °F) | 120 °C (248 °F) | 95 °C (203 °F) | | |
| $\leq 70\text{ °C}$ ($\leq 158\text{ °F}$) | 180 °C (356 °F)* | 180 °C (356 °F)* | 130 °C (266 °F)* | 130 °C (266 °F)* | — | — |
| | 80 °C (176 °F) | 80 °C (176 °F) | 80 °C (176 °F) | 80 °C (176 °F) | | |

* Only with the 'Extended tower length – TE1, TE2 or TE3' order option

Measuring medium temperature for sensors in integral mount design with dual-compartment housing



Model FCx4xx-A1..., Model FCx4xx-U1... and FCx4xx-F1... in Zone 1, Division 1

The table shows the maximum permissible measuring medium temperature as a function of ambient temperature and temperature class.

| Ambient temperature T_{amb} | Temperature class | | | | | |
|--|-------------------|------------------|------------------|-----------------|----------------|----------------|
| | T1 | T2 | T3 | T4 | T5 | T6 |
| $\leq 30\text{ °C}$ ($\leq 86\text{ °F}$) | 205 °C (400 °F)* | 205 °C (400 °F)* | 195 °C (383 °F)* | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) |
| | 130 °C (266 °F) | 130 °C (266 °F) | 130 °C (266 °F) | | | |
| $\leq 40\text{ °C}$ ($\leq 104\text{ °F}$) | 205 °C (400 °F)* | 205 °C (400 °F)* | 195 °C (383 °F)* | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) |
| | 130 °C (266 °F) | 130 °C (266 °F) | 130 °C (266 °F) | | | |
| $\leq 50\text{ °C}$ ($\leq 122\text{ °F}$) | 205 °C (400 °F)* | 205 °C (400 °F)* | 195 °C (383 °F)* | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) |
| | 130 °C (266 °F) | 130 °C (266 °F) | 130 °C (266 °F) | | | |
| $\leq 60\text{ °C}$ ($\leq 140\text{ °F}$) | 205 °C (400 °F)* | 205 °C (400 °F)* | 195 °C (383 °F)* | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) |
| | 130 °C (266 °F) | 130 °C (266 °F) | 130 °C (266 °F) | | | |
| $\leq 70\text{ °C}$ ($\leq 158\text{ °F}$) | 205 °C (400 °F)* | 205 °C (400 °F)* | 195 °C (383 °F)* | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) |
| | 130 °C (266 °F) | 130 °C (266 °F) | 130 °C (266 °F) | | | |

* Only with the 'Extended tower length – TE1, TE2 or TE3' order option

Model FCx4xx-A2..., Model FCx4xx-U2... and FCx4xx-F2... in Zone 2, Division 2

The table shows the maximum permissible measuring medium temperature as a function of ambient temperature and temperature class.


| Ambient temperature T_{amb} | Temperature class | | | | | |
|--|-------------------|------------------|------------------|-----------------|----------------|-----------------------------------|
| | T1 | T2 | T3 | T4 | T5 | T6 |
| $\leq 30\text{ °C}$ ($\leq 86\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F)* | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F)* 50 °C (122 °F) |
| | | | | | | |
| $\leq 40\text{ °C}$ ($\leq 104\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F)* | 130 °C (266 °F) | 95 °C (203 °F) | — |
| $\leq 50\text{ °C}$ ($\leq 122\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F)* | 130 °C (266 °F) | — | — |
| $\leq 60\text{ °C}$ ($\leq 140\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F)* | 130 °C (266 °F) | — | — |
| $\leq 70\text{ °C}$ ($\leq 158\text{ °F}$) | 205 °C (400 °F)* | 205 °C (400 °F)* | 195 °C (383 °F)* | 130 °C (266 °F) | — | — |
| | 130 °C (266 °F) | 130 °C (266 °F) | 130 °C (266 °F) | | | |

* Only with the 'Extended tower length – TE1, TE2 or TE3' order option

... Use in potentially explosive atmospheres

... Temperature data

Measuring medium temperature for sensors in integral mount design with single-compartment housing



Model FCx4xx-A2..., Model FCx4xx-U2... and FCx4xx-F2... in Zone 2, Division 2



The table shows the maximum permissible measuring medium temperature as a function of ambient temperature and temperature class.


| Ambient temperature T_{amb} | Temperature class | | | | | |
|--|-------------------|-----------------|-----------------|-----------------|----------------|----------------|
| | T1 | T2 | T3 | T4 | T5 | T6 |
| $\leq 30\text{ °C}$ ($\leq 86\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F) | 130 °C (266 °F) | 95 °C (203 °F) | 80 °C (176 °F) |
| $\leq 40\text{ °C}$ ($\leq 104\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F) | 130 °C (266 °F) | 95 °C (203 °F) | — |
| $\leq 50\text{ °C}$ ($\leq 122\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F) | 130 °C (266 °F) | 95 °C (203 °F) | — |
| $\leq 60\text{ °C}$ ($\leq 140\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F) | 130 °C (266 °F) | — | — |
| $\leq 70\text{ °C}$ ($\leq 158\text{ °F}$) | 205 °C (400 °F) | 205 °C (400 °F) | 195 °C (383 °F) | 130 °C (266 °F) | — | — |

* Only with the 'Extended tower length – TE1, TE2 or TE3' order option

Electrical data

| Standard / No explosion protection | Zone 2, 21 Division 2 and Zone 2, 21 | Zone 1, 21 (Zone 0) Division 2 and Zone 1, 21 |
|------------------------------------|---|--|
| ATEX: – | ATEX / UKEX: II 3 G & II 2 D | ATEX / UKEX: II 1/2 (1) G & II 2 (1) D |
| IECEX: – | IECEX: Gc & Db | IECEX: II 1/2 G & II 2 D II 2 (1) G & II 2 (1) D IECEX: (Ga) Gb & (Da) Db Ga/Gb & Db (Ga) Gb & (Da) Db |
| USA: – | USA: NI & DIP | USA: XP-IS & DIP |
| Canada: – | Canada: AEx ec & AEx tb Non-Incendive & Dust Ignition Proof Ex ec & Ex tb | Canada: AEx db ia & AEx ia tb XP-IS & DIP Ex db ia & Ex ia tb |

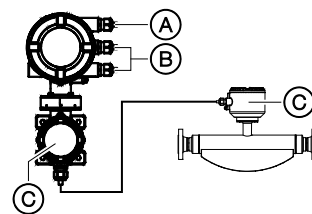

| (A) Power supply | (B) Inputs / outputs, communication | (C) Signal cable (remote mount design only) |
|--|---|---|
| <ul style="list-style-type: none"> Type of protection ATEX / UKEX / IECEx: Increased safety 'Ex e' Type of protection USA / Canada: 'non IS' Maximum 250 Vrms Terminals: 1+, 2-, L, N,  | <ul style="list-style-type: none"> Type of protection ATEX / UKEX / IECEx: Either increased safety 'Ex e' or intrinsically safe 'Ex ia' Type of protection USA / Canada: Either 'non IS' or 'intrinsically safe IS'. When installing in 'Ex ia' or 'IS', suitable intrinsically safe isolation amplifiers must be used for the connection. Terminals: 31, 32, Uco, V1, V2, V3, V4, 41, 42, 51, 52 | <ul style="list-style-type: none"> Terminals: A, B, UFE, GRN Type of protection ATEX / UKEX / IECEx: Increased safety 'Ex e' Type of protection USA / Canada: 'non IS' |

Note

When installing in 'Ex ia' or 'IS' type of protection, the type of protection is determined by the type of electrical connection. The information in **Changing the type of protection** in the operating instruction on page 106 must be observed when changing the type of protection!

... Use in potentially explosive atmospheres

... Electrical data

Zone 2, 21 and Division 2 – Model: FCx4xx-A2..., FCx4xx-U2... and FCx4xx-F2...

| Outputs on basic device | Operating values (general) | | Type of protection – 'nA' / 'NI' | |
|--|----------------------------|-------|----------------------------------|-------|
| | U_N | I_N | U_N | I_N |
| Current / HART output 31 / U_{CO}, active Terminals 31 / U_{CO} | 30 V | 30 mA | 30 V | 30 mA |
| Current / HART output 31 / 32, passive Terminals 31 / 32 | 30 V | 30 mA | 30 V | 30 mA |
| Digital output 41 / 42, active* Terminals 41 / 42 and V1 / V2* | 30 V | 30 mA | 30 V | 30 mA |
| Digital output 41 / 42, active** Terminals 41 / 42 and U_{CO} / 32** | 30 V | 30 mA | 30 V | 30 mA |
| Digital output 41 / 42, passive Terminals 41 / 42 | 30 V | 25 mA | 30 V | 25 mA |
| Digital output 51 / 52, active* Terminals 51 / 52 and V1 / V2* | 30 V | 30 mA | 30 V | 30 mA |
| Digital output 51 / 52, passive Terminals 51 / 52 | 30 V | 30 mA | 30 V | 30 mA |

All outputs are electrically isolated from each other and from the power supply.

Digital outputs 41 / 42 and 51 / 52 are not electrically isolated from each other. Terminals 42 / 52 have the same potential.

* Only in conjunction with additional '24 V DC loop power supply (blue)' plug-in card in slot OC1.

** Only in conjunction with current output U_{CO} / 32 in 'Powermode', see **Current output U_{CO} / 32 as loop power supply for digital output 41 / 42 or 51 / 52** on page 72.

| Inputs and outputs with optional plug-in cards | Operating values (general) | | Type of protection – 'nA' / 'NI' | |
|---|----------------------------|---------|----------------------------------|---------|
| | U_N | I_N | U_N | I_N |
| Current output V3 / V4, active* Terminals V3 / V4 and V1 / V2* | 30 V | 30 mA | 30 V | 30 mA |
| Current output V1 / V2, passive** | 30 V | 30 mA | 30 V | 30 mA |
| Current output V3 / V4, passive** Terminals V1 / V2** or V3 / V4** | | | | |
| Digital output V3 / V4, active* Terminals V3 / V4 and V1 / V2* | 30 V | 25 mA | 30 V | 25 mA |
| Digital output V1 / V2, passive** | 30 V | 30 mA | 30 V | 30 mA |
| Digital output V3 / V4, passive** Terminals V1 / V2** or V3 / V4** | | | | |
| Digital input V3 / V4, active* Terminals V3 / V4 and V1 / V2 | 30 V | 3,45 mA | 30 V | 3,45 mA |
| Digital input V1 / V2, passive** | 30 V | 3,45 mA | 30 V | 3,45 mA |
| Digital input V3 / V4, passive** Terminals V1 / V2** or V3 / V4** | | | | |
| Digital output V1 / V2, active* | 24 V | 22,5 mA | 30 V | 30 mA |
| Digital output V3 / V4, active* Terminals V1 / V2** or V3 / V4** | | | | |
| Modbus® / PROFIBUS DP® Terminals V1 / V2 | 30 V | 30 mA | 30 V | 30 mA |
| Ethernet card Ethernet (various protocols) Port 1 / Port 2 | 57 V | 417 mA | 57 V | 417 mA |
| Ethernet card in connection with Power over Ethernet (POE card) Ethernet (various protocols) Port 1 / Port 2 | 57 V | 417 mA | 57 V | 417 mA |

* Only in conjunction with additional '24 V DC loop power supply (blue)' plug-in card in slot OC1.

** The terminal assignment depends on the model number or the slot assignments. For connection examples, see **Connection examples** on page 76.

... Use in potentially explosive atmospheres

... Electrical data

Zone 1 ,21 and Division 1 – Model: FCx4xx-A1..., FCx4xx-U1... and FCx4xx-F1...

| Type of protection | 'e' / 'XP' | | 'ia' / 'IS' | | | | | | | | | | | |
|--|-----------------------|-----------------------|-----------------------|-----------------------|------------------------|------------------------|------------------------|------------------------|------------------------|------------------------|--------------------------|--------------------------|------------------------|------------------------|
| | U _M [V] | I _M [A] | U _O [V] | U _I [V] | I _O [mA] | I _I [mA] | P _O [mW] | P _I [mW] | C _O [nF] | C _I [nF] | C _{OPA} [nF] | C _{IPA} [nF] | L _O [mH] | L _I [mH] |
| Current / HART output 31 / U_{CO}, active Terminals 31 / U _{CO} | 30 | 0.2 | 30 | 30 | 115 | 115 | 815 | 815 | 10 | 10 | 5 | 5 | 0.08 | 0.08 |
| Current / HART output 31 / 32, passive Terminals 31 / 32 | 30 | 0.2 | — | 30 | — | 115 | — | 815 | — | 27 | — | 5 | 0.08 | 0.08 |
| Digital output 41 / 42, active* Terminals 41 / 42 and V1 / V2* | 30 | 0.1 | 27.8 | 30 | 119 | 30 | 826 | 225 | 20 | 20 | 29 | 29 | 0.22 | 0.22 |
| Digital output 41 / 42, active** Terminals 41 / 42 and U _{CO} / 32** | 30 | 0.1 | 30 | 30 | 115 | 115 | 826 | 225 | 16 | 16 | 10 | 10 | 0.08 | 0.08 |
| Digital output 41 / 42, passive Terminals 41 / 42 | 30 | 0.1 | — | 30 | — | 30 | — | 225 | — | 27 | — | 5 | — | 0.08 |
| Digital output 51 / 52, active* Terminals 51 / 52 and V1 / V2* | 30 | 0.1 | 27.8 | 30 | 119 | 30 | 826 | 225 | 20 | 20 | 29 | 29 | 0.22 | 0.22 |
| Digital output 51 / 52, passive Terminals 51 / 52 | 30 | 0.1 | — | 30 | — | 30 | — | 225 | — | 27 | — | 5 | — | 0.08 |

All outputs are electrically isolated from each other and from the power supply.

Digital outputs 41 / 42 and 51 / 52 are not electrically isolated from each other. Terminals 42 / 52 have the same potential.

* Only in conjunction with additional '24 V DC loop power supply (blue)' plug-in card in slot OC1.

** Only in conjunction with current output U_{CO} / 32 in 'power mode', see **Current output U_{CO} / 32 as loop power supply for digital output 41 / 42 or 51 / 52** on page 72.

| Type of protection | 'e' / 'XP' | | 'ia' / 'IS' | | | | | | | | | | | |
|--|-----------------------|-----------------------|-----------------------|-----------------------|------------------------|------------------------|------------------------|------------------------|------------------------|------------------------|--------------------------|--------------------------|------------------------|------------------------|
| | U _M [V] | I _M [A] | U _O [V] | U _I [V] | I _O [mA] | I _I [mA] | P _O [mW] | P _I [mW] | C _O [nF] | C _I [nF] | C _{OPA} [nF] | C _{IPA} [nF] | L _O [mH] | L _I [mH] |
| Inputs and outputs with optional plug-in cards | | | | | | | | | | | | | | |
| Current output V3 / V4, active* Terminals V3 / V4 and V1 / V2* | 30 | 0.1 | 27.8 | 30 | 119 | 30 | 826 | 225 | 29 | 29 | 117 | 117 | 0.4 | 0.4 |
| Current output V1 / V2, passive** | | | | | | | | | | | | | | |
| Current output V3 / V4, passive** Terminals V1 / V2** or V3 / V4** | 30 | 0.1 | — | 30 | — | 68 | — | 510 | — | 45 | — | 59 | — | 0.27 |
| Digital output V3 / V4, active* Terminals V3 / V4 and V1 / V2* | 30 | 0.1 | 27.8 | 30 | 119 | 68 | 826 | 225 | 17 | 17 | 31 | 31 | 0.4 | 0.4 |
| Digital output V1 / V2, passive** | | | | | | | | | | | | | | |
| Digital output V3 / V4, passive** Terminals V1 / V2** or V3 / V4** | 30 | 0.1 | — | 30 | — | 30 | — | 225 | — | 13 | — | 16 | — | 0.27 |
| Digital input V3 / V4, active* Terminals V3 / V4 and V1 / V2 | 30 | 0.1 | 27.8 | 30 | 119 | 3.45 | 826 | 25.8 | 17 | 17 | 31 | 31 | 0.4 | 0.4 |
| Digital output V1 / V2, active*** | | | | | | | | | | | | | | |
| Digital output V3 / V4, active*** Terminals V1 / V2** or V3 / V4 | 30 | 0.7 | — | — | — | — | — | — | — | — | — | — | — | — |
| Digital input V1 / V2, passive* | | | | | | | | | | | | | | |
| Digital input V3 / V4, passive* Terminals V1 / V2** or V3 / V4** | 30 | 0.1 | — | 30 | — | 3.45 | — | 25.8 | — | 13 | — | 16 | — | 0.27 |
| Modbus® / PROFIBUS DP® Terminals V1 / V2 | 30 | 0.1 | 4.2 | 4.2 | 150 | 150 | 150 | 150 | 5300 | 5300 | 0.06 | 0.06 | 0.14 | 0.14 |

* Only in conjunction with additional '24 V DC loop power supply (blue)' plug-in card in slot OC1.

** The terminal assignment depends on the model number or the slot assignments. For connection examples, see **Connection examples** on page 76.

*** Not available as intrinsically safe version.

... Use in potentially explosive atmospheres

... Electrical data

Special connection conditions

Note

The AS plug-in card (24 V DC power supply) must only be used to power the internal inputs and outputs on the device. It must not be used to power external circuits!

Note

If the protective earth (PE) is connected in the flowmeter's terminal box, you must ensure that no dangerous potential difference can arise between the protective earth (PE) and the potential equalization (PA) in areas with explosion risk.

Note

For devices with a power supply of 11 to 30 V DC, on-site external overvoltage protection must be provided. It must be ensured that the overvoltage is limited to 140 % (= 42 V DC) of the maximum operating voltage.

The output circuits are designed so that they can be connected to both intrinsically-safe and non-intrinsically-safe circuits.

- Combining intrinsically safe and non-intrinsically safe circuits is not permitted.
- On intrinsically safe circuits, potential equalization should be established along the entire length of the cable used for the signal outputs.
- The rated voltage of the non-intrinsically safe circuits is $U_M = 30 \text{ V}$.
- Intrinsic safety is preserved If the rated voltage $U_M = 30 \text{ V}$ is not up-scaled when connections are established to non-intrinsically safe external circuits.
- The information in **Changing the type of protection** in the operating instruction on page 106 must be observed when changing the type of protection.

The concept of intrinsic safety allows several approved intrinsically safe devices to be interconnected without additional intrinsic safety installation checks, if the relevant installation standards are observed.

Devices connected to the relevant equipment must not be operated at over 250 V_{rms} AC or 250 V DC to ground.

Installation in accordance with ATEX, UKEX, IECEx or EAC-Ex must comply with the applicable national and international standards and directives.

Installation in the USA or Canada must comply with ANSI / ISA RP 12.6, 'Installation of intrinsically safe systems for hazardous (classified) locations', the 'National Electrical Code (ANSI / NFPA 70), sections 504, 505' and the 'Canadian electrical code (C22.1-02)'.

Apparatus connected to the flowmeter must have appropriate explosion protection approval in accordance with the Entity concept.

The apparatus must have intrinsically safe circuits.

The apparatus must be installed and connected in accordance with the relevant manufacturer documentation. The electrical specifications in **Electrical data** on page 97 must be observed.

Ethernet communication

DANGER

Explosion hazard due to improper installation!

Ethernet Option Cards are designed only for use in hazardous applications Zone 2 / Division 2.

The output circuits are designed so that different topologies such as daisy chain or point to point can be connected. See Installation diagram for detailed information.

- It is not permitted to combine both topologies.
- Ethernet communication is only available for installations in Zone 2/Division 2.
- The rated voltage of these non-intrinsically safe circuits are $U_M = 57 \text{ V}$.

Active digital output

DANGER

Risk of injury caused by live parts!

Option cards for the active digital output are intended only for use in potentially explosive atmospheres as the 'increased safety' (Ex-e) IP rating and therefore may not be used as an intrinsically safe circuit.

If these optional active plug-in cards are used in combination with other option cards, all the option cards used and all pre-installed output current circuits must also use the 'Increased safety' (Ex-e) IP rating.

The option of changing of IP rating is not permitted in connection with Active Pulse option cards.

Use in hazardous areas in accordance with EAC TR-CU-012

Note

- An additional document with information on EAC-Ex certification is available for measuring systems that are used in potentially explosive atmospheres in accordance with EAC TR-CU-012.
- The information on EAC-Ex certification is an integral part of this instruction. As a result, it is crucial that the installation guidelines and connection values it lists are also observed. The icon on the name plate indicates the following:



Information on EAC-Ex certification is available for free download at the following link. Alternatively simply scan the QR code.



<INF/FCX100/FCX400/EAC-Ex-X8>

Questionnaire

| | |
|-------------------|--------------------|
| Customer: | Date: |
| Ms. / Mr.: | Department: |
| Telephone: | Fax: |

| | | |
|---|---|--|
| Measuring medium: | Liquid content: | Gas content: |
| Flow rate: (min., max., operating point) | kg/h | |
| Density: (min., max., operating point) | kg/m ³ | |
| Dynamic viscosity: (min., max., operating point) | mPas/cP | |
| Measuring medium temperature: (min., max., operating point) | °C | |
| Ambient temperature | °C | |
| Pressure: (min., max., operating point) | bar | |
| Rate of flow: | <input type="checkbox"/> Steady | <input type="checkbox"/> Pulsating |
| Batch operation: | <input type="checkbox"/> Yes | <input type="checkbox"/> No |
| Concentration calculation: | <input type="checkbox"/> Yes | <input type="checkbox"/> No |
| Transmitter design: | <input type="checkbox"/> Integral mount design | <input type="checkbox"/> Remote mount design |
| Explosion protection: | <input type="checkbox"/> Yes | <input type="checkbox"/> No |
| Power supply: | <input type="checkbox"/> 100 to 230 V AC, 50/60 Hz | <input type="checkbox"/> 11 to 30 V DC |
| Electrical outputs: | Communication: | |
| | <input type="checkbox"/> Current output I: 0/4 to 20 mA | <input type="checkbox"/> HART protocol |
| | <input type="checkbox"/> Current output II: 0/4 to 20 mA | |
| | <input type="checkbox"/> Current output III: 0/4 to 20 mA | |
| | <input type="checkbox"/> Pulse output, active | |
| | <input type="checkbox"/> Pulse output, passive | |
| Additional specifications: | | |
| Pipeline diameter: |mm | |
| Process connection: | | |

Trademarks

CIP (Common Industrial Protocol) is a trademark of ODVA Inc.

EtherNet/IP is a trademark of ODVA Inc.

HART is a registered trademark of FieldComm Group, Austin, Texas, USA

Hastelloy is a registered trademark of Haynes International, Inc.

Modbus is a registered trademark of Schneider Automation Inc.

PROFIBUS®, PROFIBUS DP® and PROFINET® are registered trademarks of PROFIBUS & PROFINET International (PI)

Sales



Service





ABB Measurement & Analytics

For your local ABB contact, visit:

www.abb.com/contacts

For more product information, visit:

www.abb.com/flow

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail. ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB.