

Technical Information

Liquiphant FTL51B

Vibronic
HART



Point level switch for liquids

Application

- Point level switch for minimum or maximum detection in tanks, vessels and pipes with all kinds of liquids, even in hazardous areas
- Process temperature range: -50 to $+150$ °C (-58 to $+302$ °F)
- Pressures up to 100 bar (1 450 psi)
- Viscosities up to 10 000 mPa·s
- Ideal substitute for float switches; reliable function is not affected by flow, turbulence, air bubbles, foam, vibration, solids content or buildup

Advantages

- Approved for safety systems with functional safety requirements up to SIL2/SIL3 in accordance with IEC 61508
- Function safety: monitoring of the oscillation frequency of the tuning fork
- Heartbeat Technology via Fieldcare/DTM and the free iOS/Android SmartBlue app
- Measuring device with *Bluetooth*® wireless technology

Table of contents

About this document	4	Humidity	17
Symbols	4	Operating height	17
Function and system design	5	Climate class	17
point level detection	5	Degree of protection	17
Measuring principle	5	Vibration resistance	18
Measuring system	5	Shock resistance	18
Dependability for measuring devices with HART or		Mechanical load	18
Bluetooth	5	Pollution degree	18
		Electromagnetic compatibility (EMC)	18
Input	5	Process	18
Measured variable	5	Process temperature range	18
Measuring range	5	Thermal shock	18
		Process pressure range	18
Output	6	Overpressure limit	19
Output signal	6	State of aggregation	19
Signal on alarm	6	Medium density	19
Load	6	Viscosity	19
Damping	6	Pressure tightness	19
Switch output	7	Solids contents	19
Ex connection data	7	Mechanical construction	20
Protocol-specific data	7	Design, dimensions	20
Wireless HART data	8	Dimensions	20
Heartbeat Technology	8	Weight	28
		Materials	28
Power supply	8	Surface roughness	29
Terminal assignment	8	Operability	29
Available device plugs	9	Operating concept	29
Supply voltage	9	Languages	30
Potential equalization	10	Local operation	30
Terminals	10	Local display	31
Cable entries	10	Remote operation	31
Cable specification	10	System integration	31
Overvoltage protection	10	Supported operating tools	31
		HistoROM data management	31
Performance characteristics	11	Certificates and approvals	31
Reference operating conditions	11	Ordering information	32
Maximum measured error	11	TAG	32
Resolution	11	Test reports, declarations and inspection certificates	32
Dead time, time constant, settling time	11	Application packages	32
Dynamic behavior, current output	11	Heartbeat Technology module	32
Dynamic behavior, digital output	12	Heartbeat Diagnostics	33
Hysteresis	12	Heartbeat Verification	33
Non-repeatability	12	Heartbeat Monitoring	33
Influence of the process temperature	12	Proof testing	33
Influence of the process pressure	12	Accessories	33
Influence of the density of the process medium (at room		Device Viewer	33
temperature and normal pressure)	12	Weather protection cover for dual compartment housing ..	33
		Weather protection cover for single compartment	
Mounting	13	housing, aluminum	34
Mounting location, orientation	13	Plug-in jack	34
Installation instructions	13		
Special mounting instructions	15		
Environment	16		
Ambient temperature range	16		
Storage temperature	17		

Sliding sleeves for unpressurized operation 35

High pressure sliding sleeves 36

Supplementary documentation 37

Standard documentation 37

Supplementary device-dependent documentation 37

Registered trademarks 37

About this document

Symbols

Safety symbols



This symbol alerts you to a dangerous situation. Failure to avoid this situation will result in serious or fatal injury.



This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in serious or fatal injury.



This symbol alerts you to a dangerous situation. Failure to avoid this situation can result in minor or medium injury.



This symbol contains information on procedures and other facts which do not result in personal injury.

Electrical symbols



Ground connection

Grounded clamp, which is grounded via a grounding system.



Protective earth (PE)

Ground terminals, which must be grounded prior to establishing any other connections. The ground terminals are located on the inside and outside of the device.

Symbols for certain types of information



Permitted

Procedures, processes or actions that are permitted.



Forbidden

Procedures, processes or actions that are forbidden.



Tip

Indicates additional information



Reference to documentation



Reference to another section



1., 2., 3. Series of steps

Symbols in graphics



A, B, C ... View

1, 2, 3 ... Item numbers

Function and system design

point level detection	<p>Maximum or minimum detection for liquids in tanks or pipes in all industries. Suitable for leakage monitoring, pump dry-running protection or overflow prevention, for example .</p> <p>Specific versions are suitable for use in hazardous areas.</p> <p>The point level switch differentiates between the "covered" and "not covered" conditions.</p> <p>Depending on the MIN (minimum detection) or MAX (maximum detection) modes, there are two possibilities in each case: OK status and demand mode.</p> <p>OK status</p> <ul style="list-style-type: none">■ In MIN mode, the fork is covered, e.g. Pump dry running protection■ In MAX mode, the fork is not covered e.g. overflow prevention <p>Demand mode</p> <ul style="list-style-type: none">■ In MIN mode, the fork is not covered e.g. pump dry running protection■ In MAX mode, the fork is covered e.g. overflow prevention
------------------------------	--

Measuring principle	<p>The sensor's tuning fork vibrates at its intrinsic frequency. As soon as the liquid covers the tuning fork, the vibration frequency decreases. The change in frequency causes the point level switch to switch.</p>
----------------------------	--

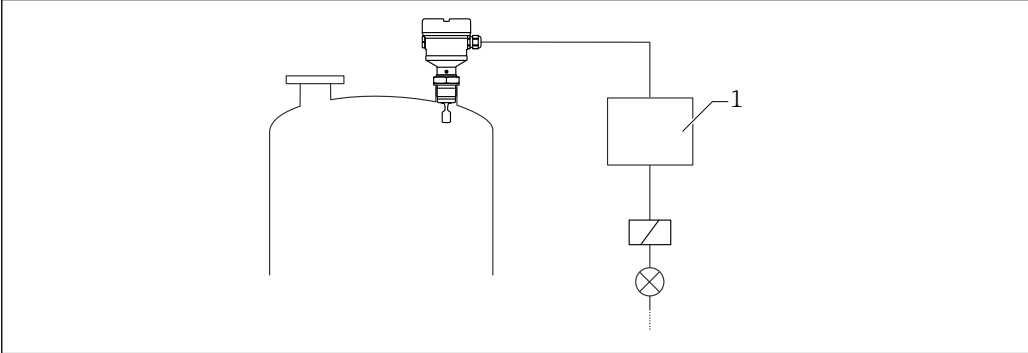Measuring system	<div><p>A schematic diagram of a measuring system. It shows a cylindrical tank with a sensor unit mounted on its top. A cable connects the sensor to a rectangular switching unit labeled '1'. Below the switching unit, a line leads to a valve symbol (a rectangle with a diagonal line), which is further connected to a light indicator symbol (a circle with a cross inside). The entire diagram is enclosed in a rectangular frame.</p></div> <p> 1 <i>Example of a measuring system</i></p> <p>1 <i>Switching unit, PLC etc.</i></p>
-------------------------	---

Dependability for measuring devices with HART or Bluetooth	<p>IT security</p> <p>Endress+Hauser can only provide a warranty if the device is installed and used as described in the Operating Instructions. The device is equipped with security mechanisms to protect it against any inadvertent changes to the device settings. IT security measures in line with operators' security standards and designed to provide additional protection for the device and device data transfer must be implemented by the operators themselves.</p> <p>Device-specific IT security</p> <p>The device offers specific functions to support protective measures by the operator. These functions can be configured by the user and guarantee greater in-operation safety if used correctly. An overview of the most important functions is provided in the following section:</p> <ul style="list-style-type: none">■ Write protection via hardware write protection switch■ Access code (applies for operation via display, Bluetooth, FieldCare, DeviceCare, AMS, PDM ...)
---	---

Input

Measured variable	Level (point level), MAX or MIN safety
Measuring range	Depends on the installation location and the pipe extension ordered Maximum sensor length 6 m (20 ft)

8/16 mA (SIO) with superimposed digital communication protocol HART, 2-wire

4 to 20 mA proportional to the oscillation frequency with superimposed digital communication protocol HART, 2-wire

- 4.0 to 20.5 mA
- NAMUR NE 43: 3.8 to 20.5 mA (factory setting)
- US mode: 3.9 to 20.8 mA


Signal on alarm in accordance with NAMUR recommendation NE 43.

- Max. alarm: can be set from 21.5 to 23 mA
- Min. alarm: < 3.6 mA (factory setting)



1 Power supply 10.5 to 30 V_{DC} Ex i
2 Power supply 10.5 to 35 V_{DC}, for other types of protection and for non-certified device versions
3 R_{Lmax} maximum load resistance
U Supply voltage

Damping

 Damping has no effect on the SIO.

Factory setting: 1 s

Switch output

Preset switching delay times can be ordered:

- 0.5 s when the tuning fork is covered and 1.0 s when the tuning fork is uncovered (factory setting)
- 0.25 s when the tuning fork is covered and 0.25 s when the tuning fork is uncovered (fastest setting)
- 1.5 s when the tuning fork is covered and 1.5 s when the tuning fork is uncovered
- 5.0 s when the tuning fork is covered and 5.0 s when the tuning fork is uncovered



The user can also set the switching delays for when the fork is covered and uncovered in the range from 1 to 60 seconds independently of one another.

(Operation via display, Bluetooth or FieldCare, DeviceCare, AMS, PDM)

Ex connection data

See safety instructions (XA): All data relating to explosion protection are provided in separate Ex documentation and are available from the Downloads Area of the Endress+Hauser-website. The Ex documentation is supplied as standard with all Ex devices.

Protocol-specific data**HART**

- Manufacturer ID: 17 (0x11)
- Device type code: 0x11C4
- Device revision: 1
- HART specification: 7
- DD revision: 1
- Device description files (DTM, DD) information and files at:
 - www.endress.com
 - www.fieldcommgroup.org
- HART load: min. 250 Ω

HART device variables (preset at the factory)

The following measured values are assigned to the device variables at the factory:

Device variable	Measured value
Primary variable (PV) parameter (Primary variable) ¹⁾	Point level detection ²⁾
Secondary variable (SV) parameter (Secondary variable)	Sensor frequency ³⁾
Tertiary variable (TV) parameter (Third variable)	Fork state ⁴⁾
Quaternary variable (QV) parameter (Quaternary variable)	Sensor temperature

- 1) The PV is always applied to the current output.
- 2) Point level detection is the initial state depending on the fork state (uncovered/covered) and the safety function (MIN/MAX)
- 3) Sensor frequency is the oscillation frequency of the fork
- 4) Fork state is the fork state (**Fork covered** option/**Fork uncovered** option)

Choice of HART device variables

- Level limit detection
- Sensor frequency
- Fork state
- Sensor temperature
- Terminal current

The terminal current is the read-back current on terminal block. Visibility depends on order options or device settings

- Terminal voltage
- Visibility depends on order options or device settings

Supported functions

- Burst mode
- Additional transmitter status
- Device locking

Wireless HART data

- Minimum start-up voltage: 10.5 V
- Start-up current: > 3.6 mA
- Start-up time: < 8 s
- Minimum operating voltage: 10.5 V
- Multidrop current: 4 mA


Heartbeat Technology**Heartbeat Technology module**


The software package consists of 3 modules. These three modules combined check, evaluate and monitor device functionality and process conditions.



- Heartbeat Diagnostics
- Heartbeat Verification
- Heartbeat Monitoring


Power supply

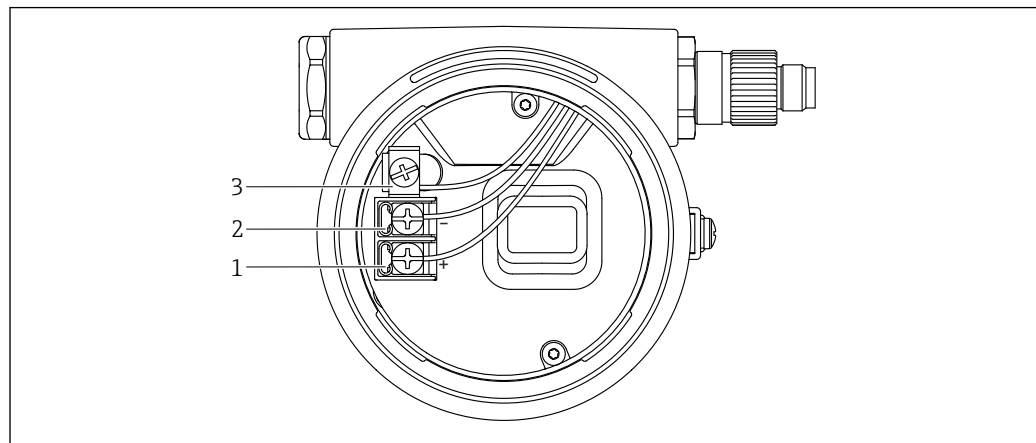Terminal assignment**Single compartment housing**

 3 Connection terminals and ground terminal in the connection compartment

- 1 Positive terminal
- 2 Negative terminal
- 3 Internal ground terminal

Dual-compartment housing, L-shape

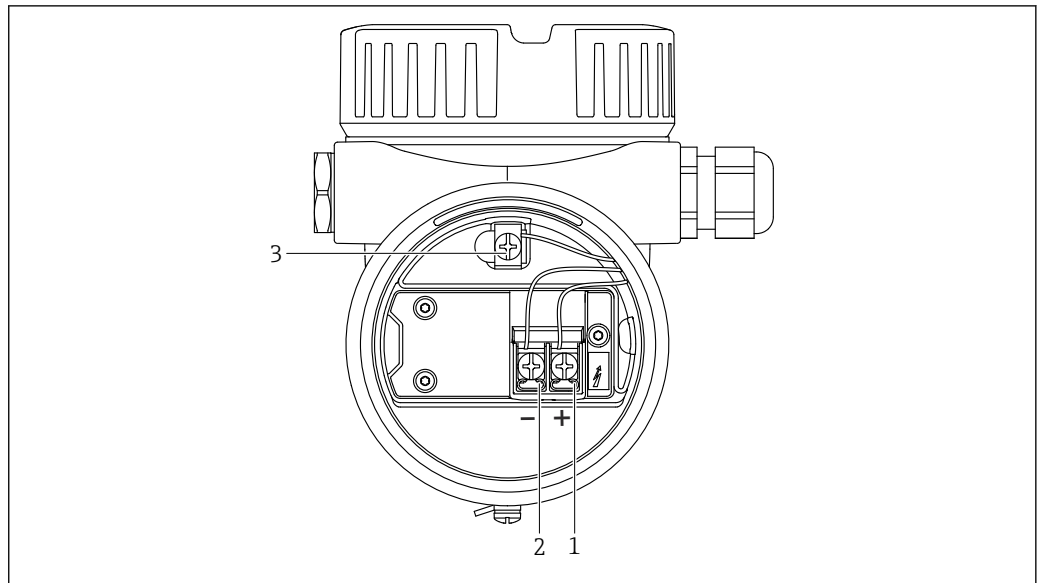

A0045842


4 Connection terminals and ground terminal in the connection compartment

- 1 Positive terminal
- 2 Negative terminal
- 3 Internal ground terminal

Available device plugs

i In the case of devices with a plug, it is not necessary to open the housing for connection purposes.

M12 plug

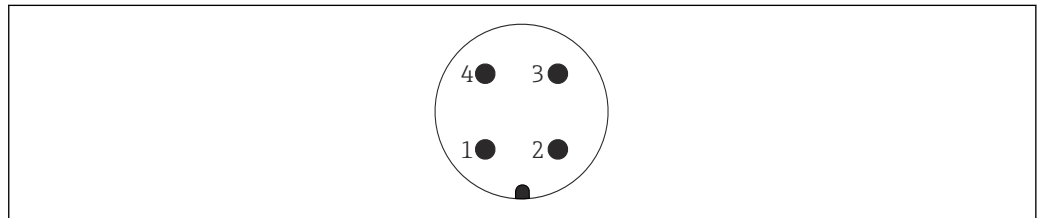

A0011175

5 M12 plug, pin assignment


- 1 Signal +
- 2 Not assigned
- 3 Signal -
- 4 Ground

A For more details, see the "Accessories" section.

Supply voltage

- $U = 10.5$ to $35 V_{DC}$ (Ex d, Ex e, non-Ex)
- $U = 10.5$ to $30 V_{DC}$ (Ex i)
- Rated current: 4 to 20 mA HART

- i**
 - The power unit must be tested to ensure it meets safety requirements (e.g. PELV, SELV, Class 2).
 - Comply with the following according to IEC/EN61010-1: provide a suitable circuit breaker for the device.

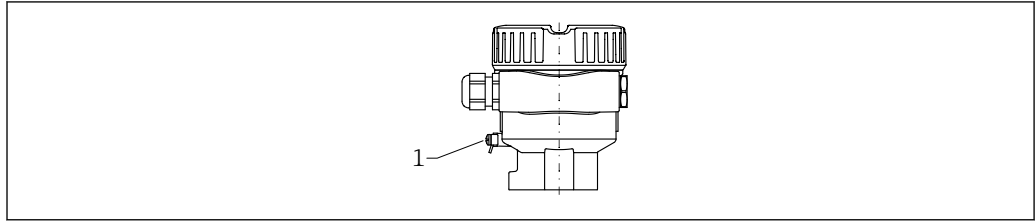Potential equalization

A0045830

1 Ground terminal for connecting the potential matching line


i If necessary, the potential matching line can be connected to the outer ground terminal of the transmitter before the device is connected.

i For optimum electromagnetic compatibility:

- Keep the potential matching line as short as possible
- Observe the minimum cross-section of 2.5 mm² (14 AWG)

Terminals

- Supply voltage and internal ground terminal: 0.5 to 2.5 mm² (20 to 14 AWG)
- External ground terminal: 0.5 to 4 mm² (20 to 12 AWG)

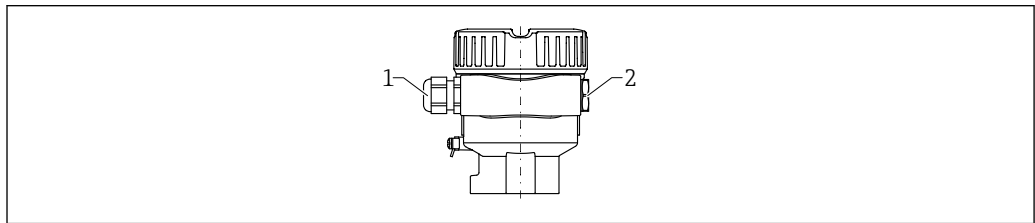Cable entries

A0045831

1 Cable entry
2 Dummy plug

The type of cable entry depends on the device version ordered.

Cable specification

- The cable outer diameter depends on the cable entry used
- Cable outer diameter
 - Plastic: Ø5 to 10 mm (0.2 to 0.38 in)
 - Nickel-plated brass: Ø7 to 10.5 mm (0.28 to 0.41 in)
 - Stainless steel: Ø7 to 12 mm (0.28 to 0.47 in)

Overvoltage protection**Devices without optional overvoltage protection**

Equipment from Endress+Hauser fulfills the requirements of the product standard IEC/DIN EN 61326-1 (Table 2 Industrial Environment).

Depending on the type of port (DC supply, input/output port) different test levels according to IEC/DIN EN 61326-1 against transient overvoltages (Surge) are applied (IEC/DIN EN 61000-4-5): Test level on DC power ports and input/output ports is 1 000 V line to earth

Devices with optional overvoltage protection

- Spark-over voltage: min. 400 V_{DC}
- Tested: According to IEC/DIN EN 60079-14 sub chapter 12.3 (IEC/DIN EN 60060-1 chapter 7)
- Nominal discharge current: 10 kA

Overvoltage category

Overvoltage category II

Pollution degree

Pollution degree 2


Performance characteristics


Reference operating conditions


- Ambient temperature: +23 °C (+73 °F)
- Process temperature: +23 °C (+73 °F)
- Medium density (water): 1 g/cm³
- Medium viscosity: 1 mPa·s
- Process pressure: ambient pressure/unpressurized
- Sensor installation: vertically and from above
- Density switch: > 0.7 g/cm³ (SGU)
- Switch direction of sensor: uncovered to covered

Take switch point into consideration

The following are typical switch points, depending on the orientation of the point level switch.
Water +23 °C (+73 °F)

 Minimum distance between the fork tip and the tank wall or pipe wall: 10 mm (0.39 in)

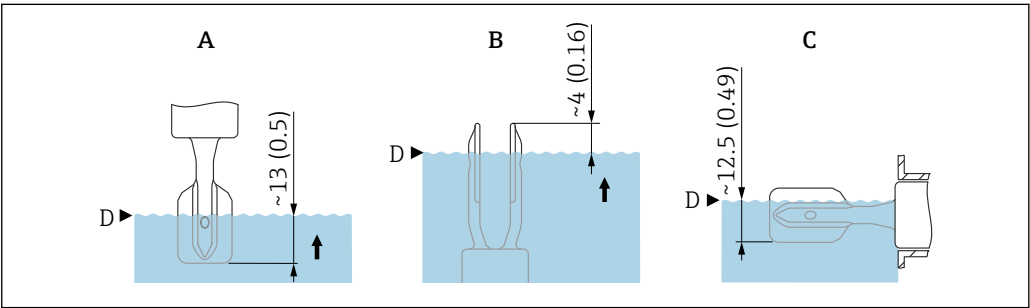

 6 Typical switch points. Unit of measurement mm (in)

- A Installation from above
- B Installation from below
- C Installation from the side
- D Switch point

Maximum measured error


At reference operating conditions: max. ± 1 mm (0.04 in) at switch point

Resolution

Current output: < 1 µA

Dead time, time constant, settling time

Presentation of the dead time, time constant and settling time as per DIN EN 61298-2

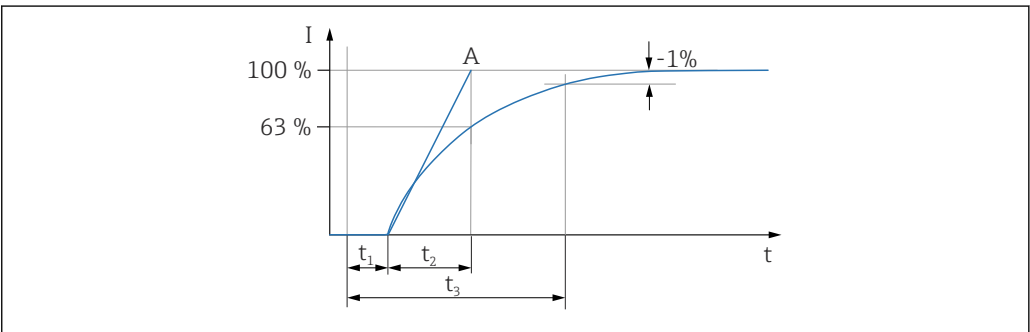

- t₁ Dead time
- t₂ Time constant
- t₃ Settling time
- A Stable full scale value

Dynamic behavior, current output

- Dead time (t₁): 100 ms
- Time constant T63 (t₂): can be set from 0 to 999 s
- Settling time (t₃): minimum 250 ms

Dynamic behavior, digital output

- Dead time (t_1):
 - Minimum: 200 ms
 - Maximum: 800 ms
- Time constant T63 (t_2): can be set from 0 to 999 s
- Settling time (t_3): minimum 200 ms

Reading cycle

- Acyclic: maximum 3/s, typically 1/s (depending on command # and number of preambles)
- Cyclic (burst): maximum 3/s, typically 2/s

The device offers the BURST MODE function for cyclic value transmission via the HART communication protocol.

Cycle time (update time)

Cyclic (burst): at least 300 ms

Hysteresis

Typically 2.5 mm (0.1 in)

Non-repeatability


0.5 mm (0.02 in)

Influence of the process temperature

The switch point moves between +1.4 to -2.6 mm (+0.06 to -0.1 in) in the temperature range from -50 to +150 °C (-58 to +302 °F)

Influence of the process pressure

The switch point moves between 0 to 2.6 mm (0 to 0.1 in) in the pressure range from -1 to +64 bar (14.5 to 928 psi)

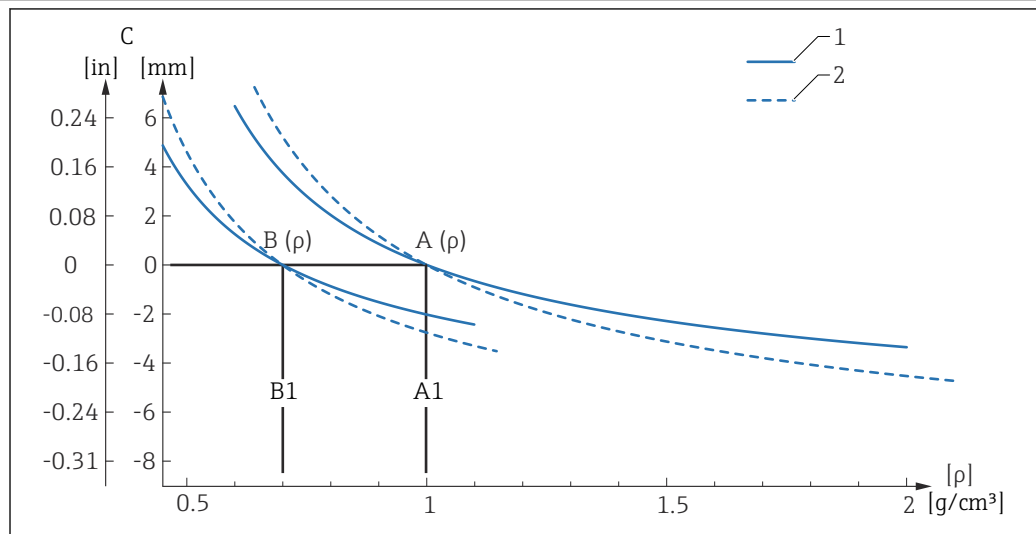Influence of the density of the process medium (at room temperature and normal pressure)

A0037670

7 Switch point deviation over density

- A Set density (ρ) > 0.7
- A1 Reference condition $\rho = 1 g/cm^3$
- B Set density (ρ) > 0.5
- B1 Reference condition $\rho = 0.7 g/cm^3$
- C Switch point deviation
- 1 Material Alloy C22
- 2 Material 316L

Density setting


- $TK_{typ.}$ [mm/10 k]
 - $\rho > 0.7$: -0.2
 - $\rho > 0.5$: -0.2
- Pressure $_{typ.}$ [mm/10 bar]
 - $\rho > 0.7$: -0.3
 - $\rho > 0.5$: -0.4

Mounting

Mounting location, orientation

Mounting instructions

- Any orientation for device with short pipe up to approx. 500 mm (19.7 in)
- Vertical orientation from above for device with long pipe
- Minimum distance between the fork tip and the tank wall or pipe wall: 10 mm (0.39 in)

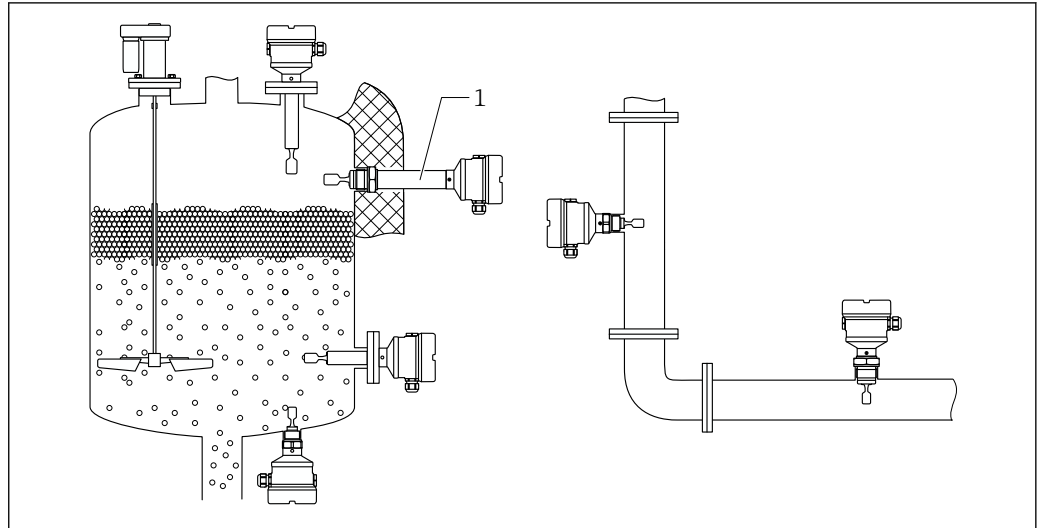

A0037879

8 Installation examples for a vessel, tank or pipe

1 Temperature spacer/pressure-tight feedthrough (optional) for tank with insulation and/or high process temperatures


Installation instructions

Take viscosity into consideration

Low viscosity

i Low viscosity, e.g. water: $< 2\,000 \text{ mPa}\cdot\text{s}$

It is permitted to position the tuning fork within the installation socket.

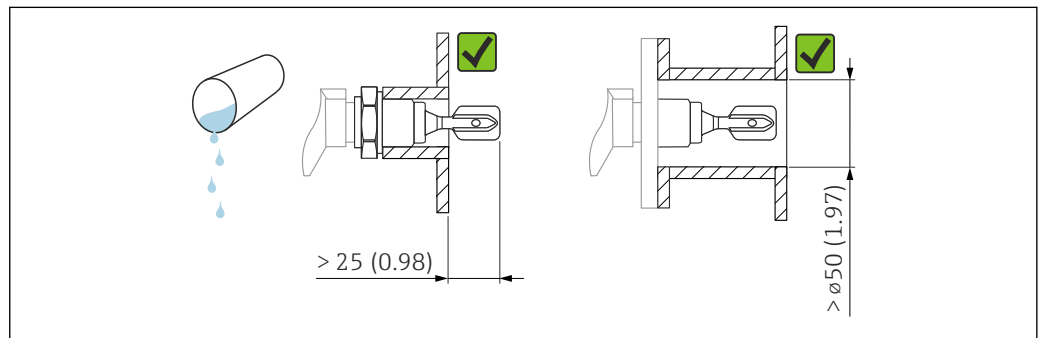

A0033297

9 Installation example for low-viscosity liquids. Unit of measurement mm (in)

High viscosity


NOTICE

Highly viscous liquids may cause switching delays.

- Make sure that the liquid can run off the tuning fork easily.
- Deburr the socket surface.

i High viscosity, e.g. viscous oils: $\leq 10\,000 \text{ mPa}\cdot\text{s}$

The tuning fork must be located outside the installation socket!

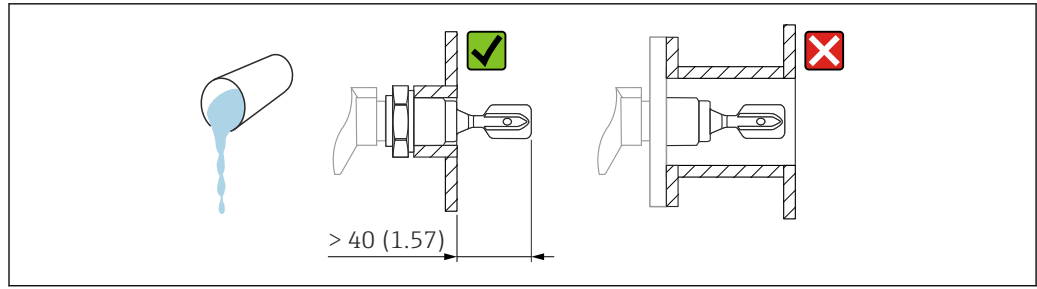


A0037348

10 Installation example for a highly viscous liquid. Unit of measurement mm (in)

Avoid buildup

- Use short installation sockets to ensure that the tuning fork projects freely into the vessel
- Leave sufficient distance between the buildup expected on the tank wall and the tuning fork

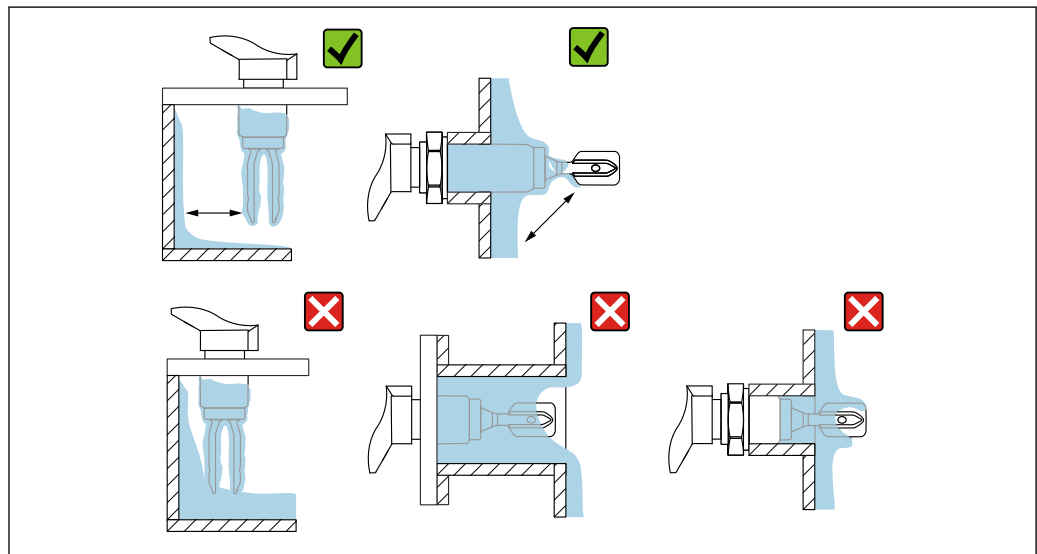


A0033239

11 Installation examples for a highly viscous process medium

Take clearance into consideration

Allow sufficient space outside the tank for mounting, connection and settings involving the electronic insert.

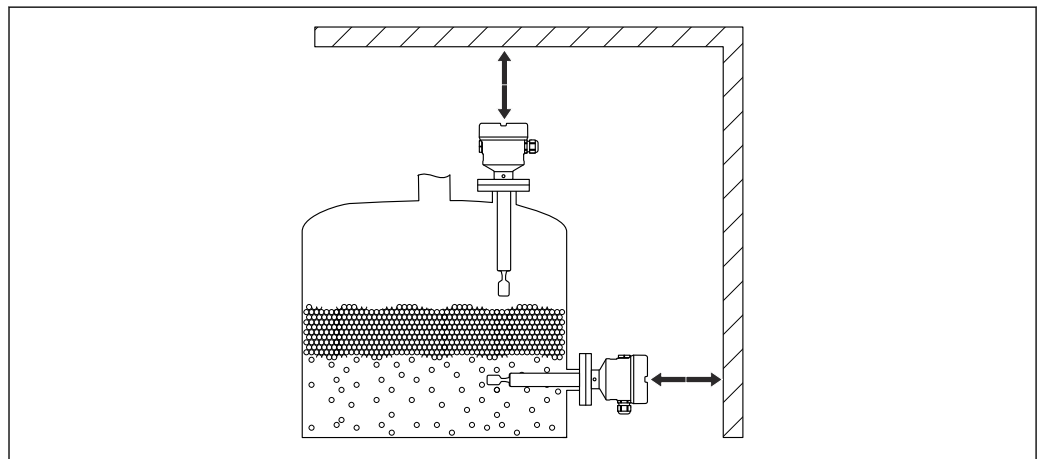

A0033236


12 Take clearance into consideration

Align the tuning fork using the marking

The tuning fork can be aligned using the marking in such a way that the medium drains off easily and buildup is avoided.

Markings may include the following:


- Material information, thread name or circle on the hexagonal nut or on the weld-in adapter
- II symbol on the back of the flange or Tri-Clamp

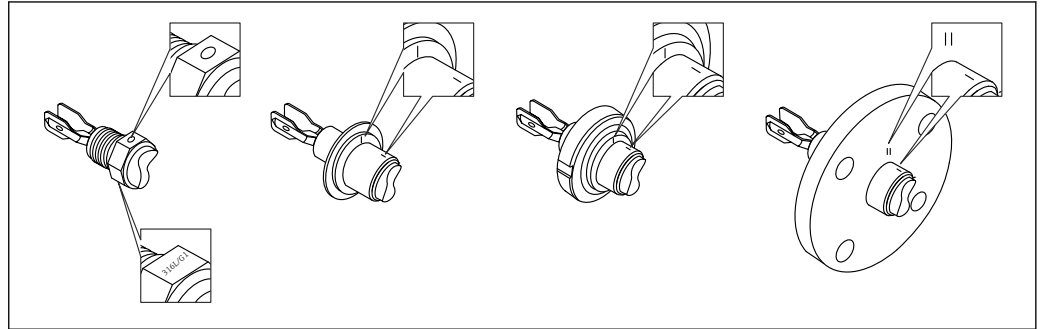

13 Markings to align the tuning fork

Installation in pipes


- Flow velocity up to 5 m/s with a viscosity of 1 mPa·s and density of 1 g/cm³ (SGU).
Check for correct functioning in the event of other process medium conditions.
- The flow will not be significantly impeded if the tuning fork is correctly aligned and the marking is pointing in the direction of flow.
- The marking is visible when installed.

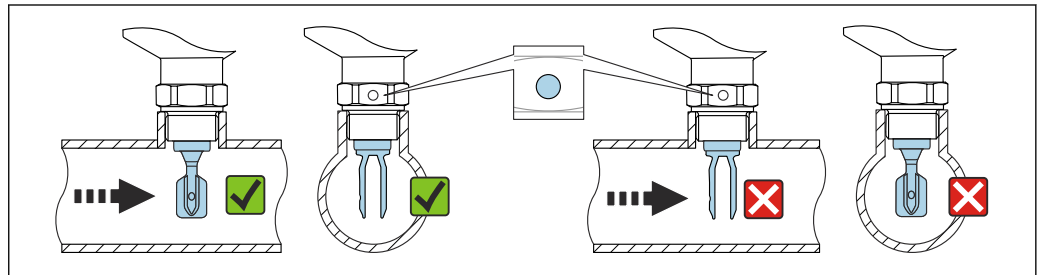

14 Installation in pipes (take fork position and marking into consideration)

Align the cable entry

The housing can be turned and the cable aligned by turning the locking screw.

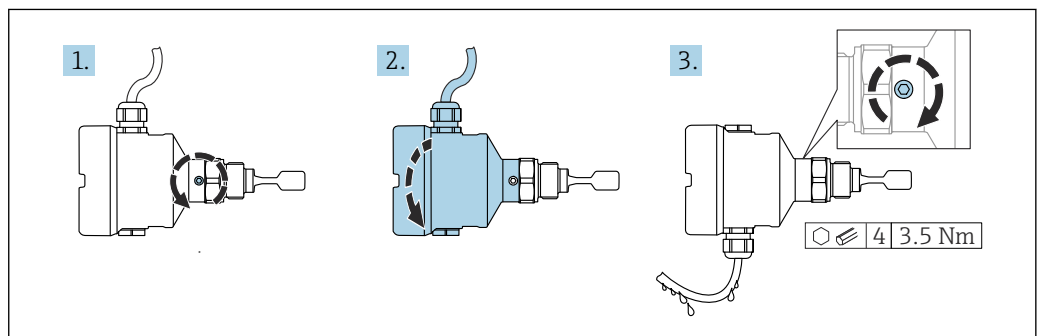


15 Housing with external locking screw and drip loop

Special mounting instructions

Support the device

Support the device in the event of severe dynamic load. Maximum lateral loading capacity of the pipe extensions and sensors: 75 Nm (55 lbf ft).

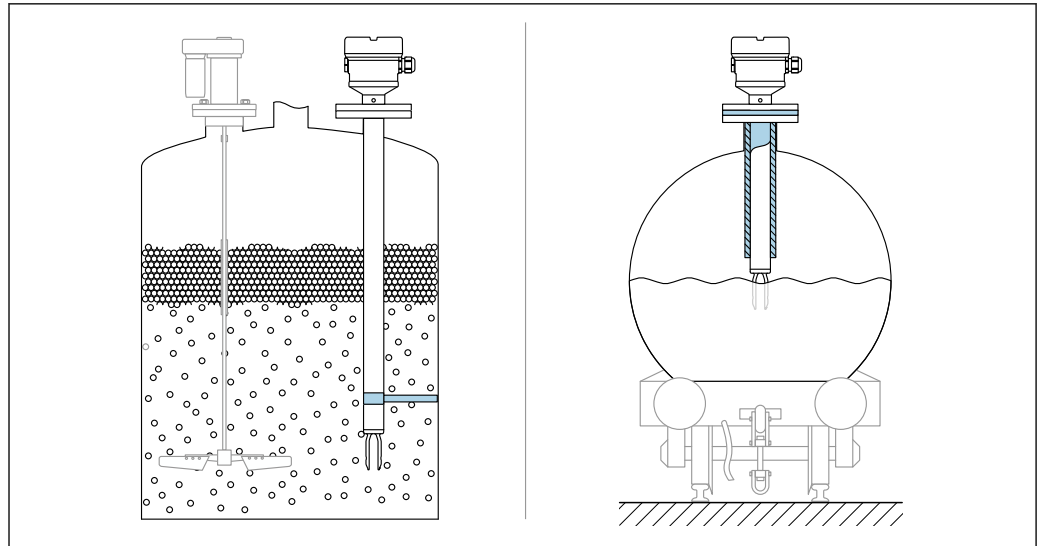


A0031874

16 Examples of support in the event of dynamic load

i Marine approval: In the case of pipe extensions or sensors longer than 1 600 mm, a support is needed at least every 1 600 mm.

Weld-in adapter with leakage hole

Weld in the weld-in adapter in such a way that the leakage hole is pointing downwards. This enables any leaks to be detected quickly.

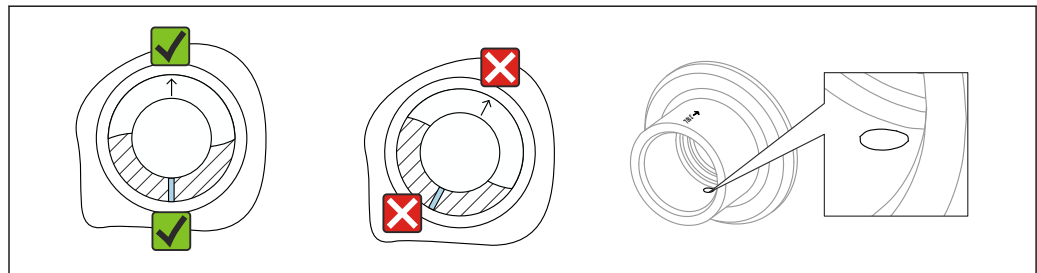

A0039230

17 Weld-in adapter with leakage hole

Sliding sleeves

📖 For more details, see the "Accessories" section.

Environment


Ambient temperature range

The following values apply up to a process temperature of +90 °C (+194). At higher process temperatures, the permitted ambient temperature is reduced (see diagram).

- Without LCD display: -40 to +70 °C (-40 to +158)
 - With LCD display: -40 to +70 °C (-40 to +158) with limitations in optical properties, such as display speed and contrast
- Can be used without limitations: -20 to +60 °C (-4 to +140 °F)

Optionally available:

- -50 °C (-58 °F) with restricted operating life and performance
 - -60 °C (-76 °F) with restricted operating life and performance,
- i** Below -50 °C (-58 °F): devices can be permanently damaged

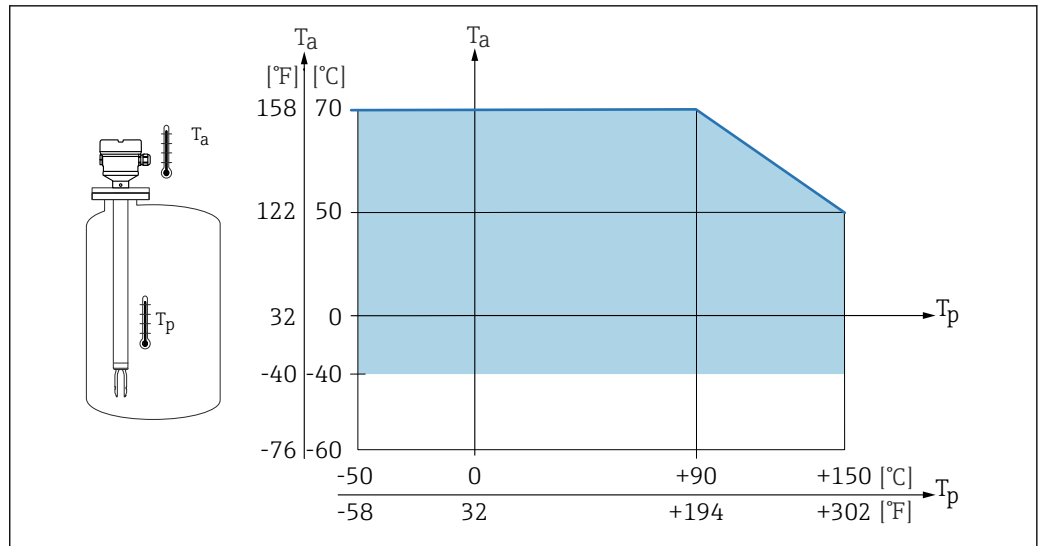

18 Permitted ambient temperature T_a at the housing as a function of the process temperature T_p in the vessel


The following ambient temperature applies over the entire process temperature range for devices with a temperature spacer: +70 °C (+158 °F)



Outdoor operation in strong sunlight:

- Mount the device in a shaded location
- Avoid direct sunlight, particularly in warmer climatic regions
- Use a weather protection cover, can be ordered as an accessory



Hazardous area

In the hazardous area, the permitted ambient temperature can be limited depending on the zones and gas groups. Pay attention to the information in the Ex documentation (XA).


Storage temperature	<p>–40 to +80 °C (–40 to +176 °F) Optional –50 °C (–58 °F) or –60 °C (–76 °F) With M12 plug, elbowed: –25 to +80 °C (–13 to +176 °F)</p>
Humidity	Operation up to 100 %. Do not open in a condensing atmosphere.
Operating height	Up to 5 000 m (16 404 ft) above sea level.
Climate class	As per IEC 60068-2-38 test Z/AD
Degree of protection	<p>In accordance with DIN EN 60529, NEMA 250</p> <p>IP66/IP68 NEMA 4X/6P (1.83 m H₂O for 24 h)</p> <p>Types of housing:</p> <ul style="list-style-type: none"> ■ Single compartment; aluminum, coated; Ex d/XP ■ Dual-compartment, L-shape; aluminum, 316L; Ex d/XP <p>Degree of protection for M12 plug</p> <ul style="list-style-type: none"> ■ When housing is closed and connecting cable is plugged in: IP66/67 NEMA Type 4X ■ When housing is open or connecting cable is not plugged in: IP20, NEMA Type 1 <p>NOTICE</p> <p>M12 plug: Loss of IP protection class due to incorrect installation!</p> <ul style="list-style-type: none"> ▶ The degree of protection only applies if the connecting cable used is plugged in and screwed tight. ▶ The degree of protection only applies if the connecting cable used is specified according to IP67 NEMA Type 4X. <p> Ordering information: Select the required option in the order code for "Electrical connection". Exclusion criteria are taken into account automatically.</p>

Vibration resistance	<p>As per IEC60068-2-64-2008 $a(\text{RMS}) = 50 \text{ m/s}^2$, $f = 5 \text{ to } 2\,000 \text{ Hz}$, $t = 3 \text{ axes} \times 2 \text{ h}$</p> <p>For increased oscillations or vibrations, the additional option of the order code for "Application" option "B" 100 bar (1 450 psi) pressure is recommended.</p>
Shock resistance	<p>In accordance with IEC60068-2-27-2008: $300 \text{ m/s}^2 [= 30 g_n] + 18 \text{ ms}$ g_n: standard acceleration of gravity</p>
Mechanical load	<p>Support the device in the event of severe dynamic load. Maximum lateral loading capacity of the pipe extensions and sensors: 75 Nm (55 lbf ft).</p> <p> For more details, see the "Supporting the device" section.</p>
Pollution degree	Pollution level 2
Electromagnetic compatibility (EMC)	<ul style="list-style-type: none"> ■ Electromagnetic compatibility as per EN 61326 series and NAMUR recommendation EMC (NE21) ■ With regard to the safety function (SIL), the requirements of EN 61326-3-x are satisfied ■ Maximum deviation under disturbance: < 0.5% of span <p> For more details, refer to the EU Declaration of Conformity.</p>

Process

Process temperature range	<p>$-50 \text{ to } +150 \text{ }^\circ\text{C}$ ($-58 \text{ to } +302 \text{ }^\circ\text{F}$)</p> <p>Observe pressure and temperature dependency,  for more details see the "Process pressure range of the sensors" section.</p>
Thermal shock	$\leq 120 \text{ K/s}$
Process pressure range	<p> WARNING</p> <p>The maximum pressure for the device depends on the lowest-rated element, with regard to pressure, of the selected component. This means that it is necessary to pay attention to the process connection as well as the sensor.</p> <ul style="list-style-type: none"> ► For pressure specifications, see the "Mechanical construction" section. ► Only operate the device within the specified limits! ► The Pressure Equipment Directive (2014/68/EU) uses the abbreviation "PS". The abbreviation "PS" corresponds to the MWP (maximum working pressure) of the device. <p>Refer to the following standards for the permitted pressure values of the flanges at higher temperatures:</p> <ul style="list-style-type: none"> ■ pR EN 1092-1: With regard to its stability-temperature property, the material 1.4435 is identical to 1.4404, which is classed as 13E0 in EN 1092-1 Tab. 18. The chemical composition of the two materials can be identical. ■ ASME B 16.5 ■ JIS B 2220 <p>In each case, the lowest value from the derating curves of the device and the selected flange applies.</p>


Process pressure range of the sensors

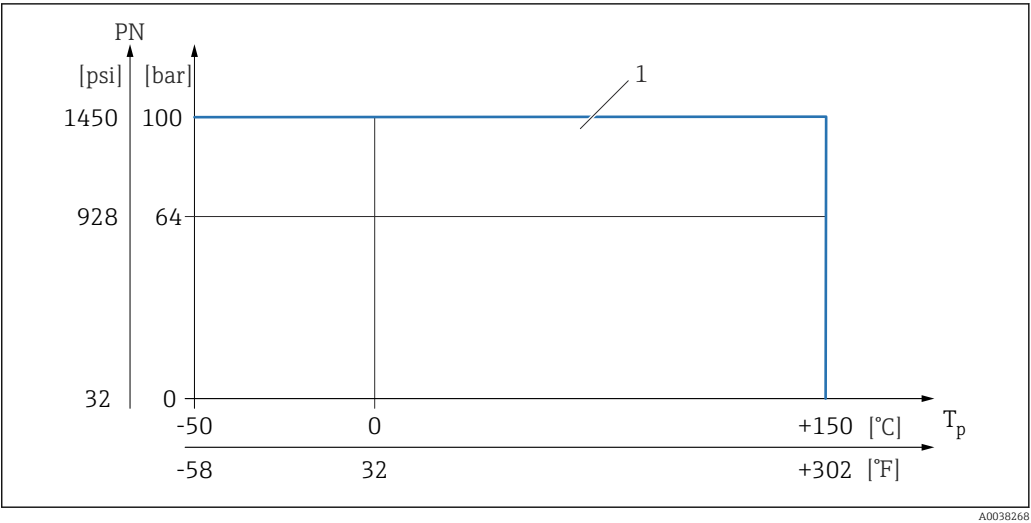

1 Permitted pressure rating when the "100 bar (1 450 psi)" option is selected. For exceptions, see the "Process connections" section. Canadian CRN approval: The maximum permitted process pressure is limited to 90 bar (1 305 psi) only in combination with the CRN approval. More details on the maximum pressure values are available in the download area of the product page under "www.endress.com".

Optionally available:

- PN: 64 bar (928 psi) at max. 150 °C (302 °F)
- PN: 100 bar (1 450 psi) at max. 150 °C (302 °F)

Overpressure limit	<ul style="list-style-type: none">■ PN = 64 bar (928 psi): overpressure limit = 1.5·PN maximum100 bar (1 450 psi) depending on process connection selected■ Membrane burst pressure at 200 bar (2 900 psi)■ PN = 100 bar (1 450 psi): overpressure limit = 1.5·PN maximum150 bar (2 175 psi) depending on process connection selected■ Membrane burst pressure at 400 bar (5 800 psi) <p>The device function is limited during the pressure test.</p> <p>The mechanical integrity is guaranteed at pressures up to 1.5 times the process nominal pressure (PN).</p>
State of aggregation	Liquid
Medium density	<p>Liquids with density > 0.7 g/cm³ Setting > 0.7 g/cm³ (as-delivered state)</p> <p>Liquids with density 0.5 to 0.8 g/cm³ Setting > 0.5 g/cm³ (can be ordered as preset value or user-configurable)</p> <p>Liquids with density > 0.4 g/cm³ (not for devices with SIL approval) Setting > 0.4 g/cm³ (can be ordered as preset value or user-configurable)</p>
Viscosity	≤ 10 000 mPa·s
Pressure tightness	<p>Up to vacuum</p> <p> In vacuum evaporation plants, select the 0.4 g/cm³ density setting.</p>
Solids contents	Ø ≤ 5 mm (0.2 in)

Mechanical construction



For the dimensions, see the Product Configurator: www.endress.com

Search for product → click "Configuration" to the right of the product image → after configuration click "CAD"

The following dimensions are rounded values. For this reason, they may deviate slightly from the dimensions given on www.endress.com.

Design, dimensions


Device height

The device height consists of the following components:

- Housing including cover
- Temperature spacer and/or pressure-tight feedthrough (second line of defense), optional
- Pipe extension, short pipe or compact version
- Process connection (flange, thread)

The individual heights of the components can be found in the following sections:

- Determine device height and add individual heights
- Take the installation clearance into consideration (space that is needed to install the device)

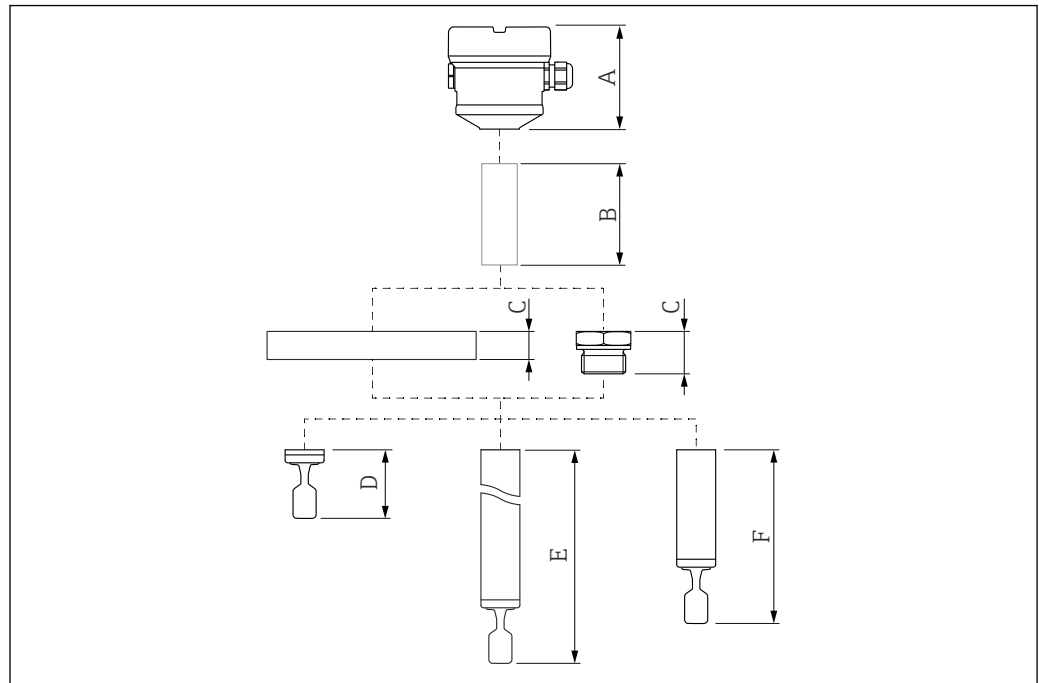

A0036841

19 Components to determine the device height


- A Housing including cover
- B Temperature spacer, pressure-tight feedthrough (optional), details in the Product Configurator, depends on the process connection, up to 60 mm (2.36 in). For details, see Product Configurator.
- C Process connection (flange, thread)
- D Tuning fork
- E Pipe extension with tuning fork
- F Short pipe with tuning fork

Dimensions

Housing and cover

All housings can be aligned. In the case of metal housings, the housing alignment can also be fixed with the locking screw.

Single compartment housing

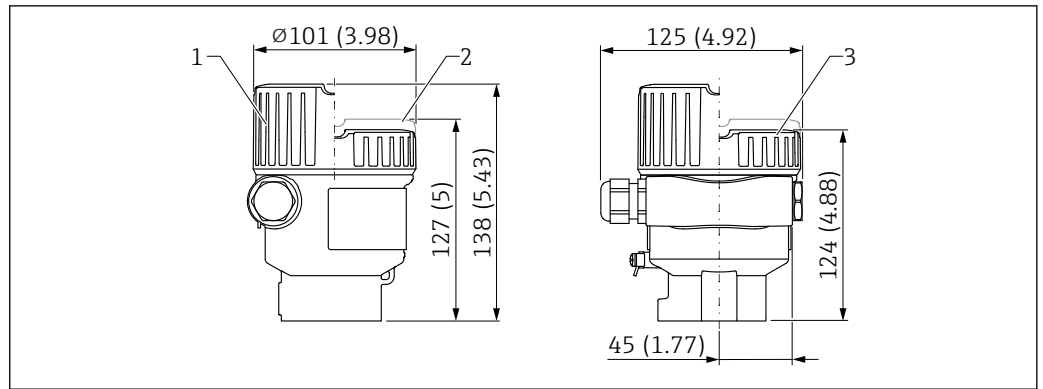


A0045829

Unit of measurement mm (in)

- 1 Cover with glass viewing window (devices for Ex d, dust Ex)
- 2 Cover with plastic viewing window
- 3 Cover without viewing window

Dual compartment housing, L-form

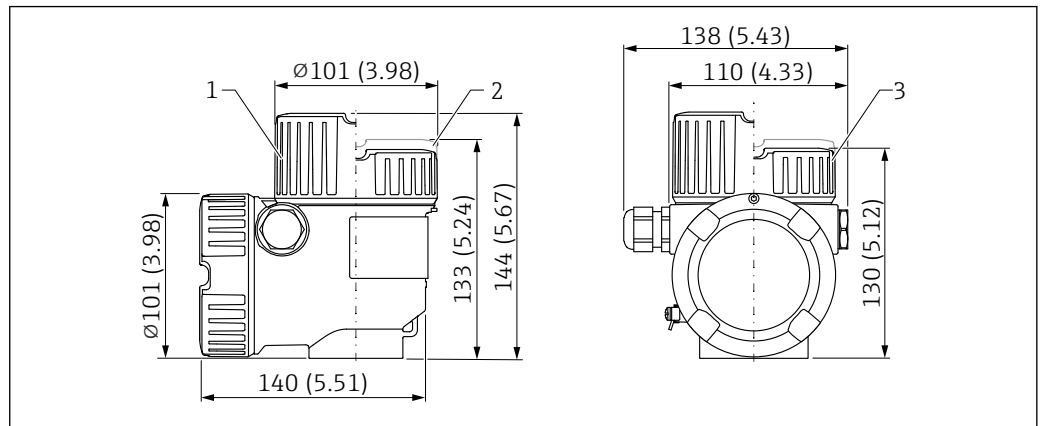


A0045828

Unit of measurement mm (in)

- 1 Cover with glass viewing window (devices for Ex d, dust Ex)
- 2 Cover with plastic viewing window
- 3 Cover without viewing window

Temperature spacer, pressure-tight feedthrough (optional)

Provides sealed insulation for the vessel and a normal ambient temperature for the housing.

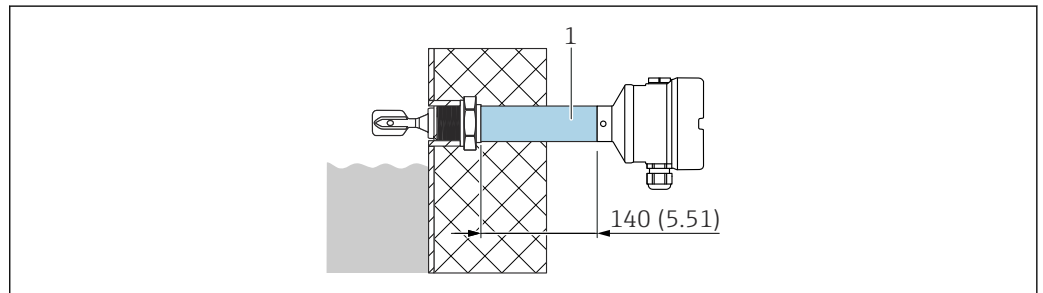

A0036845


Unit of measurement mm (in)

- 1 Temperature spacer, pressure-tight feedthrough

Product Configurator, order code for "Sensor design":


- Temperature spacer
- Pressure-tight feedthrough (second line of defense)

If the sensor is damaged, protects the housing from vessel pressures up to 100 bar (1 450 psi).


-  ■ The "Pressure-tight feedthrough" version can only be selected in combination with the "Temperature spacer" version
- Neither version can be ordered for Ex d

Ex d glass feedthrough for pipe extensions

If a pipe extension is required in combination with an Ex d approval, the following design is used:

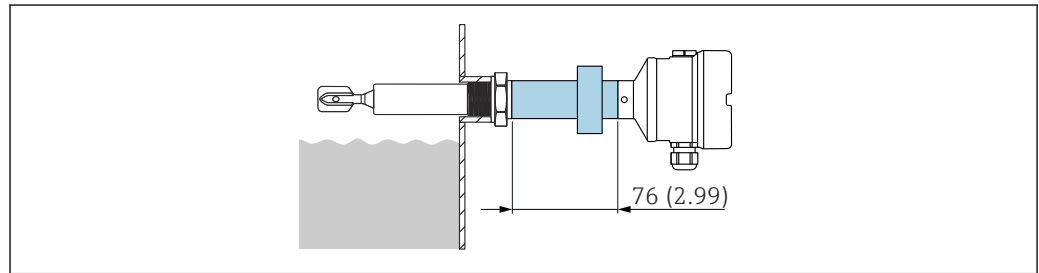


A0046136

 20 Ex d glass feedthrough for pipe extensions . Unit of measurement mm (in)


Probe design

Compact

- Material: 316L or Alloy C
- Sensor length L: depends on process connection
See section on process connections: thread G, ASME B1.20.3 MNPT, EN10226 R, Tri-Clamp

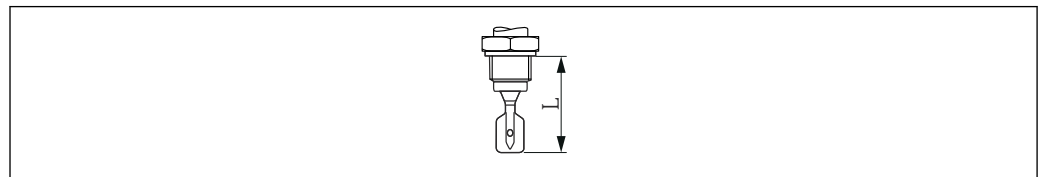

A0042435


 21 Probe design: compact, sensor length L

Short pipe

- Material: 316L, sensor length L: depends on process connection
- Material: Alloy C, sensor length L: depends on process connection
 - Flange = 115 mm (4.53 in)
 - Thread G 3/4 = 115 mm (4.53 in)
 - Thread G 1 = 118 mm (4.65 in)
 - Thread NPT, R = 99 mm (3.9 in)
 - Tri-Clamp = 115 mm (4.53 in)

Pipe extension

- Material: 316L, sensor length L: 117 to 6 000 mm (4.7 to 236 in)
- Material: Alloy C, sensor lengths L: 148 to 3 000 mm (5.9 to 118 in)
- Customized length L:
 - 117 to 3 000 mm (4.6 to 115 in); special version (TSP) on request up to 6 000 mm (235 in)
 - Length tolerances L: < 1 m (3.3 ft) = -5 mm (-0.2 in), 1 to 3 m (3.3 to 9.8 ft) = (-10 mm (-0.39 in))

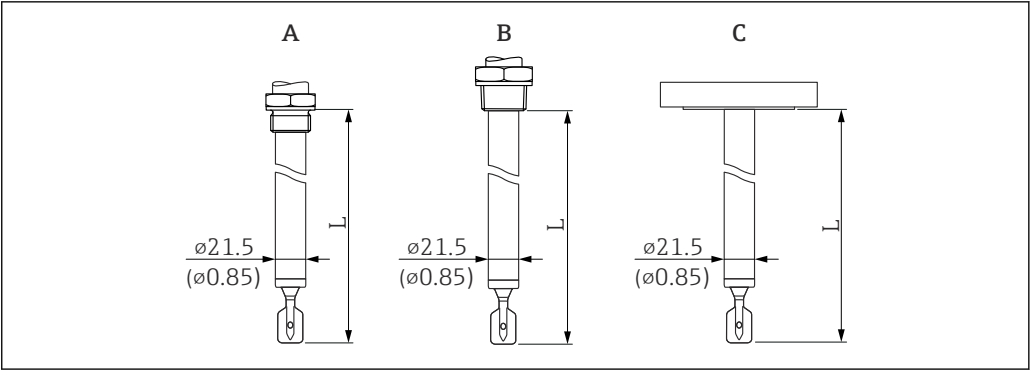


A0036860

22 Probe designs: pipe extension, short pipe, sensor length L . Unit of measurement mm (in)

- A $G \frac{3}{4}$, $G 1$
B $NPT \frac{3}{4}$, $NPT 1$, $R \frac{3}{4}$, $R 1$
C Flange, Tri-Clamp

Tuning fork

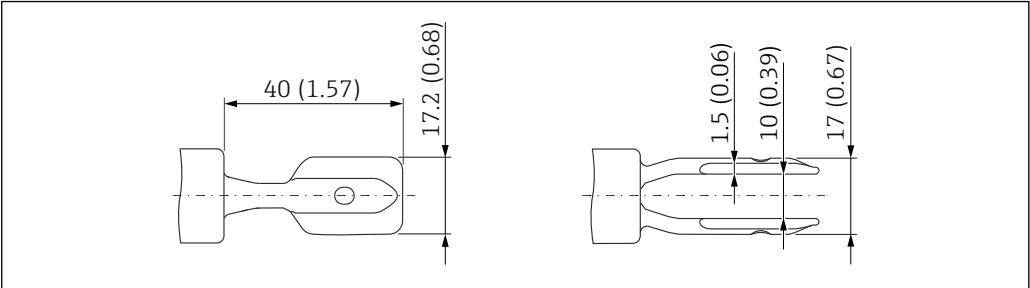


A0038269

23 Tuning fork. Unit of measurement mm (in)

Process connections

Height of process connection

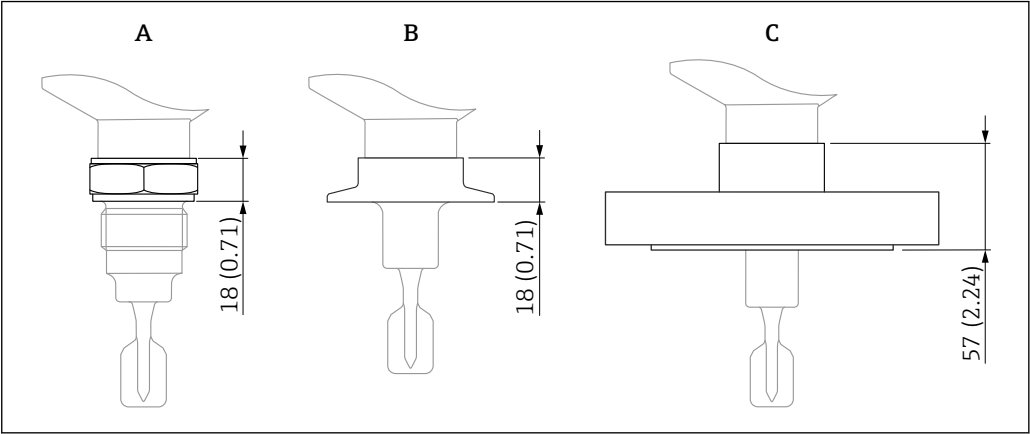

A0046284

Unit of measurement mm (in)

- A Process connection with threaded connection
B Process connection with Clamp
C Process connection with flange



Thread ISO228 G for installing in weld-in adapter

G ¾, G 1 suitable for installing in weld-in adapter



- Material: 316L
- Pressure rating, temperature: ≤ 40 bar (580 psi), ≤ 100 °C (212 °F)
- Pressure rating, temperature: ≤ 25 bar (363 psi), ≤ 150 °C (302 °F)
- Weight: 0.2 kg (0.44 lb)
- Accessory: weld-in adapter





The weld-in adapter is not included in the scope of delivery.

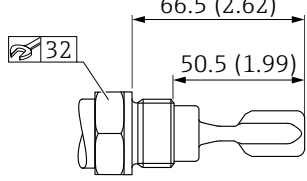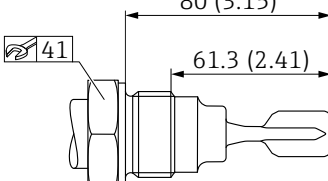 <p>24 Thread ISO228 G ¾. Unit of measurement mm (in)</p> <p>A0035549</p>	 <p>25 Thread ISO228 G 1. Unit of measurement mm (in)</p> <p>A0035551</p>
--	---



Thread ISO228 G with flat seal

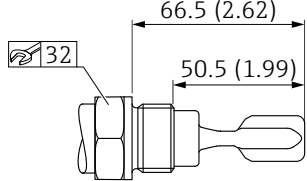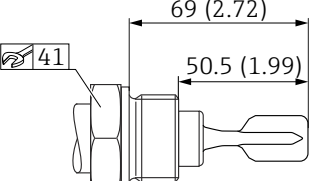 <p>26 Thread ISO228 G ¾. Unit of measurement mm (in)</p> <p>A0035549</p>	 <p>27 Thread ISO228 G 1. Unit of measurement mm (in)</p> <p>A0037756</p>
---	--

Thread ASME B1.20.3, MNPT

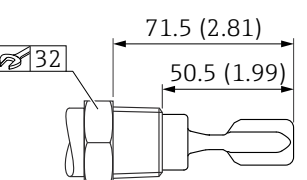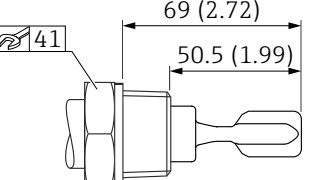 <p>28 Thread ASME B1.20.3, MNPT ¾. Unit of measurement mm (in)</p> <p>A0038274</p>	 <p>29 Thread ASME B1.20.3, MNPT 1. Unit of measurement mm (in)</p> <p>A0038275</p>
--	---


Thread EN10226, R

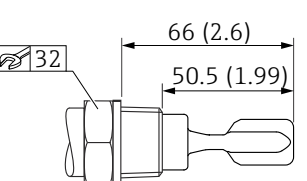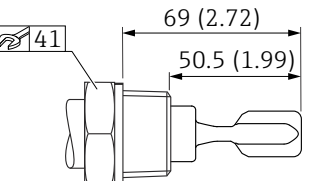
 <p>30 Thread EN10226, R ¾. Unit of measurement mm (in)</p> <p>A0038272</p>	 <p>31 Thread EN10226, R 1. Unit of measurement mm (in)</p> <p>A0038273</p>
--	---

Tri-Clamp

Options: ISO2852 DN25-38 (1 to 1-½), DIN32676 DN25-40

- Material: 316L
- Pressure rating: ≤ 25 bar (363 psi)
- Temperature: ≤ 150 °C (302 °F)
- Weight: 0.1 kg (0.22 lb)


 The maximum temperature and the maximum pressure are dependent on the clamping ring and the seal used. The lowest value applies in each case.

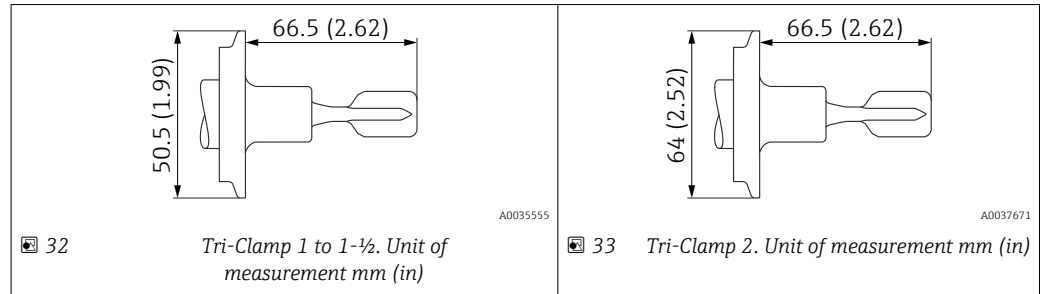

Flanges

AlloyC22-plated flanges are available for higher chemical resistance.

The flange carrier material is made of 316L and is welded to an AlloyC22 disk.

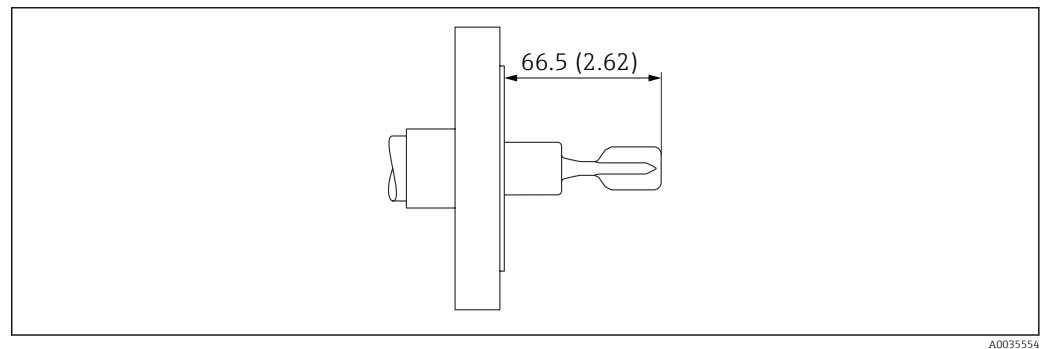

ASME B16.5 flanges, RF

Pressure rating	Type	Material	Weight
Cl.150	NPS 1"	316/316L	1.0 kg (2.21 lb)
Cl.150	NPS 1-¼"	316/316L	1.2 kg (2.65 lb)
Cl.150	NPS 2"	316/316L	2.4 kg (5.29 lb)
Cl.150	NPS 2"	AlloyC22>316/316L	2.4 kg (5.29 lb)
Cl.150	NPS 1-½"	316/316L	1.5 kg (3.31 lb)
Cl.150	NPS 3"	316/316L	4.9 kg (10.8 lb)
Cl.150	NPS 4"	316/316L	7.0 kg (15.44 lb)
Cl.300	NPS 1-¼"	316/316L	2.0 kg (4.41 lb)
Cl.300	NPS 1-½"	316/316L	2.7 kg (5.95 lb)
Cl.300	NPS 2"	316/316L	3.2 kg (7.06 lb)
Cl.300	NPS 3"	316/316L	6.8 kg (14.99 lb)
Cl.300	NPS 3"	AlloyC22>316/316L	6.8 kg (14.99 lb)
Cl.300	NPS 4"	316/316L	11.5 kg (25.6 lb)

Pressure rating	Type	Material	Weight
Cl.600	NPS 2"	316/316L	4.2 kg (9.26 lb)
Cl.600	NPS 3"	316/316L	6.8 kg (14.99 lb)

ASME B16.5 flanges, FF

Pressure rating	Type	Material	Weight
Cl.150	NPS 1"	316/316L	1.0 kg (2.21 lb)
Cl.150	NPS 2"	316/316L	2.4 kg (5.29 lb)
Cl.300	NPS 1-½"	316/316L	2.7 kg (5.95 lb)
Cl.300	NPS 2"	316/316L	3.2 kg (7.06 lb)

ASME B16.5 flanges, RTJ

Pressure rating	Type	Material	Weight
Cl.300	NPS 2"	316/316L	3.2 kg (7.06 lb)
Cl.300	NPS 4"	316/316L	11.5 kg (25.6 lb)
Cl.600	NPS 2"	316/316L	4.2 kg (9.26 lb)
Cl.600	NPS 3"	316/316L	6.2 kg (13.67 lb)

EN flanges EN 1092-1, A

Pressure rating	Type	Material	Weight
PN6	DN32	316L (1.4404)	1.2 kg (2.65 lb)
PN6	DN40	316L (1.4404)	1.4 kg (3.09 lb)
PN6	DN50	316L (1.4404)	1.6 kg (3.53 lb)
PN10/16	DN80	316L (1.4404)	4.8 kg (10.58 lb)
PN10/16	DN100	316L (1.4404)	5.6 kg (12.35 lb)
PN25/40	DN25	316L (1.4404)	1.3 kg (2.87 lb)
PN25/40	DN32	316L (1.4404)	2.0 kg (4.41 lb)
PN25/40	DN40	316L (1.4404)	2.4 kg (5.29 lb)
PN25/40	DN50	316L (1.4404)	3.2 kg (7.06 lb)
PN25/40	DN65	316L (1.4404)	4.3 kg (9.48 lb)
PN25/40	DN80	316L (1.4404)	5.9 kg (13.01 lb)
PN25/40	DN100	316L (1.4404)	7.5 kg (16.54 lb)
PN40	DN50	316L (1.4404)	3.2 kg (7.06 lb)
PN100	DN50	316L (1.4404)	5.5 kg (12.13 lb)

EN flanges EN 1092-1, B1

Pressure rating	Type	Material	Weight
PN6	DN32	316L (1.4404)	1.2 kg (2.65 lb)
PN6	DN50	316L (1.4404)	1.6 kg (3.53 lb)
PN6	DN50	AlloyC22>316L	1.6 kg (3.53 lb)
PN10/16	DN100	316L (1.4404)	5.6 kg (12.35 lb)

Pressure rating	Type	Material	Weight
PN10/16	DN100	AlloyC22>316L	5.6 kg (12.35 lb)
PN25/40	DN25	316L (1.4404)	1.4 kg (3.09 lb)
PN25/40	DN25	AlloyC22>316L	1.4 kg (3.09 lb)
PN25/40	DN50	316L (1.4404)	3.2 kg (7.06 lb)
PN25/40	DN50	AlloyC22>316L	3.2 kg (7.06 lb)
PN25/40	DN80	316L (1.4404)	5.9 kg (13.01 lb)
PN25/40	DN80	AlloyC22>316L	5.2 kg (11.47 lb)
PN100	DN50	316L (1.4404)	5.5 kg (12.13 lb)

EN flanges EN 1092-1, C

Type	Material	Pressure rating	Weight
DN32	316L (1.4404)	PN6	1.2 kg (2.65 lb)
DN50	316L (1.4404)	PN25/40	3.2 kg (7.06 lb)

EN flanges EN 1092-1, D

Type	Material	Pressure rating	Weight
DN32	316L (1.4404)	PN6	1.2 kg (2.65 lb)
DN50	316L (1.4404)	PN25/40	3.2 kg (7.06 lb)

EN flanges EN 1092-1, E

Type	Material	Pressure rating	Weight
DN32	316L (1.4404)	PN6	1.2 kg (2.65 lb)
DN50	316L (1.4404)	PN25/40	3.2 kg (7.06 lb)

JIS flanges B2220

Pressure rating	Type	Material	Weight
10K	10K 25A	316L (1.4404)	1.3 kg (2.87 lb)
10K	10K 40A	316L (1.4404)	1.5 kg (3.31 lb)
10K	10K 50A	316L (1.4404)	1.7 kg (3.75 lb)
10K	10K 50A	AlloyC22>316L	1.7 kg (3.75 lb)
10K	10K 80A	316L (1.4404)	2.2 kg (4.85 lb)
10K	10K 100A	316L (1.4404)	2.8 kg (6.17 lb)

Process connection, sealing surface

- Thread ISO228, G
- Thread ASME, MNPT
- Thread EN10226, R
- Tri-Clamp ISO2852
- Flange ASME B16.5, RF (Raised Face)
- Flange ASME B16.5, FF (Flat Face)
- Flange ASME B16.5, RTJ (Ring Type Joint)
- Flange EN1092-1, Form A
- Flange EN1092-1, Form B1

- Flange EN1092-1, Form C
- Flange EN1092-1, Form D
- Flange EN1092-1, Form E
- Flange JIS B2220, RF (Raised Face)
- Flange HG/T20592, RF (Raised Face)
- Flange HG/T20615, RF (Raised Face)
- Flange HG/T20615, RJ (Ring Joint)

Weight**Housing**

Weight including electronics and display:

- Single-compartment housing: 1.1 kg (2.43 lb)
- Dual-compartment housing, L-shape, aluminum: 1.7 kg (3.75 lb)
- Dual-compartment housing, L-shape, stainless steel: 4.3 kg (9.48 lb)

Temperature spacer

0.6 kg (1.32 lb)

Pressure-tight feedthrough

0.7 kg (1.54 lb)

Ex d glass feedthrough

0.5 kg (1.10 lb)

Pipe extension

- 1 000 mm: 0.9 kg (1.98 lb)
- 100 in: 2.3 kg (5.07 lb)

Process connection

See "Process connections" section

Weather protection cover, plastic

0.2 kg (0.44 lb)

Weather protection cover, metal

0.93 kg (2.05 lb)

Materials**Materials in contact with process**

Process connection and pipe extension


316L (1.4435)

Tuning fork

316L (1.4435)

Optional 2.4602 (AlloyC22)

Flanges

- Flanges,  mechanical construction
- Flange plating: Alloy C22 (2.4602)

Seals

Flat seal for process connection G 3/4 or G 1: fiber-reinforced elastomer seal, asbestos-free according to DIN 7603



Scope of delivery with flat seal according to DIN7603

- Metric thread G 3/4, G 1 standard
- Metric thread G 3/4, G 1 for installation in weld-in adapter



Scope of delivery without seal

- Tri-Clamp
- Flanges
- R and NPT thread

Materials not in contact with process

Single compartment housing and cover

Polyester powder coating on aluminum as per EN1706 AC43400 (reduced copper content ≤ 0.1 % to prevent corrosion)

Dual compartment housing and cover, L-form

- Polyester powder coating on aluminum as per EN1706 AC43400 (reduced copper content $\leq 0.1\%$ to prevent corrosion)
- Stainless steel (ASTM A351 : CF3M (cast equivalent to material AISI 316L)/DIN EN 10213 : 1.4409)

Aluminum housing nameplate

Adhesive plastic film label

Nameplate of stainless steel housing

Lasered onto housing

Wired-on nameplate

- Stainless steel
- Plastic film
- Provided by customer
- RFID tag: polyurethane potting compound

Cable entries

- M20 gland:
Plastic, brass nickel plated or 316L (depends on version ordered)
Dummy plug made of plastic, aluminum or 316L (depends on version ordered)
- Thread M20:
Dummy plug made of aluminum or 316L (depends on version ordered)
- Thread G $\frac{1}{2}$:
Adapter made of aluminum or 316L (depends on version ordered)
If the G $\frac{1}{2}$ thread is selected, the device is provided with an M20 thread as standard and an adapter to G $\frac{1}{2}$ is included, along with the associated documentation
- Thread NPT $\frac{1}{2}$:
Dummy plug made of aluminum or 316L (depends on version ordered)
- M12 plug:
CuZn nickel-plated or 316L (depends on version ordered)
Dummy plug made of aluminum or 316L (depends on version ordered)

Surface roughness

The surface roughness of the surface in contact with the process is $R_a < 3.2\ \mu\text{m}$ (126 μin).

Operability

Operating concept

Operator-oriented menu structure for user-specific tasks

- Guidance
- Diagnostics
- Application
- System

Fast and safe commissioning

- Interactive wizard with graphical user interface for guided commissioning in FieldCare, DeviceCare or DTM, AMS and PDM-based third-party tools or SmartBlue
- Menu guidance with short explanations of the individual parameter functions
- Standardized operation at the device and in the operating tools

Integrated HistoROM data memory

- Adoption of data configuration when electronics modules are replaced
- Up to 100 event messages recorded in the device

Efficient diagnostic behavior increases measurement availability


- Remedial measures are integrated in plain text
- Diverse simulation options

Bluetooth (optionally integrated in local display)


- Quick and easy setup with SmartBlue app or PC with DeviceCare, version 1.07.05 and higher, or FieldXpert SMT70
- No additional tools or adapters required
- Encrypted single point-to-point data transmission (tested by Fraunhofer Institute) and password-protected communication via *Bluetooth®* wireless technology

Languages**Operating languages**


- **English** option (default factory setting is **English** option, unless a different language is ordered)
- Deutsch
- Français
- Español
- Italiano
- Nederlands
- Portuguesa
- Polski
- русский язык (Russian)
- Türkçe
- 中文 (Chinese)
- 日本語 (Japanese)
- 한국어 (Korean)
- Bahasa Indonesia
- tiếng Việt (Vietnamese)
- čeština (Czech)
- Svenska

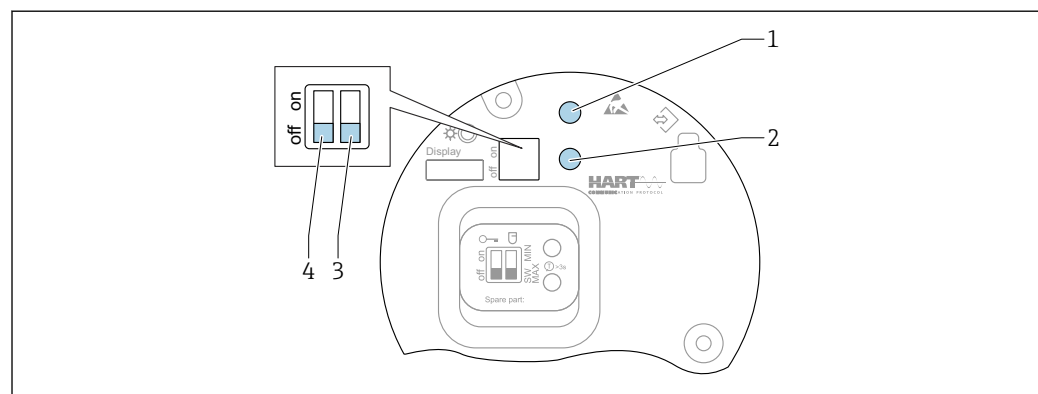


Local operation**4 to 20 mA HART (FEL60H) electronic insert**

A0046129

 35 Operating keys and DIP switches on the 4 to 20 mA HART electronic insert

- 1 Operating key for reset password (for Bluetooth login and Maintenance user role)
- 1+2 Operating keys for device reset (as-delivered state)
- 2 Operating key for "Proof test" wizard (> 3 s)
- 3 DIP switch for safety function, software-defined (SW, default = MAX) or permanently MIN (in the SW switch position, the MIN or MAX setting is defined by the software. MAX is the default value. In the MIN switch position, the setting is permanently MIN irrespective of the software).
- 4 DIP switch for locking and unlocking the device

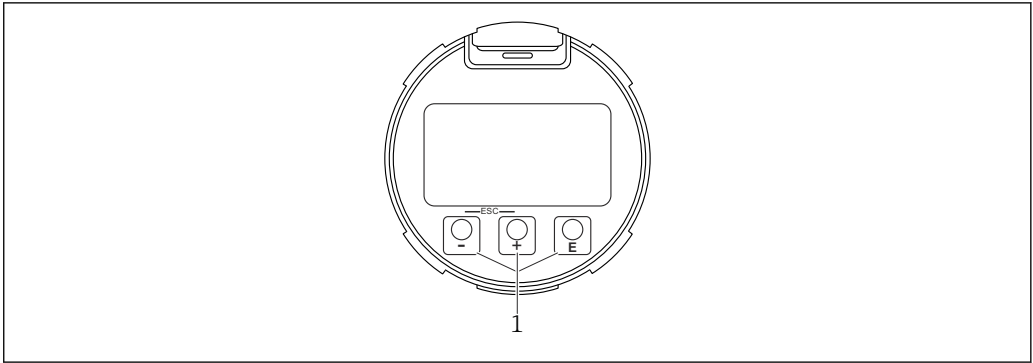- Minimum/maximum quiescent current safety can be switched at the electronic insert
- MAX = maximum safety: when the tuning fork is covered the output switches to demand mode, e.g. use for overfill protection
- MIN = minimum safety: when the tuning fork is uncovered, the output switches to demand mode, e.g. use to prevent pumps from running dry
-  ■ The setting of the DIP switches on the electronic insert has priority over the settings made via other operation methods (e.g. FieldCare/DeviceCare).
 - Density switchover: A density preset can be ordered as an option or configured via display, Bluetooth and HART.

Local display	<div data-bbox="499 208 767 241">Device display (optional)</div> <div data-bbox="499 253 608 280">Functions:</div> <div data-bbox="499 282 1327 369"><ul style="list-style-type: none">■ Display of measured values and fault and notice messages■ Background lighting, which switches from green to red in the event of an error■ The device display can be removed for easier operation</div> <div data-bbox="499 400 1536 761"></div> <div data-bbox="499 786 999 813"> 36 <i>Graphic display with optical operating keys (1)</i></div>
Remote operation	<div data-bbox="499 848 702 882">Via HART protocol</div> <div data-bbox="499 909 782 943">Via service interface (CDI)</div> <div data-bbox="499 967 1107 1001">Operation via Bluetooth® wireless technology (optional)</div> <div data-bbox="499 1012 624 1039">Prerequisite</div> <div data-bbox="499 1041 1490 1128"><ul style="list-style-type: none">■ Measuring device with display including Bluetooth■ Smartphone or tablet with Endress+Hauser SmartBlue app or PC with DeviceCare from version 1.07.05 or FieldXpert SMT70</div> <div data-bbox="499 1137 1509 1196"><p>The connection has a range of up to 25 m (82 ft). The range can vary depending on environmental conditions such as attachments, walls or ceilings.</p></div> <div data-bbox="499 1207 1509 1252"> The operating keys on the display are locked as soon as the device is connected via Bluetooth.</div>
System integration	<div data-bbox="499 1296 564 1330">HART</div> <div data-bbox="499 1341 598 1375">Version 7</div>
Supported operating tools	<p>Smartphone or tablet with Endress+Hauser SmartBlue app, DeviceCare from version 1.07.05, FieldCare, DTM, AMS and PDM</p>
HistoROM data management	<p>When replacing the electronic insert, the stored data is transferred by reconnecting the HistoROM.</p> <p>The device serial number is saved in the HistoROM. The electronics serial number is saved in the electronics.</p>

Certificates and approvals

Current certificates and approvals for the product are available via the Product Configurator at www.endress.com.

1. Select the product using the filters and search field.
2. Open the product page.

The **Configuration** button opens the Product Configurator.

Ordering information

Detailed ordering information is available from the nearest sales organization www.addresses.endress.com or in the Product Configurator under www.endress.com:

1. Select the product using the filters and search field.
2. Open the product page.

The **Configuration** button opens the Product Configurator.



Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

TAG

Measuring point (TAG)

The device can be ordered with a tag name.

Location of the tag name

Select in the additional specification:

- Stainless steel wired-on tag plate
- Plastic film
- Plate provided
- RFID TAG
- RFID TAG + stainless steel wired-on tag plate
- RFID TAG + plastic film
- RFID TAG + plate provided

Definition of tag name

Specify in the additional specification:

3 lines with a maximum of 18 characters per line

The specified tag name appears on the selected plate and/or on the RFID TAG.

Visualization in SmartBlue app

The first 32 characters of the tag name

The tag name can always be changed specifically for the measuring point via Bluetooth.

Test reports, declarations and inspection certificates

All test reports, declarations and inspection certificates are provided electronically in the *W@M Device Viewer*:

Enter the serial number from the nameplate (www.endress.com/deviceviewer)



Product documentation on paper

Test reports, declarations and inspection certificates in hard copy can optionally be ordered with feature 570 "Service", Version I7 "Product documentation on paper". The documents are then provided with the device upon delivery.

Application packages

Heartbeat Technology module

Heartbeat Diagnostics


Continuously monitors and assesses the device condition and process conditions. Generates diagnostic messages when certain events occur and provides troubleshooting measures in accordance with NAMUR NE 107.

Heartbeat Verification

Performs a verification of the current device condition on demand and generates the Heartbeat Technology verification report showing the verification result.


Heartbeat Monitoring

Continuously provides device and/or process data for an external system. Analysis of this data forms the basis for process optimization and predictive maintenance.

Heartbeat Diagnostics	<p>Diagnostic messages output to:</p> <ul style="list-style-type: none"> ■ the local display ■ an asset management system (e.g. FieldCare or DeviceCare) ■ an automation system (e.g. PLC)
Heartbeat Verification	<ul style="list-style-type: none"> ■ Device monitoring in installed state without interrupting the process, including report ■ Clear measuring point assessment (Passed/Failed) with high total test coverage within the framework of manufacturer specifications ■ Can be used to document normative requirements <p>The "Heartbeat Verification" module contains the Heartbeat Verification wizard, which verifies the current instrument health and creates the Heartbeat Technology verification report:</p> <ul style="list-style-type: none"> ■ The Heartbeat Verification wizard can be used via the SmartBlue app ■ The Heartbeat Verification wizard guides the user through the entire process for creating the verification report ■ The operating hours counter, minimum/maximum temperature indicator and minimum/maximum frequency indicator are displayed. ■ If the oscillation frequency of the fork increases, a corrosion warning appears. ■ The order configuration of the oscillation frequency in air is indicated in the verification report. <ul style="list-style-type: none"> ■ A high oscillation frequency is an indicator of corrosion. ■ A lower oscillation frequency indicates buildup or a sensor covered by the medium. ■ Deviations in the oscillation frequency compared to the oscillation frequency on delivery may be caused by the process temperature and pressure. ■ Frequency history: Last 16 sensor frequencies that were stored at the time of the Heartbeat Verification
Heartbeat Monitoring	<ul style="list-style-type: none"> ■ Loop diagnostics wizard: Detection of elevated measuring circuit resistance values or declining power supply ■ Process window wizard: Two frequency limits for monitoring the upper and lower range of the oscillation frequency (can be defined independently of one another). Changes in the process can be identified, e.g. corrosion or buildup.
Proof testing	<p> The proof test is only available for devices with SIL or WHG approval.</p> <p>A proof test is required at appropriate intervals in the following applications: SIL (IEC61508/IEC61511), WHG (German Water Resources Act).</p> <p>The Proof test wizard is available with the ordered SIL or WHG approval. The wizard guides the user through the entire process for creating the verification report. The verification report can be saved as a PDF file.</p>

Accessories

Device Viewer	<p>All the spare parts for the device, along with the order code, are listed in the <i>Device Viewer</i> (www.endress.com/deviceviewer).</p>
Weather protection cover for dual compartment housing	<ul style="list-style-type: none"> ■ Material: stainless steel 316L ■ Order number: 71438303

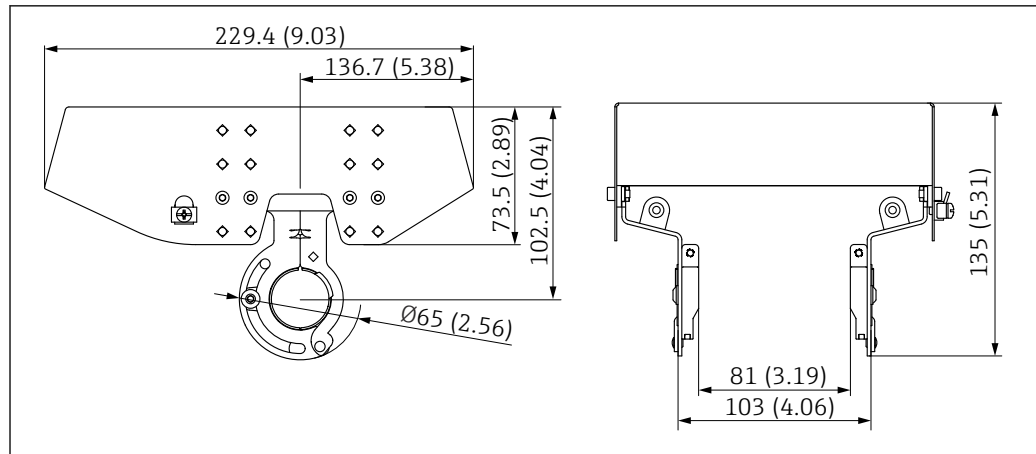


A0039231

37 Weather protection cover for dual compartment housing. Unit of measurement mm (in)

Weather protection cover for single compartment housing, aluminum

- Material: plastic
- Order number: 71438291

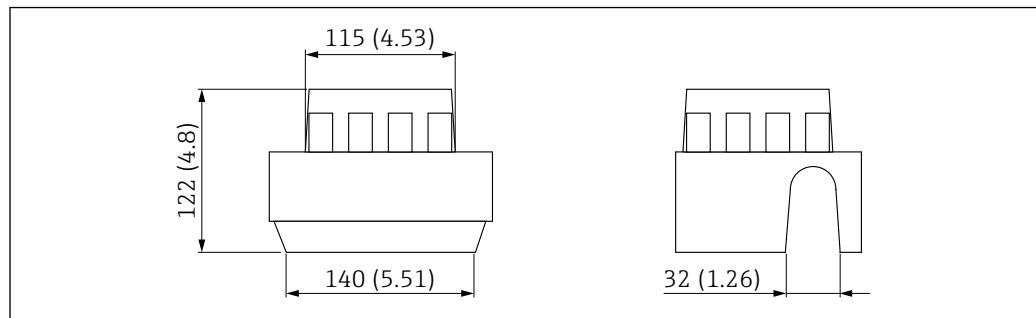

A0038280


38 Weather protection cover for single compartment housing, aluminum. Unit of measurement mm (in)

Plug-in jack

- The plug-in jacks listed are suitable for use in the temperature range -25 to $+70$ °C (-13 to $+158$ °F).

Plug-in jack M12 IP69

- Terminated at one end
- Elbowed 90°
- 5 m (16 ft) PVC cable (orange)
- Slotted nut 316L (1.4435)
- Body: PVC (orange)
- Order number: 52024216

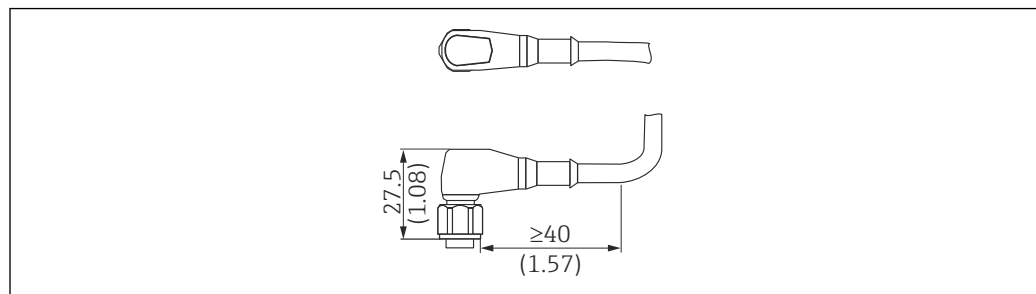


A0023713

39 Plug-in jack M12 IP69. Unit of measurement mm (in)

Plug-in jack M12 IP67

- Elbowed 90°
- 5 m (16 ft) PVC cable (gray)
- Slotted nut Cu Sn/Ni
- Body: PUR (black)
- Order number: 52010285

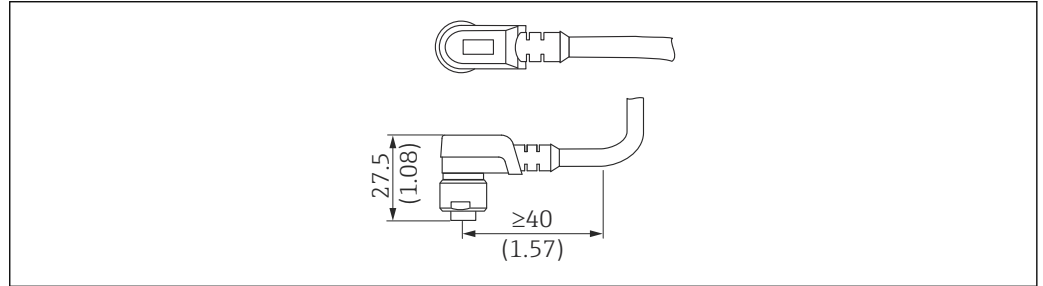


A0022292

40 Plug-in jack M12 IP67. Unit of measurement mm (in)

Sliding sleeves for unpressurized operation

Switch point, infinitely adjustable.

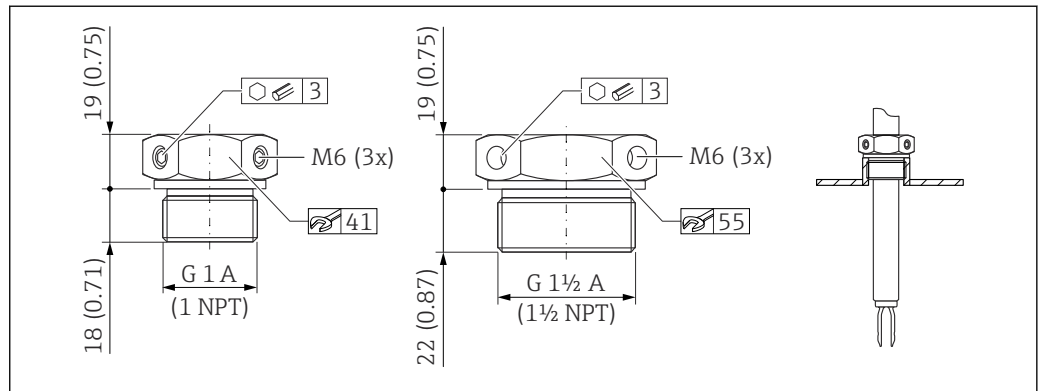

A0037666

41 Sliding sleeves for unpressurized operation $p_e = 0$ bar (0 psi). Unit of measurement mm (in)

G 1, DIN ISO 228/I

- Material: 1.4435 (AISI 316L)
- Weight: 0.21 kg (0.46 lb)
- Order number: 52003978
- Order number: 52011888, approval: with inspection certificate EN 10204 - 3.1 material

NPT 1, ASME B 1.20.1

- Material: 1.4435 (AISI 316L)
- Weight: 0.21 kg (0.46 lb)
- Order number: 52003979
- Order number: 52011889, approval: with inspection certificate EN 10204 - 3.1 material

G 1 1/2, DIN ISO 228/I

- Material: 1.4435 (AISI 316L)
- Weight: 0.54 kg (1.19 lb)
- Order number: 52003980
- Order number: 52011890, approval: with inspection certificate EN 10204 - 3.1 material

NPT 1 1/2, ASME B 1.20.1


- Material: 1.4435 (AISI 316L)
- Weight: 0.54 kg (1.19 lb)
- Order number: 52003981
- Order number: 52011891, approval: with inspection certificate EN 10204 - 3.1 material

More detailed information and documentation are available:

- Product Configurator on the Endress+Hauser website www.endress.com
- Endress+Hauser sales organization www.addresses.endress.com

High pressure sliding sleeves

- Switch point, infinitely adjustable
- Use in explosive atmospheres
- Seal package made of graphite
- Graphite seal available as spare part 71078875
- For G 1, G 1½: seal is included in the delivery

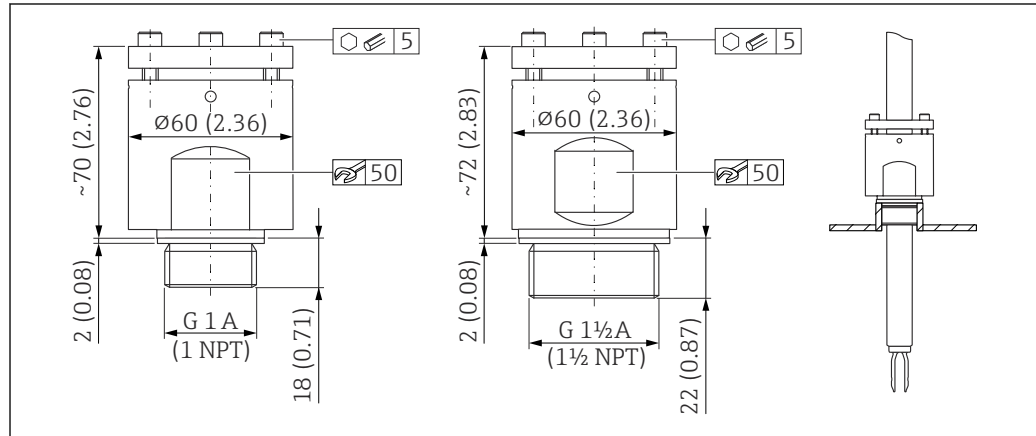

A0037667

42 High pressure sliding sleeves. Unit of measurement mm (in)

G 1, DIN ISO 228/I

- Material: 1.4435 (AISI 316L)
- Weight: 1.13 kg (2.49 lb)
- Order number: 52003663
- Order number: 52011880, approval: with inspection certificate EN 10204 - 3.1 material

G 1, DIN ISO 228/I

- Material: AlloyC22
- Weight: 1.13 kg (2.49 lb)
- Approval: with inspection certificate EN 10204 - 3.1 material
- Order number: 71118691

NPT 1, ASME B 1.20.1

- Material: 1.4435 (AISI 316L)
- Weight: 1.13 kg (2.49 lb)
- Order number: 52003667
- Order number: 52011881, approval: with inspection certificate EN 10204 - 3.1 material

NPT 1, ASME B 1.20.1

- Material: AlloyC22
- Weight: 1.13 kg (2.49 lb)
- Approval: with inspection certificate EN 10204 - 3.1 material
- Order number: 71118694

G 1½, DIN ISO 228/1

- Material: 1.4435 (AISI 316L)
- Weight: 1.32 kg (2.91 lb)
- Order number: 52003665
- Order number: 52011882, approval: with inspection certificate EN 10204 - 3.1 material

G 1½, DIN ISO 228/1


- Material: AlloyC22
- Weight: 1.32 kg (2.91 lb)
- Approval: with inspection certificate EN 10204 - 3.1 material
- Order number: 71118693

NPT 1½, ASME B 1.20.1

- Material: 1.4435 (AISI 316L)
- Weight: 1.32 kg (2.91 lb)
- Order number: 52003669
- Order number: 52011883, approval: with inspection certificate EN 10204 - 3.1 material

NPT 1½, ASME B 1.20.1

- Material: AlloyC22
- Weight: 1.32 kg (2.91 lb)
- Approval: with inspection certificate EN 10204 - 3.1 material
- Order number: 71118695

 More detailed information and documentation are available:

- Product Configurator on the Endress+Hauser website www.endress.com
- Endress+Hauser sales organization www.addresses.endress.com

Supplementary documentation



The certificates, approvals and other documentation currently available can be accessed as follows:

Endress+Hauser website: www.endress.com → Downloads.

Standard documentation

Document type: Operating Instructions (BA)

Installation and initial commissioning – contains all functions in the operating menu that are required for a typical measuring task. Functions beyond this scope are not included.

Document type: Description of Device Parameters (GP)

The document is part of the Operating Instructions and serves as a reference for parameters, providing a detailed explanation of each individual parameter of the operating menu.

Document type: Brief Operating Instructions (KA)

Quick guide to the first measured value – includes all essential information from incoming acceptance to electrical connection.

Document type: Safety Instructions, certificates

Depending on the approval, Safety Instructions are supplied with the device, e.g. XA. This documentation is an integral part of the Operating Instructions.

The nameplate indicates which Safety Instructions (XA) apply to the device in question.

Supplementary device-dependent documentation

Special Documentation

- SD02874F: Heartbeat Verification + Monitoring application package
- SD02530P: Graphic display with Bluetooth, radio approval
- SD02398F: Sliding sleeve for Liquiphant (installation instructions)
- SD01622P: Weld-in adapter (Installation Instructions)
- TI00426F: Adapter and flanges (overview)

Registered trademarks

HART®

Registered trademark of the FieldComm Group, Austin, Texas, USA

Bluetooth®

The *Bluetooth*® word mark and logos are registered trademarks owned by the Bluetooth SIG, Inc. and any use of such marks by Endress+Hauser is under license. Other trademarks and trade names are those of their respective owners.

Apple®

Apple, the Apple logo, iPhone, and iPod touch are trademarks of Apple Inc., registered in the U.S. and other countries. App Store is a service mark of Apple Inc.

Android®

Android, Google Play and the Google Play logo are trademarks of Google Inc.



www.addresses.endress.com
